

ANSI/NIRMA CM 1.0 – 2007

**American National Standard
for**

**Guidelines for Configuration Management
of
Nuclear Facilities**

Approved August 2007

NUCLEAR INFORMATION AND RECORDS MANAGEMENT ASSOCIATION



Technical standards developed by a committee, subcommittee, or ad hoc committee of the Nuclear Information and Records Management Association (NIRMA) represent a consensus of the members of the committee, subcommittee, or ad hoc committee with the concurrence of the NIRMA membership and Board of Directors. Standards are recommended procedures for establishment of a program or performance of a task related to the interests of NIRMA members. Standards represent the consensus of the sponsoring committee and are based upon the best information available from applicable regulatory requirements, industry standards and practical experience. A lesser amount of detail may be used to identify the areas of interface outside the scope of the standard.

NOTICE

A committee of the Nuclear Information and Records Management Association (NIRMA) prepared this standard. Neither this committee, members of NIRMA, other persons contributing to or assisting in the preparation of the standard, nor any person acting on behalf of these parties (a) makes any warranty or representation, expressed or implied, with respect to the accuracy, completeness, or usefulness of the information contained in this standard, or that the use of any information, apparatus, method, or process disclosed in this standard may not infringe on privately owned rights, or (b) assumes liabilities with respect to the use of any information, apparatus, method or process disclosed in this standard.

Abstract

This standard provides a description of the objectives to be achieved in the subject area of facility configuration management. It also contains definitions and functional criteria for the cost-effective implementation of configuration management at a nuclear facility, using a graded approach in defining configuration management requirements. It was prepared by members of the NIRMA Configuration Management Committee and the Configuration Management Benchmarking Group (CMBG) and received broad input from the electrical power generation and Department of Energy segments of the nuclear industry.

The purpose of this standard is to enable the implementation of effective configuration management so that conformance between design requirements, physical configuration and Facility Configuration Information can be achieved.

Contents

Foreword,	V
1.0 SCOPE,	1
2.0 DEFINITIONS,	1
3.0 CRITERIA,	3
3.1 Program Management,	3
3.2 Design Requirements,	5
3.3 Information Control,	7
3.4 Change Control,	8
3.5 Assessments,	9
3.6 CM Awareness Training,	10
APPENDICES	
Appendix A, CM Process Model and Equilibrium Restoration	12
BIBLIOGRAPHY,	14
INDEX,	15

Foreword

(This foreword is not part of the ANSI/NIRMA Standard for Configuration Management of Nuclear Facilities)

This revision to the standard was prepared by a team of industry representatives associated with NIRMA and the Configuration Management Benchmarking Group (CMBG) who are involved in the management of utility nuclear generating plants and Department of Energy (DOE) nuclear facilities. This document serves as a standard for the successful implementation of configuration management (CM). It draws on previously issued ANSI, DOE and NIRMA standards and guidelines, as well as recent industry experience and is directed primarily at organizations that manage a nuclear facility (in any stage of its life cycle). The concepts and elements identified in this standard may also be adapted for application at non-nuclear facilities.

The standard contains functional criteria for the cost-effective implementation of configuration management at a nuclear facility. Key implementation factors include use of a graded approach in defining configuration management requirements. Its purpose is to enable the implementation of effective configuration management so that conformance between design requirements, physical configuration and Facility Configuration Information can be achieved.

Management of the Facility Configuration Information (FCI) is a major objective and is addressed through recognition of appropriate process controls.

This standard does not address the subject of configuration management for computer software. Software CM is a component of configuration management for a facility; however, existing industry guidelines and

standards provide adequate guidance on this topic. Thus, it is not included in this standard.

This standard does not provide configuration management related guidance regarding product acquisition or management. It also does not provide guidance regarding performing design basis reconstitution.

This standard addresses facility authorization or licensing processes only in the context of facility configuration changes. It does not generally address the processes or requirements associated with obtaining or maintaining authorization or a license for construction or operation of a facility.

NIRMA wishes to acknowledge the efforts of the following subcommittee members who, during the course of its development, provided a significant contribution to the content of this revision to the standard:

Duane Wilson
Erin Engineering
NIRMA member

Michael D. Stout
Spescom Software
NIRMA Committee Chairperson

Richard Giska
Southern California Edison
NIRMA Business Unit Director

Linda Torunski
Entergy Nuclear Northeast
NIRMA Board Sponsor

Daniel Bierbrauer
Constellation Energy
NIRMA member

Timothy Cotter
Entergy Nuclear Northeast
NIRMA member

Thomas Czerniewski
Entergy Nuclear Northeast

Brian Grimes
Independent Consultant

Lloyd Hancock
LRH Consulting

Richard Harris
Duke Energy

Robert Hess
Pacific Gas and Electric


John Parler
South Carolina Electric and Gas

Keith Reinsmith
PPL Susquehanna

CONFIGURATION MANAGEMENT OF NUCLEAR FACILITIES

1.0 SCOPE

This standard contains functional criteria for the cost-effective implementation of configuration management at a nuclear facility. Its purpose is to enable the implementation of configuration management so that equilibrium between design requirements, physical configuration and Facility Configuration Information can be achieved and maintained in order to reduce costs and risk of error. This objective is depicted in Figure 1.

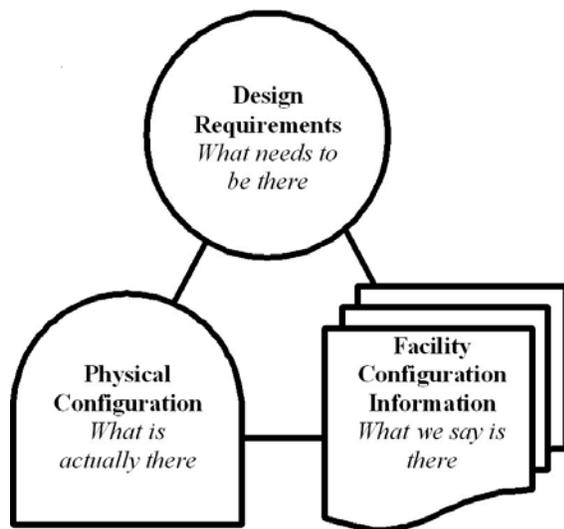

Objectives of Work Processes Are:

- Elements conform all of the time
- All changes are authorized
- Conformance can be verified

Figure 1 - Configuration Management Equilibrium Model

The guidance in this standard may be applied during all phases of the facility life cycle.

This standard does not provide configuration management related guidance regarding product or software acquisition or management. It also does not provide guidance regarding facility authorization or licensing processes, or reconstitution of design basis information.

2.0 DEFINITIONS

These definitions were developed to reflect general industry practices and are provided as a common reference relative to configuration management of nuclear facilities. Application of these definitions should take into consideration relevant terminology in effect at a facility as well as applicable industry guidance documents that address specific terms.

2.1 As-built - Documentation or data verified by physical inspection as depicting the current physical configuration within specified tolerances and verified as consistent with the design requirements, e.g., Piping and Instrument Diagrams.

2.2 As-designed - Facility Configuration Information that describes the facility configuration based on approved, but not yet implemented changes.

2.3 Authorization Basis Information- [Also referred to as Licensing Basis Information] - Those aspects of the Facility Configuration Information relied upon by the agency that authorizes or licenses facility construction and operation, (e.g., DOE, NRC) to understand the proposed facility configuration. It is not the entire licensing or authorization basis for the facility. Authorization basis information is described in documents such as the facility Safety Analysis Report, other safety analyses, hazard classification documents, the Technical Specifications or Technical Safety Requirements, and facility specific commitments made to satisfy requirements of the authorizing agency.