

Design of Steel Transmission Pole Structures

This document uses both the
International System of Units (SI)
and customary units

American Society of Civil Engineers

Design of Steel Transmission Pole Structures

This document uses both the International System of Units (SI) and customary units.



Published by the American Society of Civil Engineers

Library of Congress Cataloging-in-Publication Data

Magee, William L.

Design of steel transmission pole structures / William L. Magee.

p. cm.

ISBN 0-7844-0837-8

1. Electric lines—Poles and towers—Design and construction. 2. Steel, Structural. I. Title.

TK3242.D47 2006

621.319'22—dc22

2006004365

Published by American Society of Civil Engineers
1801 Alexander Bell Drive
Reston, Virginia 20191
www.pubs.asce.org

Any statements expressed in these materials are those of the individual authors and do not necessarily represent the views of ASCE, which takes no responsibility for any statement made herein. No reference made in this publication to any specific method, product, process, or service constitutes or implies an endorsement, recommendation, or warranty thereof by ASCE.

ASCE makes no representation or warranty of any kind, whether express or implied, concerning the accuracy, completeness, suitability, or utility of any information, apparatus, product, or process discussed in this publication, and assumes no liability therefore. This information should not be used without first securing competent advice with respect to its suitability for any general or specific application. Anyone utilizing this information assumes all liability arising from such use, including but not limited to infringement of any patent or patents.

ASCE and American Society of Civil Engineers—Registered in U.S. Patent and Trademark Office.

Photocopies and reprints. You can obtain instant permission to photocopy ASCE publications by using ASCE's online permission service (www.pubs.asce.org/authors/RightslinkWelcomePage.html). Requests for bulk copying of 100 copies or more should be submitted to the Reprints Department, Publications Division, ASCE (address above); email: permissions@asce.org. A reprint order form can be found at <http://www.pubs.asce.org/authors/reprints.html>

Copyright © 2006 by the American Society of Civil Engineers.
All Rights Reserved.
ISBN 07844-0837-8
Manufactured in the United States of America.

STANDARDS

In April 1980, the Board of Direction approved ASCE Rules for Standards Committees to govern the writing and maintenance of standards developed by the Society. All such standards are developed by a consensus standards process managed by the Codes and Standards Activities Committee. The consensus process includes balloting by the Balanced Standards Committee, which is composed of Society members and nonmembers, balloting by the membership of ASCE as a whole, and balloting by the public. All standards are updated or reaffirmed by the same process at intervals not exceeding 5 years.

The following Standards have been issued:

- ANSI/ASCE 1-82 N-725 Guideline for Design and Analysis of Nuclear Safety Related Earth Structures
- ANSI/ASCE 2-91 Measurement of Oxygen Transfer in Clean Water
- ANSI/ASCE 3-91 Standard for the Structural Design of Composite Slabs and ANSI/ASCE 9-91 Standard Practice for the Construction and Inspection of Composite Slabs
- ASCE 4-98 Seismic Analysis of Safety-Related Nuclear Structures
- Building Code Requirements for Masonry Structures (ACI 530-02/ASCE 5-02/TMS 402-02) and Specifications for Masonry Structures (ACI 530.1-02/ASCE 6-02/TMS 602-02)
- ASCE/SEI 7-05 Minimum Design Loads for Buildings and Other Structures
- ANSI/ASCE 8-90 Standard Specification for the Design of Cold-Formed Stainless Steel Structural Members
- ANSI/ASCE 9-91 listed with ASCE 3-91
- ASCE 10-97 Design of Latticed Steel Transmission Structures
- SEI/ASCE 11-99 Guideline for Structural Condition Assessment of Existing Buildings
- ASCE 12-05 Guidelines for the Design of Urban Subsurface Drainage
- ASCE 13-05 Standard Guidelines for Installation of Urban Subsurface Drainage
- ASCE 14-05 Standard Guidelines for Operation and Maintenance of Urban Subsurface Drainage
- ASCE 15-98 Standard Practice for Direct Design of Buried Precast Concrete Pipe Using Standard Installations (SIDD)
- ASCE 16-95 Standard for Load Resistance Factor Design (LRFD) of Engineered Wood Construction
- ASCE 17-96 Air-Supported Structures
- ASCE 18-96 Standard Guidelines for In-Process Oxygen Transfer Testing
- ASCE 19-96 Structural Applications of Steel Cables for Buildings
- ASCE 20-96 Standard Guidelines for the Design and Installation of Pile Foundations
- ASCE 21-96 Automated People Mover Standards—Part 1
- ASCE 21-98 Automated People Mover Standards—Part 2
- ASCE 21-00 Automated People Mover Standards—Part 3
- SEI/ASCE 23-97 Specification for Structural Steel Beams with Web Openings
- ASCE/SEI 24-05 Flood Resistant Design and Construction
- ASCE 25-97 Earthquake-Actuated Automatic Gas Shut-Off Devices
- ASCE 26-97 Standard Practice for Design of Buried Precast Concrete Box Sections
- ASCE 27-00 Standard Practice for Direct Design of Precast Concrete Pipe for Jacking in Trenchless Construction
- ASCE 28-00 Standard Practice for Direct Design of Precast Concrete Box Sections for Jacking in Trenchless Construction
- SEI/ASCE/SFPE 29-99 Standard Calculation Methods for Structural Fire Protection
- SEI/ASCE 30-00 Guideline for Condition Assessment of the Building Envelope
- SEI/ASCE 31-03 Seismic Evaluation of Existing Buildings
- SEI/ASCE 32-01 Design and Construction of Frost-Protected Shallow Foundations
- EWRI/ASCE 33-01 Comprehensive Transboundary International Water Quality Management Agreement
- EWRI/ASCE 34-01 Standard Guidelines for Artificial Recharge of Ground Water
- EWRI/ASCE 35-01 Guidelines for Quality Assurance of Installed Fine-Pore Aeration Equipment
- CI/ASCE 36-01 Standard Construction Guidelines for Microtunneling
- SEI/ASCE 37-02 Design Loads on Structures During Construction
- CI/ASCE 38-02 Standard Guideline for the Collection and Depiction of Existing Subsurface Utility Data
- EWRI/ASCE 39-03 Standard Practice for the Design and Operation of Hail Suppression Projects
- ASCE/EWRI 40-03 Regulated Riparian Model Water Code
- ASCE/EWRI 42-04 Standard Practice for the Design and Operation of Precipitation Enhancement Projects
- ASCE/SEI 43-05 Seismic Design Criteria for Structures, Systems, and Components in Nuclear Facilities
- ASCE/EWRI 44-05 Standard Practice for the Design and Operation of Supercooled Fog Dispersal Projects
- ASCE/EWRI 45-05 Standard Guidelines for the Design of Urban Stormwater Systems
- ASCE/EWRI 46-05 Standard Guidelines for the Installation of Urban Stormwater Systems
- ASCE/EWRI 47-05 Standard Guidelines for the Operation and Maintenance of Urban Stormwater Systems
- ASCE/SEI 48-05 Design of Steel Transmission Pole Structures

This page intentionally left blank

CONTENTS

Foreword	xiii
Acknowledgements	xiv
1.0 SCOPE	1
2.0 APPLICABLE DOCUMENTS	1
3.0 DEFINITIONS	2
4.0 LOADING, GEOMETRY, AND ANALYSIS	3
4.1 INTRODUCTION	3
4.2 LOADING	3
4.2.1 Factored Design Loads	3
4.2.2 Loading Considerations	3
4.2.3 Load Expression	3
4.3 GEOMETRIC CONFIGURATIONS	3
4.3.1 Configuration Considerations	3
4.3.2 Structure Types	3
4.4 METHODS OF ANALYSIS	4
4.4.1 Structural Analysis Methods	4
4.4.2 Analysis of Connections	4
4.5 ADDITIONAL CONSIDERATIONS	4
4.5.1 Structural Support	4
4.5.2 Design Restrictions	4
4.5.3 Climbing and Maintenance Provisions	4
5.0 DESIGN OF MEMBERS	4
5.1 INTRODUCTION	4
5.2 MEMBERS	4
5.2.1 Materials	4
5.2.1.1 Specifications	4
5.2.1.2 Material Properties	4
5.2.1.3 Energy-Impact Properties	4
5.2.2 Tension	5
5.2.3 Compression	5
5.2.3.1 Truss Members	5
5.2.3.2 Beam Members	5
5.2.4 Shear	7
5.2.5 Bending	7
5.2.6 Combined Stresses	7
5.3 GUYS	7
5.3.1 Material Properties	7
5.3.2 Tension	7
5.4 TEST VERIFICATION	8
6.0 DESIGN OF CONNECTIONS	8
6.1 INTRODUCTION	8

6.2	BOLTED AND PINNED CONNECTIONS	8
6.2.1	Materials	8
6.2.2	Shear Stress in Bearing Connections	8
6.2.3	Bolts Subject to Tension	8
6.2.4	Bolts Subject to Combined Shear and Tension	9
6.2.5	Bearing Stress in Bolted Connections	9
6.2.6	Minimum Edge Distances and Bolt Spacing for Bolted Connections	9
6.2.7	Bearing Stress in Pinned Connections	9
6.2.8	Minimum Edge Distances for Pinned Connections	9
6.3	WELDED CONNECTIONS	10
6.3.1	Material Properties	10
6.3.2	Effective Area	10
6.3.3	Design Stresses	11
6.3.3.1	Through-Thickness Stress	12
6.3.4	Circumferential Welded Splices	12
6.3.5	Flange and Base Plate to Pole Shaft Welds	12
6.3.6	T-joints	12
6.4	FIELD CONNECTIONS OF MEMBERS	12
6.4.1	Slip Joints	12
6.4.2	Base and Flange Plate Connections	12
6.5	TEST VERIFICATION	12
7.0	DETAILING AND FABRICATION	12
7.1	DETAILING	12
7.1.1	Drawings	12
7.1.2	Drawing Review	12
7.1.3	Erection Drawings	13
7.1.4	Shop Detail Drawings	13
7.1.4.1	Material	13
7.1.4.2	Dimensions and Tolerances	13
7.1.4.3	Welding	13
7.1.4.4	Corrosion and Finish Considerations	13
7.1.4.5	Other Requirements	13
7.2	FABRICATION	13
7.2.1	Material	13
7.2.2	Material Preparation	13
7.2.2.1	Cutting	13
7.2.2.2	Forming	13
7.2.2.3	Holes	14
7.2.2.4	Identification	14
7.2.3	Welding	14
8.0	TESTING	14
8.1	INTRODUCTION	14
8.2	FOUNDATIONS	14
8.3	MATERIAL	14
8.4	FABRICATION	14
8.5	STRAIN MEASUREMENTS	14
8.6	ASSEMBLY AND ERECTION	14

8.7	TEST LOADS	14
8.8	LOAD APPLICATION	14
8.9	LOADING PROCEDURE	14
8.10	LOAD MEASUREMENT	14
8.11	DEFLECTIONS	15
8.12	FAILURES	15
8.13	POSTTEST INSPECTION	15
8.14	DISPOSITION OF PROTOTYPE	15
8.15	REPORT	15
9.0	STRUCTURAL MEMBERS AND CONNECTIONS USED IN FOUNDATIONS	15
9.1	INTRODUCTION	15
9.2	GENERAL CONSIDERATIONS	15
9.3	ANCHOR BOLTS	15
9.3.1	Bolts Subject to Tension	15
9.3.2	Shear Stress	16
9.3.3	Combined Shear and Tension	16
9.3.4	Development Length	16
9.4	DIRECT-EMBEDDED POLES	17
9.5	EMBEDDED CASINGS	17
9.6	TEST VERIFICATION	17
10.0	QUALITY ASSURANCE/QUALITY CONTROL	17
10.1	INTRODUCTION	17
10.2	QUALITY ASSURANCE	17
10.2.1	Design and Drawings	17
10.2.2	Materials	17
10.2.3	Welding	17
10.2.4	Nondestructive Testing	17
10.2.5	Tolerances	17
10.2.6	Surface Coatings	17
10.2.7	Shipping	18
10.3	QUALITY CONTROL	18
10.3.1	Materials	18
10.3.2	Visual Inspection	18
10.3.3	Dimensional Inspection	18
10.3.4	Surface Coating Inspection	18
10.3.5	Weld Inspection	18
10.3.6	Shipment and Storage	18
11.0	ASSEMBLY AND ERECTION	18
11.1	INTRODUCTION	18
11.2	HANDLING	18
11.3	SINGLE POLE STRUCTURES	19
11.3.1	Slip Joints	19

11.3.2	Bolted Flange Joints	19
11.3.3	Attachments to Pole Sections	19
11.3.4	Erection of Assembled Structures	19
11.4	FRAME TYPE STRUCTURES	19
11.4.1	Slip Joints in Frames	19
11.4.2	Erection	19
11.4.3	Bolted Frame Connections	19
11.5	INSTALLATION ON FOUNDATION	19
11.5.1	Anchor Bolt and Base Plate Installation	19
11.5.2	Direct-Embedded Poles	19
11.6	GUYING	19
11.6.1	Guy Anchor Location	19
11.6.2	Guy Installation	20
11.7	POSTERECTION PROCEDURES	20
11.7.1	Inspection	20
11.7.2	Grounding	20
11.7.3	Coating Repair	20
11.7.4	Unloaded Arms	20
11.7.5	Hardware Installation	20

Commentary

C4.0	LOADING, GEOMETRY, AND ANALYSIS	21
C4.2	LOADING	21
C4.2.1	Factored Design Loads	21
C4.2.2	Loading Considerations	21
C4.2.3	Load Expression	21
C4.3	GEOMETRIC CONFIGURATIONS	22
C4.3.1	Configuration Considerations	22
C4.3.2	Structure Types	22
C4.4	METHODS OF ANALYSIS	22
C4.4.1	Structural Analysis Methods	22
C4.5	ADDITIONAL CONSIDERATIONS	23
C4.5.1	Structural Support	23
C4.5.2	Design Restrictions	23
C4.5.3	Climbing and Maintenance Provisions	24
C5.0	DESIGN OF MEMBERS	24
C5.1	INTRODUCTION	24
C5.2	MEMBERS	24
C5.2.1	Materials	24
C5.2.1.1	Specifications	24
C5.2.1.2	Material Properties	24
C5.2.1.3	Energy-Impact Properties	24
C5.2.2	Tension	25
C5.2.3	Compression	25
C5.2.3.1	Truss Members	25
C5.2.3.2	Beam Members	25
C5.2.4	Shear	29
C5.2.5	Bending	29

C5.2.6	Combined Stresses	29
C5.3	GUYS	29
C5.3.1	Material Properties	29
C5.3.2	Tension	29
REFERENCES		29
C6.0	DESIGN OF CONNECTIONS	30
C6.1	INTRODUCTION	30
C6.2	BOLTED AND PINNED CONNECTIONS	30
C6.2.1	Materials	30
C6.2.2	Shear Stress in Bearing Connections	30
C6.2.3	Bolts Subject to Tension	30
C6.2.6	Minimum Edge Distances and Bolt Spacing for Bolted Connections	30
C6.2.7	Bearing Stress in Pinned Connections	31
C6.2.8	Minimum Edge Distances for Pinned Connections	31
C6.3	WELDED CONNECTIONS	31
C6.3.3	Design Stresses	31
C6.3.3.1	Through-Thickness Stress	31
C6.4	FIELD CONNECTIONS OF MEMBERS	31
C6.4.1	Slip Joints	31
C6.4.2	Base and Flange Plate Connections	32
C6.5	TEST VERIFICATION	32
REFERENCE		32
C7.0	DETAILING AND FABRICATION	32
C7.1	DETAILING	32
C7.1.1	Drawings	32
C7.1.2	Drawing Review	32
C7.1.3	Erection Drawings	32
C7.1.4	Shop Detail Drawings	32
C7.1.4.2	Dimensions and Tolerances	32
C7.1.4.4	Corrosion and Finish Considerations	33
C7.1.4.5	Other Requirements	33
C7.2	FABRICATION	33
C7.2.1	Material	33
C7.2.2	Material Preparation	33
C7.2.2.1	Cutting	33
C7.2.2.2	Forming	33
C7.2.2.3	Holes	34
C7.2.2.4	Identification	34
C7.2.3	Welding	34
C8.0	TESTING	34
C8.1	INTRODUCTION	34
C8.2	FOUNDATIONS	34
C8.3	MATERIAL	35
C8.4	FABRICATION	35
C8.5	STRAIN MEASUREMENTS	35

C8.6	ASSEMBLY AND ERECTION	35
C8.7	TEST LOADS	35
C8.8	LOAD APPLICATION	35
C8.9	LOADING PROCEDURE	35
C8.10	LOAD MEASUREMENT	36
C8.11	DEFLECTIONS	36
C8.12	FAILURES	36
C8.13	POSTTEST INSPECTION	36
C8.14	DISPOSITION OF PROTOTYPE	36
C8.15	REPORT	36
C9.0	STRUCTURAL MEMBERS AND CONNECTIONS USED IN FOUNDATIONS	37
C9.1	INTRODUCTION	37
C9.2	GENERAL CONSIDERATIONS	38
C9.3	ANCHOR BOLTS	38
C9.3.1	Bolts Subject to Tension	38
C9.3.2	Shear Stress	38
C9.3.3	Combined Shear and Tension	38
C9.3.4	Development Length	39
C9.4	DIRECT-EMBEDDED POLES	39
C9.5	EMBEDDED CASINGS	39
C10.0	QUALITY ASSURANCE/QUALITY CONTROL	39
C10.1	INTRODUCTION	39
C10.2	QUALITY ASSURANCE	39
C10.2.1	Design and Drawings	40
C10.2.4	Nondestructive Testing	40
C10.2.5	Tolerances	40
C10.2.6	Surface Coatings	40
C10.2.7	Shipping	40
C10.3	QUALITY CONTROL	40
C10.3.1	Materials	40
C10.3.3	Dimensional Inspection	40
C10.3.4	Surface Coating Inspection	40
C10.3.5	Weld Inspection	40
C10.3.6	Shipment and Storage	41
C11.0	ASSEMBLY AND ERECTION	41
C11.1	INTRODUCTION	41
C11.2	HANDLING	41
C11.3	SINGLE POLE STRUCTURES	41
C11.3.1	Slip Joints	42
C11.3.2	Bolted Flange Joints	42
C11.3.3	Attachments to Pole Sections	42
C11.3.4	Erections of Assembled Structures	42

C11.4	FRAME TYPE STRUCTURES	42
C11.4.1	Slip Joints in Frames	43
C11.4.2	Erection	43
C11.5	INSTALLATION ON FOUNDATION	43
C11.5.1	Anchor Bolt and Base Plate Installation	43
C11.5.2	Direct-Embedded Poles	43
C11.6	GUYING	43
C11.6.1	Guy Anchor Location	43
C11.6.2	Guy Installation	44
C11.7	POSTERECTION PROCEDURES	44
C11.7.1	Inspection	44
C11.7.2	Grounding	44
C11.7.3	Coating Repair	44
C11.7.4	Unloaded Arms	44
C11.7.5	Hardware Installation	44
APPENDIX I	NOTATION	45
APPENDIX II	PROPERTIES OF VARIOUS TUBULAR SECTIONS	46
APPENDIX III	HORIZONTAL TESTING	48
Test Equipment	48	
Test Procedure for Pole Test	48	
APPENDIX IV	HEADED ANCHOR BOLTS	48
Headed Bolts Development Length	48	
Background	48	
APPENDIX V	ASSEMBLY AND ERECTION	49
Introduction	49	
Helicopter Erection	49	
In-Service Structure Maintenance and Inspection	49	
Wind-Induced Vibration	49	
APPENDIX VI	SHAFT-TO-FOUNDATION CONNECTION	50
Base Plates Analysis Considerations	50	
Calculation of Anchor Bolt Load	50	
INDEX		53

This page intentionally left blank

FOREWORD

The Engineering Manual and Report on Engineering Practice No. 72 titled “Design of Steel Transmission Pole Structures” has been used by electric transmission design professionals since 1973. The purpose of the design guide was to provide a uniform basis for the design, fabrication, testing, assembling, and erecting of steel transmission pole structures. Because many changes continue to take place in the steel pole industry, in 1989 it was proposed that ASCE form a committee to develop a standard. The proposal was approved, and the committee was organized in 1991. The second edition of Manual 72 served as the primary resource document for the development of this standard. The previous work of the ASCE task committee on Manual 72 is greatly appreciated.

This standard includes commentary and appendices that are furnished as supplemental information. The commentary and appendices are *not* mandatory.

This standard has been prepared in accordance with recognized engineering principles and should not be used without the user’s competent knowledge for a given application. The publication of this standard by ASCE is not intended as a warrant that the information contained therein is suitable for any general or specific use, and the Society takes no position with regards to the validity of patent rights. Users are advised that the determination of patent rights or risk of infringement is entirely their own responsibility.

It is with much appreciation that we acknowledge the contributions of two committee members who are no longer with us, Jerome G. Hanson and Dan S. Thiemann.

ACKNOWLEDGEMENTS

This standard was prepared through the consensus standards process by balloting in compliance with procedures of ASCE's Codes and Standards Activities

Committee. Those individuals who serve on the Design of Steel Transmission Pole Structures Standards Committee are

Richard F. Aichinger, P.E.
Gary E. Bowles, P.E.
David G. Brinker
Michael D. Brown, P.E.
Donald D. Cannon
Jerry G. Crawford, P.E.
Dana R. Crissey, P.E.
Martin L. De La Rosa, P.E.
David Endorf, P.E.
Michael R. Gall, P.E.
Lewis H. Grant, P.E.
Bobby G. Hagler, P.E.
Magdi F. Ishac, Ph.D., P.Eng.
Brian Lacoursiere, P.Eng.
Otto J. Lynch, P.E.
Leon Kempner, Jr., Ph.D., P.E.
Massoud Khavari, P.E.
Fred H. Kulhawy, Ph.D., P.E., G.E.

Paul M. Legrand, P.E.
William L. Magee, P.E., Vice-Chair
Terry C. McAnnally, P.E.
Marlo A. Menlove, P.E.
George E. Murray, P.E.
William B. Mills, P.E.
Robert E. Nickerson, P.E, Secretary
Garold D. Oberlender, Ph.D., P.E.
Robert L. Patterson, P.E.
Alain H. Peyrot, Ph.D., P.E.
Ronald E. Randle, P.E., Chair
Randall L. Samson, P.E.
Pedram Sadr, P.E.
Majed J. Saleh
Kenneth L. Sharpless, P.E.
Jerry Tang, P.E.
Marlon W. Vogt, P.E.

Design of Steel Transmission Pole Structures

1.0 SCOPE

Design of Steel Transmission Pole Structures specifies requirements for the design, fabrication, testing, assembly, and erection of cold-formed tubular members and connections for steel electrical transmission pole structures. Structure components (members, connections, guys) are selected to resist factored design loads at stresses approaching yielding, buckling, fracture, or any other limiting condition specified in this standard. Distribution, substation, communication, and railroad electric traction structures are not included within the scope of this standard.

Units of measurement herein are expressed first in English units followed by the International System (SI) units in parentheses. Formulae are based on English units, and, thus, some formulae require a conversion factor to use SI units. The appropriate conversion factor is given following each formula.

2.0 APPLICABLE DOCUMENTS

The following standards are referenced in this document:

ASTM International (ASTM) Standards
A6/A6M-04 Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
A36/A36M-03a Standard Specification for Carbon Structural Steel
A123/A123M-02 Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
A143/A143M-03 Standard Practice for Safeguarding Against Embrittlement of Hot-Dip Galvanized Structural Steel Products and Procedure for Detecting Embrittlement
A153/A153M-03 Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
A193/A193M-03 Standard Specification for Alloy-Steel and Stainless Steel Bolting Materials for High-Temperature Service
A307-03 Standard Specification for Carbon Steel Bolts and Studs, 60,000 psi Tensile Strength
A325-04 Standard Specification for Structural Bolts, Steel, Heat Treated, 120/105 ksi Minimum Tensile Strength

A325M-04 Standard Specification for Structural Bolts, Steel Heat Treated 830 MPa Minimum Tensile Strength [Metric]

A354-03a Standard Specification for Quenched and Tempered Alloy Steel Bolts, Studs, and Other Externally Threaded Fasteners

A370-03a Standard Test Methods and Definitions for Mechanical Testing of Steel Products

A385-03 Standard Practice for Providing High-Quality Zinc Coatings (Hot-Dip)

A394-00 Standard Specification for Steel Transmission Tower Bolts, Zinc-Coated and Bare

A449-04 Standard Specification for Quenched and Tempered Steel Bolts and Studs

A475-03 Standard Specification for Zinc-Coated Steel Wire Strand

A490-04 Standard Specification for Structural Bolts, Alloy Steel, Heat Treated, 150 ksi Minimum Tensile Strength

A490M-04 Standard Specification for High-Strength Steel Bolts, Classes 10.9 and 10.9.3, for Structural Steel Joints [Metric]

A529/A529M-03 Standard Specification for High-Strength Carbon-Manganese Steel of Structural Quality

A563-04 Standard Specification for Carbon and Alloy Steel Nuts

A563M-03 Standard Specification for Carbon and Alloy Steel Nuts [Metric]

A568/A568M-03 Standard Specification for Steel, Sheet, Carbon, and High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, General Requirements for

A572/A572M-03 Standard Specification for High-Strength Low-Alloy Columbium-Vanadium Structural Steel

A588/A588M-03 Standard Specification for High-Strength Low-Alloy Structural Steel with 50 ksi [345 MPa] Minimum Yield Point to 4 in. [100 mm] Thick

A595-98(2002) Standard Specification for Steel Tubes, Low-Carbon, Tapered for Structural Use

A606-01 Standard Specification for Steel, Sheet and Strip, High-Strength, Low-Alloy, Hot-Rolled, and Cold-Rolled, with Improved Atmospheric Corrosion Resistance

A615/A615M-04 Standard Specification for Deformed and Plain Billet-Steel Bars for Concrete Reinforcement

A633/A633M-01 Standard Specification for Normalized High-Strength Low-Alloy Structural Steel Plates

A673/A673M-02 Standard Specification for Sampling Procedure for Impact Testing of Structural Steel

A780-01 Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings

A871/A871M-03a Standard Specification for High-Strength Low-Alloy Structural Steel Plate with Atmospheric Corrosion Resistance

A1011/A1011M-03a Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy and High-Strength Low-Alloy with Improved Formability

B416-98(2002) Standard Specification for Concentric-Lay-Stranded Aluminum-Clad Steel Conductors

E165-02 Standard Test Method for Liquid Penetrant Examination

E709-01 Standard Guide for Magnetic Particle Examination

American Welding Society (AWS) Standards
AWS B1.10:1999 Guide for Nondestructive Inspection of Welds

AWS C2.18-93 Guide for the Protection of Steel with Thermal Sprayed Coatings of Aluminum and Zinc and Their Alloys and Composites

AWS D1.1/D1.1M-2002 Structural Welding Code Steel

AWS D1.3-98 Structural Welding Code—Sheet Steel

AWS QC1-96 Standard for AWS Certification of Welding Inspectors

American Society of Civil Engineers (ASCE)
ASCE 10-97 Design of Latticed Steel

Transmission Structures

American Institute of Steel Construction (AISC)
AISC-ASD—Specification for Structural Steel Buildings Allowable Stress Design, and Plastic Design, June 1, 1989

Research Council on Structural Connections
RCSC—Specification for Structural Joints Using ASTM A325 or A490 Bolts, June 23, 2000

3.0 DEFINITIONS

Aeolian Vibration—High-frequency, low amplitude vibration generated by a low velocity steady wind blowing across the conductor or structural member.

Blast Cleaning—Cleaning and descaling of a steel object using peening action of shot, sand, or abrasive powder under high pressure.

Camber (or Precamber)—Pole curvature, induced in fabrication, used to counteract predetermined pole deflection, such that the pole will appear straight under a specified load condition.

Circumferential Weld—A weld joint directionally perpendicular to the long axis of a structural member. Commonly used to join two closed-section shapes of a common diameter.

Complete Fusion—Fusion that has occurred over the entire base metal surface intended for welding and between all adjoining weld beads.

Complete Joint Penetration—A penetration by weld metal for the full thickness of the base metal in a joint with a groove weld.

Design Stress—The maximum permitted stress in a given member.

Direct-Embedded Pole—A structure in which the lower section is extended below groundline a predetermined distance.

Edge Distance—The distance between the center of a connection hole and the edge of the plate or member.

Fabricator—The party responsible for the fabrication of the steel pole structure.

Factored Design Loads—Unfactored loads multiplied by a specified load factor to establish the design load on a structure.

Faying Surfaces—The contacting surfaces of two joined members.

Fusion—The melting together of filler metal and base metal (substrate), or of base metal only, to produce a weld.

Galloping Vibration—Low-frequency, large amplitude vibration that occurs when a moderate velocity steady wind blows over a conductor covered by a layer of ice deposited by freezing rain, mist, or sleet.

Ground Sleeve (or Corrosion Collar)—A steel jacket that encapsulates a portion of a direct-embedded pole immediately above and below the groundline.

Lamellar Tearing—Separation in highly restrained base metal caused by through-thickness strains induced by shrinkage of the adjacent weld metal.

Line Designer—An agent of the owner who is responsible for the design of the proposed transmission line.

Load Factor (or Overload Factor)—A multiplier used with the assumed loading condition or unfactored load, to establish the factored design load.

Local Buckling—An introduction of a series of waves or wrinkles in one or more elements of a

column section or the compressive side of a beam section because of the inability of the section to resist the compressive stress in its current geometric shape.

Loosely Bolted—Bolted connections in which the nuts are drawn into contact with the mating surface without being tightened beyond that which can be obtained without the use of tools.

Owner—The owner of the proposed transmission line or the owner's designated representative, who may be a consulting engineer, general contractor, or other.

Rake—The amount of horizontal pole top displacement created by installing a pole tilted out of plumb. It is used to counteract predetermined pole deflection such that the pole will appear plumb under a specified load condition.

Security Load—A design load used to decrease the risk of a cascading type line failure. Loads that could cause cascading could be weather-related or accident-related resulting from broken conductors, components, or failed structures.

Shield Wire—Wire installed above the conductors for lightning protection and fault current return. Other terms used are overhead ground wire, static wire, and optical ground wire (OPGW).

Shop Detail Drawings—Drawings that are usually prepared by the fabricator and that contain complete and detailed information necessary for the fabrication of the structure and components.

Slip Joint (or Slip Splice)—A telescoping type connection of two tapered tubular pole sections.

Snug-Tight—Tightness obtained manually through the full effort of a worker using an ordinary spud wrench or as obtained through a few impacts of an impact wrench.

Stability—The ability of a structure or member to support a given load without experiencing a sudden change in configuration.

Structure Designer—The party responsible for the design of the structure. May be an agent of the owner or fabricator.

T-Joint—A joint between two members located approximately at right angles to each other in the form of a "T".

Test Engineer—The person assigned overall responsibility for a structure test.

Through-Thickness Stress—Tensile stresses through the thickness of the plate that can cause failure parallel to the plate or tube surface.

Truss Member—Member designed to carry only axial force.

4.0 LOADING, GEOMETRY, AND ANALYSIS

4.1 INTRODUCTION

This section details the minimum basic information that the Owner shall provide in a written specification to enable the Structure Designer to design the structure. This section also details the methods of analysis that shall be utilized by the Structure Designer to design the structure.

4.2 LOADING

4.2.1 Factored Design Loads

Factored design loads shall be determined by the Owner and included in the design specification, drawings, or documents.

4.2.2 Loading Considerations

The development of factored design loads shall consider the following:

1. Conductor and shield wire properties,
2. Minimum legislated loads,
3. Historical climatic conditions,
4. Structure orientation,
5. Construction and maintenance operations,
6. Line security provisions, and
7. Unique loading situations.

4.2.3 Load Expression

Factored design loads shall be specified by the Owner and shall be expressed in the form of load trees or in tabular form. Factored design loads shall include the magnitude, direction, and point of application with respect to a single orthogonal coordinate system.

4.3 GEOMETRIC CONFIGURATIONS

4.3.1 Configuration Considerations

Tubular steel pole structures shall be designed with geometric configurations that are based on electrical, economic, and safety requirements specified by the Owner.

4.3.2 Structure Types

Tubular steel pole structures shall be designed as either self-supporting or guyed structures as specified by the Owner.

4.4 METHODS OF ANALYSIS

The Structure Designer shall use established principles of structural analysis to determine the forces and moments caused by the factored design loads.

4.4.1 Structural Analysis Methods

The Structure Designer shall utilize geometrically nonlinear elastic stress analysis methods.

4.4.2 Analysis of Connections

The Structure Designer shall be responsible for the analysis of all connections. This analysis shall be substantiated by stress calculations or by test results.

4.5 ADDITIONAL CONSIDERATIONS

4.5.1 Structural Support

The Owner shall specify the type and degree of support provided by foundations or guys that will be utilized with the installed structure. Additional requirements regarding foundations appear in Section 9.2.

4.5.2 Design Restrictions

The Owner shall specify design restrictions, including shipping length, shipping weight, diameter, taper, deflection, finish, shaft to shaft connection type, foundation type, and guy attachment and anchor location if applicable.

4.5.3 Climbing and Maintenance Provisions

The Owner shall specify the types and positions of climbing and maintenance apparatus. This includes information concerning ladder or step attachment devices, grounding connection provisions, and "hot line" maintenance equipment attachment details, where applicable.

5.0 DESIGN OF MEMBERS

5.1 INTRODUCTION

The design stresses for members shall be based on ultimate strength methods using factored design loads.

5.2 MEMBERS

This section contains criteria for determining design stress levels in tubular members and in truss members. Ground sleeves shall not be considered as structural members in the design.

5.2.1 Materials

5.2.1.1 Specifications

Materials conforming to the following ASTM Specifications are suitable for use under this standard:

ASTM A36/A36M, Standard Specification for Carbon Structural Steel;

ASTM A529/A529M, Standard Specification for High-Strength Carbon-Manganese Steel of Structural Quality;

ASTM A572/A572M, Standard Specification for High-Strength Low-Alloy Columbium-Vanadium Structural Steel;

ASTM A588/A588M, Standard Specification for High-Strength Low-Alloy Structural Steel with 50 ksi (345 MPa) Minimum Yield Point to 4 in. (100 mm) Thick;

ASTM A595, Standard Specification for Steel Tubes, Low-Carbon, Tapered for Structural Use;

ASTM A606, Standard Specification for Steel, Sheet and Strip, High-Strength, Low-Alloy, Hot-Rolled, and Cold-Rolled, with Improved Atmospheric Corrosion Resistance;

ASTM A633/A633M, Standard Specification for Normalized High-Strength Low-Alloy Structural Steel Plates;

ASTM A871/A871M, Standard Specification for High-Strength Low-Alloy Structural Steel Plate with Atmospheric Corrosion Resistance; and

ASTM A1011/A1011M, Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, and High-Strength Low-Alloy with Improved Formability.

This listing of suitable steels does not exclude the use of other steels that conform to the chemical and mechanical properties of one of the listed specifications or other published specifications, which establish the properties and suitability of the materials. As a minimum, material shall meet the requirements of ASTM A6 or ASTM A568, as applicable.

5.2.1.2 Material Properties

The yield stress, F_y , and the tensile stress, F_u , shall be the specified minimum values determined according to the appropriate ASTM specification. The modulus of elasticity, E , for steel is defined to be 29,000 ksi (200 GPa).

5.2.1.3 Energy-Impact Properties

Impact properties in the longitudinal direction of all structural plate or coil materials shall be determined in accordance with the Charpy V-notch test

described in ASTM A370 and, at a minimum, shall meet the requirements of 15 ft-lb (20 J) absorbed energy at a temperature of -20°F (-29°C). Absorbed energy requirements for subsize test specimens shall be in accordance with ASTM A370 and A673.

For all plate and coil materials of any thickness, heat-lot testing shall be used unless specified differently by the Owner.

5.2.2 Tension

The tensile stress shall not exceed either of the following:

$$\frac{P}{A_g} \leq F_t \quad \text{where } F_t = F_y \quad (\text{Eq. 5.2-1})$$

or

$$\frac{P}{A_n} \leq F_t \quad \text{where } F_t = 0.83F_u \quad (\text{Eq. 5.2-2})$$

where

- F_t = tensile stress permitted;
- F_y = specified minimum yield stress;
- F_u = specified minimum tensile stress;
- P = axial tension force on member;
- A_g = gross cross-sectional area; and
- A_n = net cross-sectional area.

5.2.3 Compression

Members subjected to compressive forces shall be checked for general stability and local buckling. The compressive stresses shall not exceed those permitted in the following sections.

5.2.3.1 Truss Members

For truss members with a uniform closed cross section, the actual compressive stress, f_a , shall not exceed the compressive stress permitted, F_a , as determined by the following:

$$F_a = F_y \left[1 - 0.5 \left(\frac{KL}{r C_c} \right)^2 \right] \quad \text{when } \frac{KL}{r} \leq C_c \quad (\text{Eq. 5.2-3})$$

$$F_a = \frac{\pi^2 E}{\left(\frac{KL}{r} \right)^2} \quad \text{when } \frac{KL}{r} > C_c \quad (\text{Eq. 5.2-4})$$

$$C_c = \pi \sqrt{\frac{2E}{F_y}} \quad (\text{Eq. 5.2-5})$$

where

- F_a = compressive stress permitted;
- F_y = specified minimum yield stress;
- E = modulus of elasticity;
- L = unbraced length;
- r = governing radius of gyration; and
- K = effective length factor.

KL/r is the largest slenderness ratio of any unbraced segment.

Truss members made of angles shall be designed in accordance with Section 3.7 of ASCE 10 (503).

5.2.3.2 Beam Members

The limiting values of w/t and D_o/t specified in this section may be exceeded without requiring a reduction in extreme fiber stress if local buckling stability is demonstrated by an adequate program of tests.

5.2.3.2.1 Regular Polygonal Members For formed, regular polygonal tubular members, the compressive stress, $P/A + Mc/I$, on the extreme fiber shall not exceed the following:

Octagonal, hexagonal, or rectangular members (bend angle $\geq 45^\circ$)

$$F_a = F_y \quad \text{when } \frac{w}{t} \leq \frac{260\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-6})$$

$$F_a = 1.42F_y \left(1.0 - 0.00114 \frac{1}{\Omega} \sqrt{F_y} \frac{w}{t} \right) \quad \text{when } \frac{260\Omega}{\sqrt{F_y}} < \frac{w}{t} \leq \frac{351\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-7})$$

$$F_a = \frac{104,980\Phi}{\left(\frac{w}{t} \right)^2} \quad \text{when } \frac{w}{t} > \frac{351\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-8})$$

Dodecagonal members (bend angle = 30°)

$$F_a = F_y \quad \text{when } \frac{w}{t} \leq \frac{240\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-9})$$

$$F_a = 1.45F_y \left(1.0 - 0.00129 \frac{1}{\Omega} \sqrt{F_y} \frac{w}{t} \right) \quad \text{when } \frac{240\Omega}{\sqrt{F_y}} < \frac{w}{t} \leq \frac{374\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-10})$$

$$F_a = \frac{104,980\Phi}{\left(\frac{w}{t} \right)^2} \quad \text{when } \frac{w}{t} > \frac{374\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-11})$$

Hexdecagonal members (bend angle = 22.5°)

$$F_a = F_y \quad \text{when} \quad \frac{w}{t} \leq \frac{215\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-12})$$

$$F_a = 1.42F_y \left(1.0 - 0.00137 \frac{1}{\Omega} \sqrt{F_y} \frac{w}{t} \right)$$

$$\text{when} \quad \frac{215\Omega}{\sqrt{F_y}} < \frac{w}{t} \leq \frac{412\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-13})$$

$$F_a = \frac{104,980\Phi}{\left(\frac{w}{t}\right)^2} \quad \text{when} \quad \frac{w}{t} > \frac{412\Omega}{\sqrt{F_y}} \quad (\text{Eq. 5.2-14})$$

where

- F_y = specified minimum yield stress;
- F_a = compressive stress permitted;
- w = flat width of a side;
- t = wall thickness;
- Ω = 1.0 for F_y or F_a in ksi (2.62 for F_y or F_a in Mpa); and
- Φ = 1.0 for F_a in ksi (6.90 for F_a in Mpa).

In determining w , the actual inside bend radius shall be used unless it exceeds $4t$, in which case it shall be taken equal to $4t$. For sections with two or more plies, this criterion shall be satisfied for each ply.

Table 5-1 summarizes the equations that shall be used to determine the compressive stress permitted based on bend angle and axial stress.

5.2.3.2.2 Rectangular Members Eqs. 5.2-6, 5.2-7, and 5.2-8 shall be used for rectangular members. The flat width associated with each side shall be treated separately. If the axial stress, f_a , is greater than 1 ksi (6.9 MPa), Eqs. 5.2-9, 5.2-10, and 5.2-11 shall be used.

5.2.3.2.3 Polygonal Elliptical Members The bend angle and flat width associated with elliptical cross sections are not constant. The smallest bend angle associated with a particular flat shall be used to deter-

mine the compressive stress permitted. See Table 5.1 to determine which equations shall be used based on this bend angle.

5.2.3.2.4 Round Members For round members or regular polygonal members with more than sixteen sides, the compressive stress shall not exceed the following:

$$\frac{f_a}{F_a} + \frac{f_b}{F_b} \leq 1 \quad (\text{Eq. 5.2-15})$$

where

- f_a = compressive stress due to axial loads;
- f_b = compressive stress due to bending moments;
- F_a = compressive stress permitted; and
- F_b = bending stress permitted.

$$F_a = F_y \quad \text{when} \quad \frac{D_o}{t} \leq \frac{3800\Phi}{F_y} \quad (\text{Eq. 5.2-16})$$

$$F_a = 0.75F_y + \frac{950\Phi}{\frac{D_o}{t}}$$

$$\text{when} \quad \frac{3800\Phi}{F_y} < \frac{D_o}{t} \leq \frac{12,000\Phi}{F_y} \quad (\text{Eq. 5.2-17})$$

$$F_b = F_y \quad \text{when} \quad \frac{D_o}{t} \leq \frac{6000\Phi}{F_y} \quad (\text{Eq. 5.2-18})$$

$$F_b = 0.70F_y + \frac{1800\Phi}{\frac{D_o}{t}}$$

$$\text{when} \quad \frac{6000\Phi}{F_y} < \frac{D_o}{t} \leq \frac{12,000\Phi}{F_y} \quad (\text{Eq. 5.2-19})$$

where

- D_o = outside diameter of the tubular section (flat-to-flat outside diameter for polygonal members);
- t = wall thickness; and
- Φ = 1.0 for F_y , F_a , or F_b in ksi (6.90 for F_y , F_a , or F_b in MPa).

TABLE 5-1. Compressive Stress Permitted Based on Bend Angle

Bend Angle	F_a	Equation
≥ 45°	≤ 1 ksi (6.9 MPa)	5.2-6, 5.2-7, 5.2-8
≥ 45°	> 1 ksi (6.9 MPa)	5.2-9, 5.2-10, 5.2-11
≥ 30° but < 45°	N.A.	5.2-9, 5.2-10, 5.2-11
≥ 22.5° but < 30°	N.A.	5.2-12, 5.2-13, 5.2-14
< 22.5°	N.A.	5.2-15, 5.2-16, 5.2-17, 5.2-18, 5.2-19

5.2.4 Shear

The shear stress resulting from applied shear forces, torsional shear, or a combination of the two shall not exceed the following:

$$\frac{VQ}{Ib} + \frac{Tc}{J} \leq F_v \quad \text{where } F_v = 0.58F_y \quad (\text{Eq. 5.2-20})$$

where

F_y = specified minimum yield stress;
 F_v = shear stress permitted;
 V = shear force;
 Q = moment of section about neutral axis;
 I = moment of inertia;
 T = torsional moment;
 J = torsional constant of cross section;
 c = distance from neutral axis to extreme fiber; and
 b = 2 times wall thickness (t).

5.2.5 Bending

The stress resulting from bending shall not exceed either of the following:

$$\frac{Mc}{I} \leq F_t \quad (\text{Eq. 5.2-21})$$

or

$$\frac{Mc}{I} \leq F_a \quad (\text{Eq. 5.2-22})$$

where

F_t = tensile stress permitted;
 F_a = compressive stress permitted;
 I = moment of inertia;
 M = bending moment; and
 c = distance from neutral axis to extreme fiber.

5.2.6 Combined Stresses

For a polygonal member, the combined stress at any point on the cross section shall not exceed the following:

$$\left[\left(\frac{P}{A} + \frac{M_x c_y}{I_x} + \frac{M_y c_x}{I_y} \right)^2 + 3 \left(\frac{VQ}{It} + \frac{Tc}{J} \right)^2 \right]^{(1/2)} \leq F_t \quad \text{or } F_a \quad (\text{Eq. 5.2-23})$$

For a round member, the combined stress at any point on the cross section shall not exceed the following:

$$\left[\left(\frac{P}{A} + \frac{M_x c_y}{I_x} + \frac{M_y c_x}{I_y} \right)^2 + 3 \left(\frac{VQ}{It} + \frac{Tc}{J} \right)^2 \right]^{(1/2)} \leq F_t \quad \text{or } F_b \quad (\text{Eq. 5.2-24})$$

where

F_a = compressive stress permitted by Section 5.2.3.2.1;
 F_b = bending stress permitted by Section 5.2.3.2.4;
 F_t = tensile stress permitted by Section 5.2.2;
 P = axial force on member;
 A = cross-sectional area;
 M_x = bending moment about X-X axis;
 M_y = bending moment about Y-Y axis;
 I_x = moment of inertia about X-X axis;
 I_y = moment of inertia about Y-Y axis;
 c_x = distance from Y-Y axis to point where stress is checked;
 c_y = distance from X-X axis to point where stress is checked;
 V = total resultant shear force;
 Q = moment of section about neutral axis;
 I = moment of inertia;
 T = torsional moment;
 J = torsional constant of cross section;
 c = distance from neutral axis to point where stress is checked; and
 t = wall thickness.

The bending stress (Mc/I) and shear stress portions of these equations shall be absolute values (i.e., always positive). The same equation shall be used to check tension and compression stresses. When checking tension, P/A is positive if the member is in tension and negative if the member is in compression. The converse is true when checking compression.

5.3 GUYS

5.3.1 Material Properties

The minimum rated breaking strength of guys shall be determined according to the appropriate ASTM specification or as specified by the Owner. The modulus of elasticity, E , of a guy shall be as specified by the applicable ASTM specification or as specified by the Owner. In the absence of a specified value, E shall be assumed to be 23,000 ksi (159 GPa).

5.3.2 Tension

The maximum design tension force in a guy shall not exceed the following:

$$P \leq P_{\max} \quad \text{where } P_{\max} = 0.65 \text{ RBS} \quad (\text{Eq. 5.3-1})$$

where

P = tension force in the guy;
 P_{\max} = maximum tension force permitted in the guy; and
RBS = minimum rated breaking strength of the guy.

5.4 TEST VERIFICATION

Design values other than those prescribed in this section can be used if substantiated by experimental or analytical investigations.

6.0 DESIGN OF CONNECTIONS

6.1 INTRODUCTION

The design stresses for connections shall be based on ultimate strength methods using factored design loads.

6.2 BOLTED AND PINNED CONNECTIONS

For bolted connections, these provisions shall pertain to holes with diameters a maximum of 0.125 in. (3 mm) larger than the nominal bolt diameter (except for anchor bolt holes). For pinned connections, the ratio of the diameter of the hole to the diameter of the pin shall be less than 2.

6.2.1 Materials

Materials conforming to the following standard specifications are suitable for use under this standard:

ASTM A325, Standard Specification for Structural Bolts, Steel, Heat Treated, 120/105 ksi Minimum Tensile Strength;

ASTM A325M, Standard Specification for Structural Bolts, Steel Heat Treated 830 MPa Minimum Tensile Strength [Metric];

ASTM A307, Standard Specification for Carbon Steel Bolts and Studs, 60,000 psi Tensile Strength;

ASTM A354, Standard Specification for Quenched and Tempered Alloy Steel Bolts, Studs, and Other Externally Threaded Fasteners;

ASTM A394, Standard Specification for Steel Transmission Tower Bolts, Zinc-Coated and Bare;

ASTM A449, Standard Specification for Quenched and Tempered Steel Bolts and Studs;

ASTM A490, Standard Specification for Structural Bolts, Alloy Steel, Heat Treated, 150 ksi Minimum Tensile Strength;

ASTM A490M, Standard Specification for High-Strength Steel Bolts, Classes 10.9 and 10.9.3, for Structural Steel Joints [Metric];

ASTM A563, Standard Specification for Carbon and Alloy Steel Nuts; and

ASTM A563M, Standard Specification for Carbon and Alloy Steel Nuts [Metric].

This listing of suitable steels does not exclude the use of other steels that conform to the chemical and mechanical properties of one of the listed specifications or other published specifications, which establish the properties and suitability of the material.

6.2.2 Shear Stress in Bearing Connections

The shear stress for bolts and pins shall not exceed the following:

$$\frac{V}{A} \leq F_v \quad \text{where } F_v = 0.45 F_u \quad (\text{Eq. 6.2-1})$$

where

V = shear force (bolt or pin);

A = either A_g or A_r ;

A_g = gross cross-sectional area of the shank (bolt or pin);

A_r = cross-sectional area at root of the threads;

F_v = shear stress permitted (bolt or pin); and

F_u = specified minimum tensile stress (bolt or pin).

A_r shall be used if the shear plane passes through the threads, and A_g may be used if the threads are excluded from the shear plane.

6.2.3 Bolts Subject to Tension

The values for tensile stress, proof-load stress, and yield stress shall be the specified minimum values as given in the applicable ASTM specification.

Bolts shall be proportioned so that the sum of the tensile stresses caused by the applied external load and any tensile stress resulting from prying action does not exceed the permitted tensile stress, F_t , as follows:

1. For bolts having a specified proof-load stress, F_t shall equal the lowest value of ASTM proof-load stress by the length-measurement method, or $0.83F_u$ (where F_u is the specified minimum tensile stress of the bolt).
2. For bolts with no specified proof-load stress but a specified yield stress, F_t shall equal the lowest value of F_y , where F_y is the specified yield stress, or $0.83F_u$ (where F_u is the specified minimum tensile stress of the bolt).
3. For bolts with no specified proof-load stress or yield stress, F_t shall equal $0.60F_u$, where F_u is the specified minimum tensile stress of the bolt.

$$\frac{T_s}{A_s} = F_t \quad (\text{Eq. 6.2-2})$$

The stress area, A_s , is given by

$$A_s = \frac{\pi}{4} \left(d - \frac{0.9743}{n} \right)^2 \quad (\text{Eq. 6.2-3})$$

where

T_s = bolt tensile force;
 D = nominal diameter of the bolt; and
 n = number of threads per unit of length.

6.2.4 Bolts Subject to Combined Shear and Tension

For bolts subject to combined shear and tension, the permitted axial tensile stress in conjunction with shear stress, $F_{t(v)}$, shall be

$$F_{t(v)} = F_t \sqrt{1 - \left(\frac{f_v}{F_v} \right)^2} \quad (\text{Eq. 6.2-4})$$

where

F_v = shear stress permitted defined in Section 6.2.2;
 F_t = tensile stress permitted defined in Section 6.2.3;
 and
 f_v = shear stress on effective area.

The combined tensile and shear stresses shall be taken at the same cross section in the bolt.

6.2.5 Bearing Stress in Bolted Connections

The maximum bearing stress shall satisfy the following condition:

$$f_{br} = \frac{P}{dt} \leq 1.5 F_u \quad (\text{Eq. 6.2-5})$$

where

f_{br} = bearing stress;
 P = force transmitted by the bolt;
 d = nominal diameter of the bolt;
 t = member thickness; and
 F_u = specified minimum tensile stress of the member.

6.2.6 Minimum Edge Distances and Bolt Spacing for Bolted Connections

Minimum edge distances shall satisfy the following conditions:

$$L_e = \frac{1.2P}{F_u t} \quad (\text{Eq. 6.2-6})$$

$$L_e = 1.3d \quad (\text{Eq. 6.2-7})$$

$$L_e = t + \frac{d}{2} \quad (\text{Eq. 6.2-8})$$

and

$$L_e = \frac{1}{2} \left[\frac{P}{0.58 F_y t} + d_h \right] \quad (\text{Eq. 6.2-9})$$

Minimum bolt spacing shall satisfy the following condition:

$$s \geq 2.67 d \quad (\text{Eq. 6.2-10})$$

where

P = force transmitted by the bolt;
 L_e = minimum edge distance, parallel to the load, from the center of the hole to the edge of the member;
 d = nominal diameter of the bolt;
 d_h = diameter of the hole;
 t = member thickness;
 F_u = specified minimum tensile stress of the member;
 F_y = specified minimum yield stress of the member; and
 s = minimum center-to-center spacing between bolts.

6.2.7 Bearing Stress in Pinned Connections

The maximum bearing stress shall satisfy the following condition:

$$f_{br} = \frac{P}{dt} \leq 1.35 F_u \quad (\text{Eq. 6.2-11})$$

where

f_{br} = bearing stress;
 P = force transmitted by the pin;
 d = nominal diameter of the pin;
 t = member thickness; and
 F_u = specified minimum tensile stress of the member.

6.2.8 Minimum Edge Distances for Pinned Connections

Minimum edge distances shall satisfy the following conditions:

$$L_s = \frac{1}{2} \left[\frac{P}{0.75 F_y t} + d_h \right] \quad (\text{Eq. 6.2-12})$$

and

$$L_e = \frac{1}{2} \left[\frac{P}{0.375 F_u t} + d_h \right] \quad (\text{Eq. 6.2-13})$$

where

- P = force transmitted by the pin;
- L_e = minimum edge distance, parallel to the load, from the center of the hole to the edge of the member;
- L_s = minimum edge distance, perpendicular to the load, from the center of the hole to the edge of the member;
- d_h = diameter of the attachment hole;
- t = member thickness;
- F_y = specified minimum yield stress of the member; and
- F_u = specified minimum tensile stress of the member.

6.3 WELDED CONNECTIONS

6.3.1 Material Properties

The nominal tensile strength of weld metals shall be based on the minimum values as established in the AWS D1.1. Weld material shall be compatible with the base material as specified in the AWS D1.1. Welding electrodes shall meet the same Charpy impact requirements as the base material.

6.3.2 Effective Area

Except for plug and slot welds, the effective area of a weld joint shall be equal to the effective length of

the weld times the effective throat thickness. For plug and slot welds, the effective area shall be considered to be the nominal cross-sectional area of the hole or slot in the plane of the faying surface.

The effective length of a groove weld shall be equal to the width of the connected part. The effective throat of a complete penetration groove weld shall be equal to the thickness of the thinner connected part. The effective throat thickness of partial penetration groove welds is listed in Table 6-1. The effective throat thickness for flare groove welds is listed in Table 6-2.

Except for welds in holes and slots, the effective length of a fillet weld shall be the overall length of a full-size fillet, including returns. For fillet welds in holes and slots, the effective length shall be the length of the center line of the weld through the center of the plane through the throat. In the case of overlapping fillets, the effective area shall not exceed the nominal cross-sectional area of the hole or slot in the plane of the faying surface.

The effective throat thickness of a fillet weld shall be the shortest distance from the root to the face of the diagrammatic weld. For fillets made by the submerged arc process, the effective throat shall be equal to the leg size for 0.375 in. (9.5 mm) and smaller fillets and equal to the theoretical throat plus 0.11 in. (2.8 mm) for fillets over 0.375 in. (9.5 mm).

TABLE 6-1. Effective Throat Thickness of Partial Penetration Groove Welds

Welding Process	Welding Position	Included Angle at Root of Groove	Effective Throat Thickness
Shielded metal arc or submerged arc	All	< 60° but ≥ 45°	Depth of chamfer minus 1/8 in. (3.2 mm)
		≥ 60°	Depth of chamfer
Gas metal arc or flux cored arc	All	≥ 60°	Depth of chamfer
	Horizontal or flat	< 60° but ≥ 45°	Depth of chamfer
	Vertical or overhead	< 60° but ≥ 45°	Depth of chamfer minus 1/8 in. (3.2 mm)
Electrode gas	All	> 60°	Depth of chamfer

TABLE 6-2. Effective Throat Thickness of Flare Groove Welds

Type of Weld	Radius (R) of Bar or Bend	Effective Throat Thickness
Flare-bevel-groove	All	5/16R
Flare-V-groove	All	1/2R ^a

^aUse 3/8R for Gas Metal Arc Welding (except short circuiting transfer process) when R ≥ 1/2 in. (12.7 mm).

6.3.3 Design Stresses

Design stresses for welds shall conform to the following: Table 6-3—Complete Penetration Groove Welds; Table 6-4—Fillet Welds; Table 6-5—Partial Penetration Groove Welds; and Table 6-6—Plug and Slot Welds.

In the case where the base metals are of different strengths, the lowest grade of base metal shall be used for the weld design.

TABLE 6-3. Complete Penetration Groove Welds

Type of Weld & Stress ^a	Design Stress	Required Weld Strength Level ^{b,c}
Tension normal to effective area	Same as base metal	“Matching” weld metal must be used
Compression normal to effective area	Same as base metal	
Tension or compression parallel to axis of weld	Same as base metal	
Shear on effective area	0.50X nominal tensile strength of weld metal, except shear stress on base metal shall not exceed 0.58X yield stress of base metal	Weld metal with a strength level equal to or less than “matching” weld metal may be used

^aFor definition of effective area, see Section 6.3.2.

^bFor “matching” weld metal, see Table 4.1, AWS D1.1.

^cWeld metal one strength level higher than “matching” weld metal will be permitted.

TABLE 6-4. Fillet Welds

Type of Weld & Stress ^a	Design Stress	Required Weld Strength Level ^{b,c}
Shear on effective area	0.50X nominal tensile strength of weld metal, except shear stress on base metal shall not exceed 0.58X yield stress of base metal	Weld metal with a strength level equal to or less than “matching” weld metal may be used
Tension or compression parallel to axis of weld	Same as base metal	

^aFor definition of effective area, see Section 6.3.2.

^bFor “matching” weld metal, see Table 4.1, AWS D1.1.

^cWeld metal one strength level higher than “matching” weld metal will be permitted.

TABLE 6-5. Partial Penetration Groove Welds

Type of Weld & Stress ^a	Design Stress	Required Weld Strength Level ^{b,c}
Compression normal to effective area	Same as base metal	
Tension or compression parallel to axis of weld	Same as base metal	
Shear parallel to axis of weld	0.50X nominal tensile strength of weld metal, except shear stress on base metal shall not exceed 0.58X yield stress of base metal	
Tension normal to effective area	0.50X nominal tensile strength of weld metal, except shear stress on base metal shall not exceed 1.0X yield stress of base metal or 36 ksi (248 MPa), whichever is less	Weld metal with a strength level equal to or less than “matching” weld metal may be used

^aFor definition of effective area, see Section 6.3.2.

^bFor “matching” weld metal, see Table 4.1, AWS D1.1.

^cWeld metal one strength level higher than “matching” weld metal will be permitted.

TABLE 6-6. Plug and Slot Welds

Type of Weld & Stress ^a	Design Stress	Required Weld Strength Level ^{b,c}
Shear parallel to faying surfaces (on effective area)	0.50X nominal tensile strength of weld metal, except shear stress on base metal shall not exceed 0.58X yield stress of base metal	Weld metal with a strength level equal to or less than “matching” weld metal may be used

^aFor definition of effective area, see Section 6.3.2.

^bFor “matching” weld metal, see Table 4.1, AWS D1.1.

^cWeld metal one strength level higher than “matching” weld metal will be permitted.

6.3.3.1 Through-Thickness Stress

Maximum design through-thickness stress shall be 36 ksi (248 MPa) for all grades of steel.

6.3.4 Circumferential Welded Splices

Complete penetration (100%) welds shall be used for sections joined by circumferential welds. Longitudinal welds within 3 in. (76 mm) of circumferential welds shall have complete fusion through the section thickness and complete joint penetration for processes using weld metal.

6.3.5 Flange and Base Plate to Pole Shaft Welds

Flange and base plate to pole shaft welds shall be complete penetration (100%) groove welds with reinforcing fillet to satisfy the requirements for through-thickness stresses in the flange or base plates. Longitudinal welds within 3 in. (76 mm) of a flange plate or base plate weld shall have complete fusion through the section thickness and complete joint penetration for processes using weld metal.

6.3.6 T-joints

T-joints shall satisfy the requirements for through-thickness stresses.

6.4 FIELD CONNECTIONS OF MEMBERS

6.4.1 Slip Joints

Slip joints shall be designed to resist the maximum forces and moments at the connection. As a minimum, slip joints shall be designed to resist 50% of the moment capacity of the lower strength tube. Taper above and below the slip joint shall be the same.

Supplemental locking devices shall be used if relative movement of the joint is critical or if the joint might be subjected to uplift forces. In resisting uplift forces, locking devices shall be designed to resist 100% of the maximum uplift load. The female section longitudinal seam weld in the area of the splice shall

have complete fusion through the section thickness and complete joint penetration for processes using weld metal for a length equal to the maximum lap dimension.

6.4.2 Base and Flange Plate Connections

Flexural stress in the base or flange plate shall not exceed the specified minimum yield stress, F_y , of the plate material. Base and flange plate connections shall be designed to resist the maximum forces and moments at the connection. As a minimum, base and flange plate connections shall be designed to resist 50% of the moment capacity of the lowest strength tube.

6.5 TEST VERIFICATION

Design values other than those prescribed in this section may be used if substantiated by experimental or analytical investigations.

7.0 DETAILING AND FABRICATION

7.1 DETAILING

7.1.1 Drawings

Drawings consist of erection and shop detail drawings. If shop detail drawings are provided by the Owner, the Owner shall be responsible for the completeness and accuracy of these drawings. If shop detail drawings are prepared by the Fabricator, the Fabricator shall be responsible for conveying the dimensions and details from the design and contract documents, the correctness of dimensional calculations performed in preparing the drawings, and the general fit-up of parts to be assembled in the field.

7.1.2 Drawing Review

Drawings shall be reviewed by the Structure Designer regarding the strength requirements of the

design and compliance with the Owner's specification. Drawings prepared by the Fabricator shall be submitted to the Owner for review.

7.1.3 Erection Drawings

Erection drawings shall show the complete field assembly of the structure, clearly indicating the positioning of the components, including fasteners. The identification markings for each component shall be indicated on the drawing. Fasteners shall be identified by grade, length, and diameter for bolts and grade and diameter for nuts and washers.

The erection drawings shall include a bill-of-material of all components for the structure, including the weight of each component. The erection drawings shall provide instructions for slip joint assembly, bolt tightening, and field welding where applicable.

7.1.4 Shop Detail Drawings

Shop detail drawings shall show all fabrication requirements, including material, dimensions, welding, shop applied finish, and any specific processing requirements, including those of the contract and applicable codes. They shall be shown either by assembled section or as piece by piece. The drawings shall indicate the piece mark of each component.

7.1.4.1 Material

Shop detail drawings shall specify member and connection materials, such as ASTM specification and grade designation.

7.1.4.2 Dimensions and Tolerances

Dimensioning practices, including tolerances, shall ensure compliance with clearance, appearance, strength, and assembly requirements. Proper mating of components detailed and supplied by one fabricator shall be the responsibility of that fabricator.

7.1.4.3 Welding

Welding shall be detailed in accordance with the AWS D1.1 Code including weld symbols. Only weld details that are prequalified or qualified in accordance with the AWS D1.1 Code shall be used. Appropriate detailing practices shall be used to ensure that the required penetration is achievable.

7.1.4.4 Corrosion and Finish Considerations

When shop finish is specified in the contract documents, the requirements and specifications for surface preparation, painting, galvanizing, and/or metallizing requirements shall be shown on the drawings.

Details for weathering steel structures shall be designed to avoid uncoated pockets, crevices, and faying surfaces that can collect and retain water, damp debris, and moisture. Weld backing for unsealed weathering steel structures shall be weathering steel.

7.1.4.5 Other Requirements

Specific requirements and limitations of the contract documents and applicable codes shall be shown on the drawings.

7.2 FABRICATION

Fabrication shall be performed in compliance with the shop detail drawings. The Fabricator shall be responsible for the means, methods, techniques, sequences, and procedures of fabrication. Safety precautions and programs for fabrication shall be the responsibility of the Fabricator.

7.2.1 Material

The Fabricator shall maintain a system, including records, that will verify that the structural steel furnished meets the specified requirements. Certified test reports from the plate or coil mills and from suppliers of bolts, welding electrode, and other materials shall constitute sufficient evidence of conformity. The Fabricator shall accurately identify all material to ensure proper usage.

7.2.2 Material Preparation

7.2.2.1 Cutting

Parts shall be cut in accordance with AWS D1.1. Burrs or sharp notches that are detrimental to the structure or that pose a safety hazard shall be removed. Reentry cuts shall be rounded.

7.2.2.2 Forming

Care shall be taken during forming to prevent separation of the outer surface and reduction of the cross-sectional properties below those required by design. If separation occurs during bending, it shall be repaired in accordance with AWS D1.1. Loosening of mill scale shall not be considered a separation.

When hot bending is required, heating shall be done evenly over the entire bend area and shall be of sufficient temperature to minimize separation and necking down of the cross section. The temperature used in hot bending shall be such that the physical properties of the steel are not diminished.

7.2.2.3 Holes

Bolt holes shall have the correct shape and alignment in accordance with connection details, be free of burrs, and be clean cut without torn or ragged edges.

7.2.2.4 Identification

All components shall be clearly marked.

7.2.3 Welding

All welding shall be performed by welders, welding operators, and tackers qualified for the type of welding to be performed. All welding and qualifications shall be in accordance with the applicable requirements of AWS D1.1 and AWS D1.3. Preheat and interpass temperatures shall be in accordance with AWS D1.1 or the steel manufacturer's recommendations. Longitudinal seam welds shall have 60 percent minimum penetration (except as specified in Sections 6.3.4, 6.3.5, and 6.4.1).

8.0 TESTING

8.1 INTRODUCTION

The Owner shall specify in the contract documents which structures or components of a structure will be tested. If a proof test of a structure or structure component is specified, the test shall be performed on a full-size prototype of the structure or structure component in accordance with the following sections.

8.2 FOUNDATIONS

The Structure Designer shall approve the support conditions used for testing.

8.3 MATERIAL

The prototype shall be made of material that is representative of the material that will be used in production. Mill test reports shall be available for each major component in the test structure. When mill test reports are unavailable, coupon tests are required. Coupon tests shall be performed in accordance with ASTM A370.

8.4 FABRICATION

Fabrication of the prototype shall be done in the same manner as for the production structure.

8.5 STRAIN MEASUREMENTS

The Owner shall specify if any special strain determination methods are required for the prototype and identify those components to be strain gaged.

8.6 ASSEMBLY AND ERECTION

The assembly method of the prototype shall be approved by the Owner. The completed test structure shall be erected within the tolerances established by the Owner.

8.7 TEST LOADS

The Owner shall specify in the contract documents which load cases shall be tested as a minimum and if the structure is to be tested to destruction. The test loads shall be the factored design loads.

8.8 LOAD APPLICATION

Load lines shall be attached to the load points on the prototype in a manner that simulates the in-service application as close as possible. The attachment hardware for the test shall have the same degrees of freedom as the in-service hardware. Wind-on-structure loads shall be applied as concentrated loads at selected points on the structure. Load application shall consider the deflected position of the structure.

8.9 LOADING PROCEDURE

The sequence of load cases tested shall be specified by the Structure Designer and approved by the Owner.

Loading shall be stopped at preselected load levels to allow time for reading deflections and to permit observation of the test to check for signs of structural distress.

8.10 LOAD MEASUREMENT

Loads shall be measured through a verifiable arrangement of strain devices or by predetermined dead weights. Load-measuring devices shall be used in accordance with manufacturer's recommendations and calibrated prior to and after the conclusion of testing.

8.11 DEFLECTIONS

At the locations specified by the Structure Designer and approved by the Owner, deflections of prototypes under load shall be measured and recorded by the test engineer. Deflection readings shall be made for the “before” and “off” load conditions as well as at each intermediate hold during loading. All deflections shall be referenced to common base readings taken before the first test loads are applied.

8.12 FAILURES

When failure occurs before application of 100% of the factored design loads, the cause of the failure, the corrective measures to be taken, and the need for a retest shall be determined by the Structure Designer and approved by the Owner.

8.13 POSTTEST INSPECTION

The prototype shall be inspected after testing. Welds shall be inspected in accordance with the normal fabrication procedures. Visual inspection for any signs of structural damage shall be conducted by the Test Engineer.

8.14 DISPOSITION OF PROTOTYPE

The contract document shall state the disposition of the prototype after the test is completed.

8.15 REPORT

The testing organization shall furnish the number of copies of the test report as required by the contract document. The test report shall describe the test procedure, test results, and any remedial action taken.

9.0 STRUCTURAL MEMBERS AND CONNECTIONS USED IN FOUNDATIONS

9.1 INTRODUCTION

This section specifies design procedures for steel members and connections embedded in concrete or other backfill material. This section is not intended to

serve as a foundation design guide. It is the responsibility of the Owner to ensure adequate geotechnical design.

9.2 GENERAL CONSIDERATIONS

As applicable, the Owner shall include the following in the specifications:

1. Foundation type,
2. Depth to point of foundation fixity,
3. Design limit for foundation rotation or deflection,
4. Foundation reveal,
5. Coating requirements,
6. Grounding requirements,
7. Concrete or backfill material strength,
8. Corrosion protection,
9. Other special requirements.

9.3 ANCHOR BOLTS

Anchor bolts shall be designed to transfer the tensile, compressive, and shear loads to the concrete by adequate embedment length or by the end connection. Impact properties in the longitudinal direction of all anchor bolt materials shall be determined in accordance with the Charpy V-notch test described in ASTM A370 and, at a minimum, shall meet the requirements of 15 ft-lb (20 J) absorbed energy at a temperature of -20°F (-29°C).

9.3.1 Bolts Subject to Tension

The tensile, proof-load, and yield stresses shall be specified minimum values determined according to the ASTM specification for the material involved.

Bolts shall be designed so that the sum of the tensile stresses caused by the applied external load and any tensile stress resulting from prying action does not exceed the tensile stress permitted, F_t , as follows:

1. For bolts having a specified proof-load stress, F_t shall equal the lowest value of ASTM proof-load stress by the length-measurement method or $0.83F_u$, where F_u is the specified minimum tensile stress of the bolt.
2. For bolts with no specified proof-load stress but a specified yield stress, F_t shall equal the lowest value of F_y , where F_y is the specified yield stress, or $0.83F_u$, where F_u is the specified minimum tensile stress of the bolt.

For bolts with no specified proof-load stress or yield stress, F_t shall equal $0.60F_u$, where F_u is the specified minimum tensile stress of bolt.

$$\frac{T_s}{A_s} = F_t \quad (\text{Eq. 9.3-1})$$

where the stress area, A_s , is given by

$$A_s = \frac{\pi}{4} \left(d - \frac{0.9743}{n} \right)^2 \quad (\text{Eq. 9.3-2})$$

where

- T_s = bolt tensile force;
- d = nominal diameter of the bolt; and
- n = number of threads per unit of length.

9.3.2 Shear Stress

The shear stress for anchor bolts shall be determined as follows:

$$\frac{V}{A_s} \leq F_v = 0.65 F_y \quad (\text{Eq. 9.3-3})$$

where

- V = shear force on bolt;
- $A_s = \pi/4(d - 0.9743/n)^2$, tensile stress area of bolt;
- F_v = shear stress permitted;
- F_y = specified minimum yield stress of bolt material;
- d = nominal diameter of the bolt; and
- n = number of threads per unit of length.

9.3.3 Combined Shear and Tension

For bolts subject to combined shear and tension, the permitted axial tensile stress in conjunction with shear stress, $F_{t(v)}$, shall be

$$F_{t(v)} = F_t \sqrt{1 - \left(\frac{f_v}{F_y} \right)^2} \quad (\text{Eq. 9.3-4})$$

where

- F_v = shear stress permitted defined in Section 9.3.2;
- F_t = tensile stress permitted defined in Section 9.3.1; and
- f_v = shear stress on effective area.

The combined tensile and shear stresses shall be taken at the same cross section in the bolt.

9.3.4 Development Length

The Owner shall provide a minimum of 3 in. (76 mm) clear concrete cover. The development length

for the threaded reinforcing bar used as anchor bolts shall be calculated as follows:

$$L_d = l_d \alpha \beta \gamma \quad (\text{Eq. 9.3-5})$$

where

- L_d = minimum development length (embedding) of anchor bolt; and
- l_d = basic development length of anchor bolt.

The basic development length for the bolt shall be as follows:

for bars up to and including #11 (35M), use the larger of

$$l_d = \frac{1.27 \Gamma A_g F_y}{\sqrt{f'_c}} \quad (\text{Eq. 9.3-6})$$

or

$$l_d = 0.400 \Phi d F_y \quad (\text{Eq. 9.3-7})$$

for #14 (45M) bars

$$l_d = \frac{2.69 \Theta F_y}{\sqrt{f'_c}} \quad (\text{Eq. 9.3-8})$$

for #18 and #18J (55M) bars

$$l_d = \frac{3.52 \Theta F_y}{\sqrt{f'_c}} \quad (\text{Eq. 9.3-9})$$

where

- A_g = gross area of anchor bolt;
- $A_{s(\text{req'd})}$ = required tensile stress area of bolt;
- F_y = specified minimum yield stress of anchor bolt;
- f'_c = specified compressive strength of concrete;
- d = anchor bolt diameter;
- Γ = 1.00 for F_y and f'_c in ksi and A_g in in.², and 0.0150 for F_y and f'_c in MPa and A_g in mm²;
- Φ = 1.00 for F_y in ksi and d in in., and 0.145 for F_y in MPa and d in mm;
- Θ = 1.00 for F_y and f'_c in ksi and 9.67 for F_y and f'_c in MPa;
- α = 1.0 if $F_y = 60$ ksi (414 MPa), or 1.2 if $F_y = 75$ ksi (517 MPa);
- β = 0.8 if the bolt spacing up to and including 6 in. (152 mm) on center, or 1.0 if the bolt spacing less than 6 in. (152 mm) on center; and
- γ = $A_{s(\text{req'd})}/A_g$.

9.4 DIRECT-EMBEDDED POLES

The embedded section shall be designed to resist the overturning moment, shear, and axial loads. The length of the section of the pole below the groundline shall be determined using a lateral resistance approach. The Owner shall be responsible for supplying the Structure Designer information regarding the embedment depth, allowable foundation rotation, and design point of fixity of the embedded section.

9.5 EMBEDDED CASINGS

The casing shall be designed to resist all design loads. The length of the embedded casing below the groundline shall be determined using a lateral resistance approach. The Owner shall be responsible for supplying the Structure Designer information regarding the embedment depth, allowable foundation rotation, design point of fixity of the embedded section, vibratory installation forces, vibratory device attachment, and method of steel pole attachment.

9.6 TEST VERIFICATION

Design values other than those prescribed in this section may be used if substantiated by experimental or analytical investigations.

10.0 QUALITY ASSURANCE/QUALITY CONTROL

10.1 INTRODUCTION

The contract between the Owner and the Fabricator shall state the responsibility of each party and the conditions under which the work will be accepted or rejected.

10.2 QUALITY ASSURANCE

Quality assurance (QA) is the responsibility of the Owner. The specifying and implementation of quality assurance requirements by the Owner shall not relieve the Fabricator of responsibility in producing a product in accordance with this standard.

10.2.1 Design and Drawings

The quality assurance specification shall indicate the procedure for review of the design concept, design

calculations, stress analyses, and the Fabricator's drawings.

10.2.2 Materials

The quality assurance specification shall specify the requirements for review and agreement on the Fabricator's material specifications, supply sources, material identification, storage, traceability procedures, and acceptance of certified mill test reports.

10.2.3 Welding

The quality assurance specification shall include requirements for the review of, and agreement on, welders' qualification and certification procedures, including a list of welders certified for the work to be performed. The quality assurance specification shall establish the process for acceptance of welding procedures for each type of weld and the method used to determine that the procedure will be performed with satisfactory quality control.

10.2.4 Nondestructive Testing

The quality assurance specification shall indicate the requirement for acceptance of the type and procedure of nondestructive testing and inspection programs employed during each step in the fabrication processes.

10.2.5 Tolerances

Fabrication tolerances shall be specified and agreed upon by the Owner and the Fabricator.

10.2.6 Surface Coatings

When painting is specified, the paint system, procedures, and methods of application shall be agreed upon by both the Owner and the Fabricator. The selected paint system shall be suitable for both the product and its intended exposure.

When galvanizing is specified, the procedure and facilities shall be agreed upon by the Owner and the Fabricator. Inspection rights and privileges, procedures, and acceptance or rejection of galvanized steel material shall conform to ASTM A123, A143, A153, and A385 as applicable. When metallizing is specified, the procedure and facilities shall be in accordance with the coating vendor's recommendations and be acceptable to both the Owner and the Fabricator. When bare weathering steel is specified, the need for and degree of blast cleaning the steel shall be agreed upon by the Owner and the Fabricator.

The quality assurance specification shall establish inspection rights, privileges, and procedures for evaluating the surface coating.

10.2.7 Shipping

When receiving material, all products shall be inspected for shipping damage prior to accepting delivery. If damage is apparent, the Owner shall immediately notify both the delivering carrier and the Fabricator.

10.3 QUALITY CONTROL

Quality control (QC) is the responsibility of the Fabricator. The Fabricator shall have a QC program consisting of a written document that establishes the procedures and methods of operation that affect the quality of the work. The QC functions shall be clearly defined and available for review and approval by the Owner. The QC program shall verify that the product meets the level of quality established by the Fabricator's standards and the Owner's specification. The QC program shall establish procedures for maintaining records of all pertinent information on all components.

10.3.1 Materials

The quality control program shall specify the review requirements of all materials that are used in the fabricating and coating of the complete structure, all mill test reports for material compliance, all material suppliers for their manufacturing procedures and quality control programs, and all welding electrodes.

The Fabricator shall maintain a system, including records, that will allow verification that the structural steel meets the specified requirements. Certified test reports from the plate mills and from the supplier of bolts, welding electrodes, and other materials in accordance with the governing specification shall constitute evidence of conformity. Certified tests by the Fabricator or a testing laboratory shall also constitute evidence of conformity.

10.3.2 Visual Inspection

Structural components and 100 percent of all welds shall be visually inspected to determine conformance to drawings, procedures, overall workmanship, weld contour, weld size, and any other pertinent items.

10.3.3 Dimensional Inspection

Structural components shall be inspected for dimensional compliance to determine conformance with detail drawings and established tolerances. When applicable, the Owner shall specify shop assembly requirements.

10.3.4 Surface Coating Inspection

The Fabricator shall check product preparation and coating thickness to ensure that the minimum dry film thickness requirements of the coating specification are met. Visual inspection shall be performed for the purpose of detecting pinholes, cracking, and other undesirable characteristics.

10.3.5 Weld Inspection

Quality control supervisory personnel shall be certified welding inspectors (CWI) in accordance with the provisions of AWS QCI. Weld inspection shall be performed in accordance with the requirements of Section 6, Inspection, Part C, of AWS D1.1. Personnel qualification for nondestructive weld testing shall be in accordance with Section 6.14.6.1 of AWS D1.1.

Complete penetration welds shall be 100% inspected by either ultrasonic (UT) or radiographic (RT) methods. Appropriate inspection practices shall be used to ensure that required penetration is achieved.

For galvanized members with large T-joint connections, such as base plates, flange plates, etc., ultrasonic nondestructive weld testing shall be performed on 100% of all such joints, not only before, but also after galvanizing to ensure no cracks have developed. Any indications found with this test shall be ground smooth and inspected with magnetic particle methods. Any positive indications following this inspection shall be repaired and reinspected, and the finish shall be repaired per ASTM. This requirement may be waived if the Fabricator can demonstrate through study and quality assurance records that it can control its material, forming, welding, and galvanizing processes to the degree that such continued inspection is unnecessary.

10.3.6 Shipment and Storage

The quality control program shall provide procedures that will prevent damage, loss, or deterioration to the structure during storage and shipment.

11.0 ASSEMBLY AND ERECTION

11.1 INTRODUCTION

This section covers the assembly and erection requirements for steel transmission pole structures.

11.2 HANDLING

Poles, pole sections, crossarms, and other structural elements shall be lifted and stored in such a manner as

to prevent excessive deflection, stresses, and buckling. Sections that are distorted, buckled, or permanently deflected shall not be installed. The Owner shall contact the Structure Designer to verify acceptability of members with suspected damage.

11.3 SINGLE POLE STRUCTURES

Assembly shall be in accordance with the erection drawings and requirements of the Owner.

11.3.1 Slip Joints

Slip joints shall be assembled in accordance with the Structure Designer's requirements as to method, equipment, and minimum and maximum permissible assembly force, as well as within the Fabricator's specified tolerance for maximum and minimum overlap length. In the event an assembled slip joint is not within the specified tolerance for overlap length, the actual overlap shall be reported to the Structure Designer for review of acceptability.

11.3.2 Bolted Flange Joints

Mating surfaces shall be cleaned of all foreign matter prior to assembly. The bolts shall be installed to snug-tight condition in a sequence to ensure the proper alignment of the two pole sections. Following snug tightening, the bolts shall be tensioned in accordance with the Structure Designer's recommendations using a similar tightening sequence. In the absence of specific tightening recommendations, the "turn-of-nut" method as described in Research Council on Structural Connections "Specification for Structural Joints Using ASTM A325 or A490 Bolts," Section 8.2.1, shall be employed for fastener tensioning.

11.3.3 Attachments to Pole Sections

Installation of crossarms and other attachments to the pole structure shall be in accordance with the Fabricator's recommendations.

11.3.4 Erection of Assembled Structures

Assembled structures with slip joints shall have the slip joints temporarily secured prior to lifting to prevent the pole sections from separating during the erection operation.

11.4 FRAME TYPE STRUCTURES

The assembly and erection procedure for frame structures shall be in accordance with the Fabricator's

recommendations and the requirements listed in Section 11.3 except as modified by this section.

11.4.1 Slip Joints in Frames

Slip joint connections shall be assembled as described in Section 11.3.1. On multiple leg structures, the assembled leg-length differential shall not exceed the practical adjustment length of the foundation system.

11.4.2 Erection

Erection of frame structures shall be in accordance with the Fabricator's recommendations, including the use of temporary braces or members as required to prevent damaging or overstressing members and connections during the installation procedure. All slip joints shall be restrained to prevent separation of the joint during structure erection.

11.4.3 Bolted Frame Connections

Bolted frame joints shall be assembled with fasteners loosely bolted to permit movement in the joint during installation of additional framing. Bolted joints shall be tightened after completion of structure erection in accordance with the Structure Designer's recommendation.

11.5 INSTALLATION ON FOUNDATION

11.5.1 Anchor Bolt and Base Plate Installation

Installation shall be made in such a manner as to ensure that all anchor bolt nuts are tightened to both the top and the bottom of the pole base plate in accordance with the Structure Designer's recommendations.

11.5.2 Direct-Embedded Poles

The annular opening around the embedded pole shall be backfilled with soil or concrete. Soil shall be compacted in accordance with the Line Designer's requirements.

11.6 GUYING

11.6.1 Guy Anchor Location

Guy anchors shall be installed at the locations specified by the Structure Designer and approved by the line designer. If field conditions prevent the installation of any anchor at the specified location, the Structure Designer shall be consulted to provide an acceptable alternate location or other specific measures.

11.6.2 Guy Installation

Installation and tensioning of guys shall be in accordance with the requirements of the Structure Designer.

11.7 POSTERECTION PROCEDURES

11.7.1 Inspection

Structures shall be inspected for proper tightening of all bolted joints, condition of protective coating, and vertical alignment (plumb or rake).

11.7.2 Grounding

Installation of all required structure grounding shall be completed promptly following structure erection.

11.7.3 Coating Repair

Per the Owner's approval, all damaged areas of protective coating shall be repaired in accordance with the coating manufacturer's recommendations.

11.7.4 Unloaded Arms

Unloaded arms shall be evaluated by the Structure Designer for susceptibility to damage from wind-induced oscillations. Remedial measures to reduce oscillation magnitudes shall be employed if damage is considered likely.

11.7.5 Hardware Installation

Conductor dampening devices and/or spacers for bundled conductors, if required, shall be installed after conductor stringing is completed.

COMMENTARY

This commentary is not a part of ASCE/SEI 48-05. It is intended for informational purposes only. This information is provided as explanatory and supplementary material to assist in applying the recommended requirements.

The sections of this commentary are numbered to correspond to the sections of the standard to which they refer. Since it is not necessary to have supplementary material for every section in the standard, there are gaps in the numbering sequence of the commentary.

C4.0 LOADING, GEOMETRY, AND ANALYSIS

C4.2 LOADING

C4.2.1 Factored Design Loads

The overload factors specified by the National Electrical Safety Code (NESC) are load factors according to the terminology of this standard. The ASCE has developed information to aid in the selection of loads for transmission line structures. "Guidelines for Electrical Transmission Line Structural Loading," ASCE Manuals and Reports on Engineering Practice No. 74, presents a reliability-based methodology for developing transmission line structure loads. Other methods for selecting loads also may be acceptable where utility companies have established procedures that are based on years of successful operating experience.

C4.2.2 Loading Considerations

Prevailing practice and most state laws require that transmission lines be designed, as a minimum, to meet the requirements of past or current editions of the NESC.

When evaluating potential structure loading criteria, the Owner should consider the following sources of information:

1. Individual utility planning criteria will usually dictate specific conductor and shield wire sizes.
2. Minimum legislated loading conditions are specified in applicable national, state, and local codes, e.g., NESC, California GO-95, and Canadian Standards Association (CSA-22.3).
3. Historical climatic conditions in the utility's service area may indicate loads in excess of legislated loads. These may include wind or ice, or any combination thereof, at a specified temperature.
4. Local terrain and line routing procedures will determine the individual structure orientation criteria.
5. Individual utility policies and procedures will determine specific construction and maintenance requirements such as structure stability prior to conductor/shield wire installation, the potential for

unbalanced longitudinal loads during conductor/shield wire stringing, the need for attachment provisions for structure lifting and hoisting material such as insulators, stringing blocks, etc., or the need for "hot line" maintenance capability.

6. Individual utility planning criteria and experience may require the need for a load condition to prevent progressive line failure (cascading).
7. Utilities may need to consider unique loading situations that are applicable to their service area or created by joint use of their structures. Examples of service area loading conditions include galloping and/or aeolian vibration of wires, as well as seismic events. Typical electrical transmission structure designs provide adequate strength to resist loadings from seismic acceleration forces. Tubular frame type structures may need to consider the effects of foundation movement caused by earthquake ground motions. Examples of joint-use loads are telecommunication applications and other nonelectrical apparatuses (such as traffic signals). The Owner should determine the applicable design code for joint-use applications.

C4.2.3 Load Expression

The Owner should transmit specific loading criteria to the Structure Designer in the form of load trees, utilizing a single orthogonal coordinate system as shown in Fig. C4-1. These loading criteria should express the magnitude, direction, and point of application for each load and load case. Conductor and shield wire loads should be shown at their appropriate attachment points. The weight of insulators and hardware should be included in these loads.

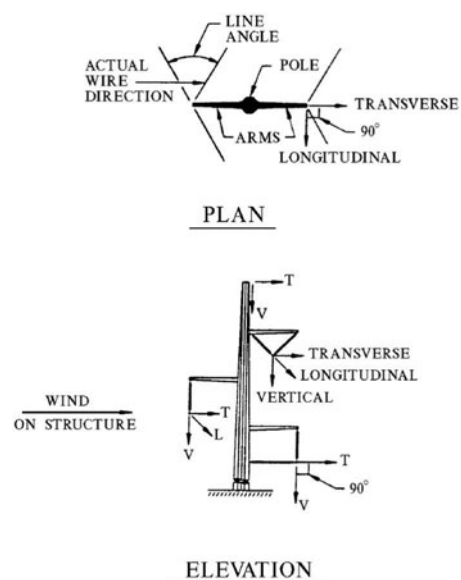


FIGURE C4-1 Recommended Load Tree Format.

The magnitude and direction of wind on the structure should be defined by the Owner. Shape and height coefficients should be included in the wind loading or listed separately in tabular form. One reference for these coefficients is ASCE Manual of Practice No. 74, "Guidelines for Electrical Transmission Line Structural Loading." If listed separately, the use of these coefficients should be defined by a formula.

When necessary, design loads for attachment plates should be shown separately.

All special loading considerations that may affect the design of the structure should be clearly communicated to the Structure Designer (e.g., reverse wind on bisector of a guyed small angle structure, temporary construction guying, or installation of single circuit conditions for double circuit structures).

C4.3 GEOMETRIC CONFIGURATIONS

C4.3.1 Configuration Considerations

The Owner should determine the preliminary structure geometry based on an appropriate technical and economic evaluation of the electrical and mechanical performance requirements.

Generally, transmission structures may be classified as one of three types: suspension, strain, or dead-end.

Suspension structures are those in which conductors and shield wires pass through and are suspended from support points.

Strain structures are those in which conductors and shield wires are attached to the structure by means of bolted or compression dead-end fittings. These structures are designed to support intact, basically equal, longitudinal loads on both sides of the structure.

Dead-end structures utilize similar conductor and shield wire attachment methods as utilized on strain structures. However, dead-end structures are designed to support intact unbalanced longitudinal loads because of differing conductor and shield wire tensions and/or sizes on opposite sides of the structure.

Additional nomenclature for the basic structure types is used to help identify structure orientation with respect to the center line of the transmission line. The term "tangent" denotes a basic structure type with little or no line angle. The term "angle" denotes a basic structure type that is subjected to various degrees of line angle. Therefore, the following terminology is recommended: tangent suspension, angle suspension, tangent strain, angle strain, tangent dead-end, and angle dead-end.

C4.3.2 Structure Types

The previously described structure types may also be categorized as either "self-supported" or "guyed." Self-supported structures have sufficient strength and stiffness to support the design loads without any guy support. Guyed structures rely on guys for load distribution, stiffness, and stability.

C4.4 METHODS OF ANALYSIS

The response of a tubular structure subjected to factored design loads is generally nonlinear. Geometric nonlinearity (also called second order effect or P-Delta effect) results from displacements that can be substantial. Material nonlinearity may occur in the behavior of the steel material, with localized yielding taking place. Localized yielding may even take place at load levels less than design loads because of stresses induced during manufacturing.

Three states of behavior can be described for a tubular structure: elastic state, inelastic or damage state, and ultimate or collapse state. A structure is in the elastic state if it does not sustain permanent deformation under loading conditions. A structure is in the inelastic or damage state if it can safely carry the loads, but sustains permanent deformation. Repair or replacement may be required depending on the extent of damage sustained. A structure is in the ultimate or collapse state when the loads cannot be supported. Geometric nonlinearities are present in all three states. Material nonlinearity becomes significant only in the damage or ultimate states. It is not significant in the elastic state.

C4.4.1 Structural Analysis Methods

The philosophy adopted by this standard is to design a structure so that it will not be permanently damaged under the design climatic, construction, and maintenance loads. For security loads, the Owner may allow permanent damage as long as ultimate collapse is prevented. Allowing permanent damage takes advantage of the fact that tubular structures can exhibit additional strength beyond the onset of ultimate loading or collapse state.

For design conditions where permanent damage is prohibited, a geometrically nonlinear elastic analysis is required. For the rare design conditions where damage is tolerated, a nonlinear analysis with both geometric and material nonlinearities is required. The elastic method of analysis, with geometric nonlinearity included, is the most common analysis method being used by structure designers.

The analysis should have the ability to predict elastic instability phenomena; i.e., the analysis should indicate increasingly large deformations, even under small lateral loads, for vertical loads approaching the buckling load of the structure.

The analysis should include the axial and shear forces, as well as the bending and torsional moments at the critical locations of the structure. With geometric nonlinearity included, all forces and moments should be in equilibrium in the deformed state of the structure.

The structure should be modeled with a sufficient number of elements to ensure that locations of maximum stresses coincide with the origin or the end of an element, and the effects of deflection on amplification of moments are included. All structural members, including interpolate ties, bracing, and guys should be included as elements.

The inherent flexibility of most unguyed tubular structures can have a substantial effect on the magnitude of the loads and conductor and shield wire sags caused by an unbalanced longitudinal condition. For example, conductors and shield wires that remain intact may be able to provide some support for a structure adjacent to a single conductor break. When the loads on a flexible structure are considered to be affected by their connection to other structures through conductors and shield wires, a system analysis may be performed. As a minimum, the system should include several spans in either direction and their supporting structures. The conductors and shield wires in the spans should be modeled as catenary elements.

Cross-sectional properties of commonly used tubular members can be approximated by the formulae in Appendix II.

Guys may be modeled as straight tension-only bars, prestressed if desired, or as a cable element including the actual prestress in the guy. If the structure is designed utilizing the reduced moments resulting from prestressing the guys, the Owner's assembly and erection specifications should require compliance with these assumptions. For further information see Chapter 5 of "Design of Guyed Electrical Transmission Structures," ASCE Manuals and Reports on Engineering Practice No. 91.

If foundation movement is of concern, the model should be able to accommodate specified displacement or rotation at the structure base, or connection to foundation elements.

The effects of aeolian vibration of the structures or members and the resulting fatigue stress on the structure or members should be considered. Damping options or recommendations should be provided to the

Owner where appropriate. In lieu of a comprehensive engineering analysis of a structure or member, the installation of the conductor or shield wire can normally be considered as an effective means of suppressing these vibrations.

C4.5 ADDITIONAL CONSIDERATIONS

C4.5.1 Structural Support

The degree of support provided by structure foundations can have a significant effect on the design of a structure because of foundation rotation or displacement. If foundation rotation/displacement allowances are specified, the Owner should establish the performance requirements for the structure, guys, and foundations. In determining this value, aesthetics, electrical clearances, and the ability to replumb a structure should be considered.

C4.5.2 Design Restrictions

Structure shipping length and weight restrictions are usually influenced by construction site conditions and material handling limitations.

Structure diameter, taper, and deflection restrictions are usually influenced by the desired appearance of installed structures. Line angles and unbalanced phase arrangements can create loading situations that will cause a structure to deflect noticeably. There are several methods that can be used to minimize these effects. One method is to camber the structure during fabrication to offset the anticipated deflection under load so that it will appear straight and plumb after installation. Another method is to rake the structure during installation. The deflection at the top of the structure is determined, and the pole is tilted a corresponding amount so that the top of the structure is at a specified position in relation to the structure at groundline.

To camber or rake a structure, a special load case, usually the "normal" or "everyday" load on the structure, should be specified by the Owner.

The structure finish is a factor that influences the design and fabrication of the structure. The most common structure finishes are hot dip galvanized, weathering, painted, zinc silicate coated, and metallized. The selection of a finish is normally influenced by environmental exposure, appearance, and regulatory requirements.

The determination of the shaft-to-shaft connection is normally based on the type and magnitude of structure loading. Shafts loaded in bending or compression are normally designed utilizing a slip joint connection,

whereas shafts loaded in uplift, or guyed structures with axial loads greater than the Structure Designer's recommended jacking force, normally utilize a bolted flange connection.

The type of foundation is usually based on economic factors influenced by geotechnical conditions, construction material costs, and structure loads. The drilled shaft and anchor bolt, direct-embedded pole, and embedded casing foundations are the most common types used for tubular steel pole structures.

Guy attachment and anchor locations are usually determined by structural support, electrical clearance, and right-of-way considerations.

C4.5.3 Climbing and Maintenance Provisions

Generally, provisions should be made so that all portions of structures, and insulator and hardware assemblies, are accessible for maintenance purposes. Where steps and/or ladders are required, they should be sufficiently strong so they do not deform permanently under the weight of maintenance personnel with tools and equipment.

All climbing devices should be oriented to provide adequate clearance between maintenance personnel and energized parts, allowing for conductor movement under specified climatic conditions. Detachable ladders should be fabricated in lengths that can be handled by maintenance personnel on the structure. Additional information on climbing can be obtained in IEEE's Standard 1307, "IEEE Standard for Fall Protection for Utility Work."

C5.0 DESIGN OF MEMBERS

C5.1 INTRODUCTION

The American Institute of Steel Construction (AISC) and, to a lesser extent, the American Iron and Steel Institute (AISI) Specifications [C5-1], [C5-2] are the basis for the design requirements of this standard. Transmission structures have traditionally been designed based on ultimate strength methods using factored loads. The design stresses of this standard are derived from the American Institute of Steel Construction Allowable Stress Design Specification, 9th Edition. AISC allowable stresses are applicable to equations where the member forces are the result of unfactored loads. The design stress values in this section are based on the allowable stresses in the AISC specification, with the values adjusted upward (by factors ranging from 1.5 to 2.0) for use in ultimate

strength design and to compensate for the equivalent safety factors built into the AISC values.

These design requirements are applicable only to tubular members, truss members, and guys. For design of other members, the user should refer to ASCE Standard 10 [C5-3] or to the AISC Specification [C5-1], with appropriate conversions from allowable stress to ultimate strength design.

The AISC has published design criteria [C5-4] based on the Load and Resistance Factor Design (LRFD) methodology. Additional testing to determine probability-based factors for details unique to tubular transmission structures is required prior to adopting the LRFD method.

C5.2 MEMBERS

The formulae used in this section historically have been used in the industry to design members with cross-sectional shapes shown in Appendix II and members with elliptical or rectangular cross sections that have maximum major to minor dimension ratios of 2 to 1.

C5.2.1 Materials

C5.2.1.1 Specifications

Steel pole structures are typically manufactured from high-strength structural steel with a yield strength of 65 ksi (448 MPa). The suitable materials listed include some that are not specifically referenced in the AISC or AISI specifications, but have been proven acceptable through in-service performance.

C5.2.1.2 Material Properties

Cold working in forming tubes increases the yield stress of the steel. However, increasing the design yield stress over the minimum yield stress specified in the applicable ASTM specification is not recommended. Since the difference between the yield stress (F_y) and the tensile stress (F_u) of the high-strength steels from which these structures are normally fabricated is relatively small, the beneficial effect of cold working would also be relatively small. Furthermore, this benefit would likely be offset to some extent by a reduction in the notch toughness.

C5.2.1.3 Energy-Impact Properties

Generally, brittle fracture can occur in structural steel when there is a sufficiently adverse combination of tensile stress, temperature, strain rate, and geometri-

cal discontinuities (notches). Other design and fabrication factors may also have an important influence. Because of the interrelation of these effects, the exact combination of stress, temperature, strain rate, notches, and other conditions that will cause brittle fracture in a given structure cannot be readily calculated. Consequently, designing against brittle fracture primarily involves proper steel selection and minimizing geometric discontinuities.

The impact requirements of this section are based on historical experience of structure performance. These requirements exceed those listed in Table 3.1 of ASCE Manual No. 72 [C5-5] for certain plate strengths and thicknesses, but the added cost of providing this testing is minimal. More stringent temperature requirements may be necessary in some areas because of the expected climatic conditions. Energy-impact requirements are applicable only to plate material, not to hot-rolled shapes.

This standard requires only heat-tot testing to be used. The requirement contained in ASCE Manual No. 72 [C5-5] for plate testing of controlled rolled or as-rolled plates over 0.5 in. (13 mm) in thickness was eliminated based on experience with the plate quality currently produced by steel manufacturers.

C5.2.2 Tension

For tension members with holes or slots, yielding of the net area may become a serviceability limit state warranting special consideration and exercise of engineering judgment. These conditions can result when the length of the hole or slot along the longitudinal axis of the member exceeds the member depth or constitutes an appreciable portion of the member length.

C5.2.3 Compression

C5.2.3.1 Truss Members

As discussed in Section C4.4.1, the elastic stability of beam elements in tubular structures is numerically checked during the nonlinear analysis and need not be checked by manual methods. However, when nonlinear analysis methods are used, the stability of truss elements, which by definition can carry only axial loads, is not checked. These members must be manually checked for stability using Eqs. 5.2-3 and 5.2-4.

Typically, truss members, made from round or polygonal tubes or angles, are used as bracing in a tubular transmission structure (cross braces in an H-frame, arm braces, etc.). The K factor for a truss member depends on the connection design for the

member. Theoretically, $K = 1.0$ for a member pinned at both ends [C5-1]. In practice, these members are attached to the structure with a single bolt installed perpendicular to the plane of the truss member. This connection may not act as a pin for loads out-of-plane with the member (such as longitudinal or torsional loads on an H-frame structure). This is especially important in the design of nonsymmetrical members, such as angles. Engineering judgment should be used in the selection of the K factor for this type of connection.

Truss members used for cross bracing are usually connected at the point of intersection by means of a U-bolt or through bolt. This connection changes the effective length of the compression brace, based on the amount of rotational support provided by the connection. The effective length for tubular members has been shown to be dependent upon the relative load levels between the compression brace and the tension brace [C5-6], [C5-7]. Assuming no rotational support is provided by the bolt and the point of intersection is at the midpoint of the cross bracing, the K factor varies from 0.5 (tension load = 60% to 100% of the compression load) to 0.72 (no tension). This K factor applies to the overall length of the compression member. Ref. [C5-6] provides suggested K factors for other bracing configurations. If the connection between the braces provides sufficient rotational support, $K = 0.8$, based on the length of the compression member from the intersection of the braces to the main support [C5-1].

KL/r values for tubular truss members should be limited to prevent potential vibration problems. Typically, these members are limited to values of 200 for compression members and 300 for tension members [C5-1].

C5.2.3.2 Beam Members

This section determines the design compressive stress based on what is commonly referred to as local buckling. When testing is performed to determine local buckling stability, actual yield strengths and dimensions of the test specimens should be used in the calculations.

C5.2.3.2.1 Regular Polygonal Members Eqs. 5.2-6 through 5.2-14 are based on research conducted by the Electric Power Research Institute (EPRI) for tubes in bending and were published in a report [C5-8] in 1987. Full scale testing [C5-8], [C5-9] demonstrates that regular polygonal shaped tubes with different numbers of sides have different buckling capacities.

Thus, different equations are provided for octagonal, dodecagonal, and hexdecagonal tubes. These equations are summarized graphically in Figs. C5-1, C5-2, C5-3, and C5-4.

Based on this testing, less conservative criteria than were previously used have been established for polygonal tubes with eight or fewer sides (Eqs. 5.2-6, 5.2-7, and 5.2-8). However, these equations should be

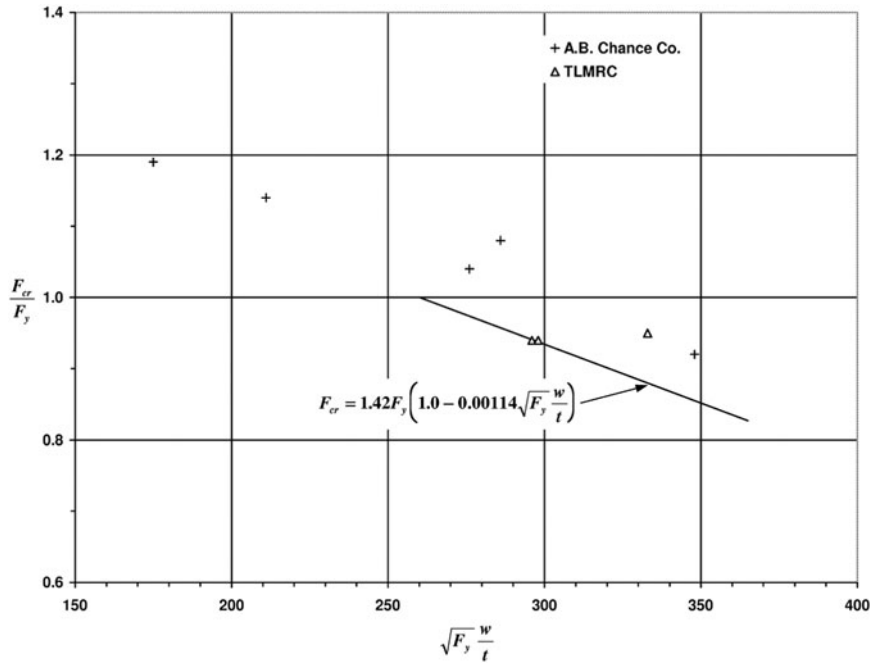


FIGURE C5-1. Local Buckling Test Data for Octagonal Tubes.

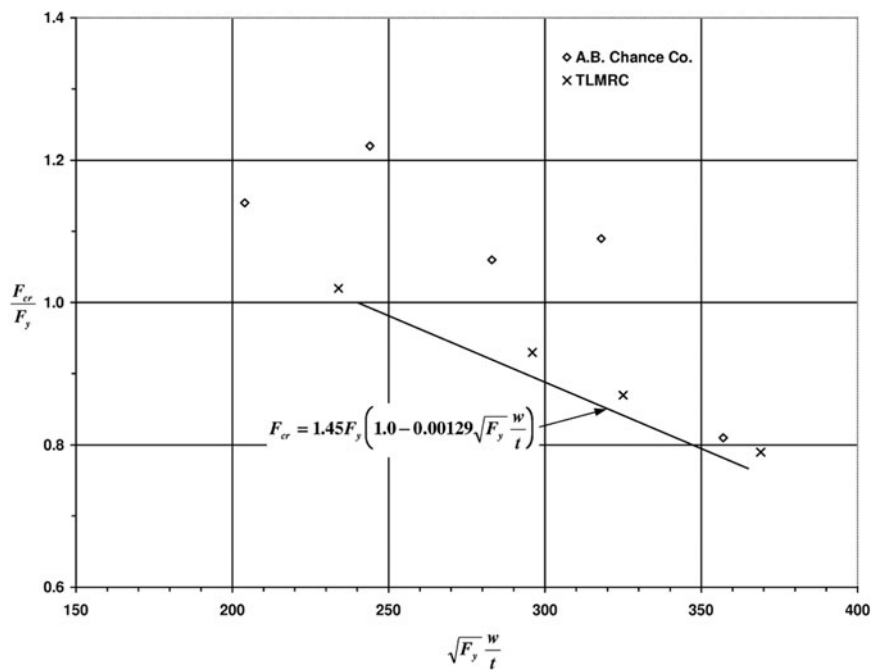


FIGURE C5-2. Local Buckling Test Data for Dodecagonal Tubes.

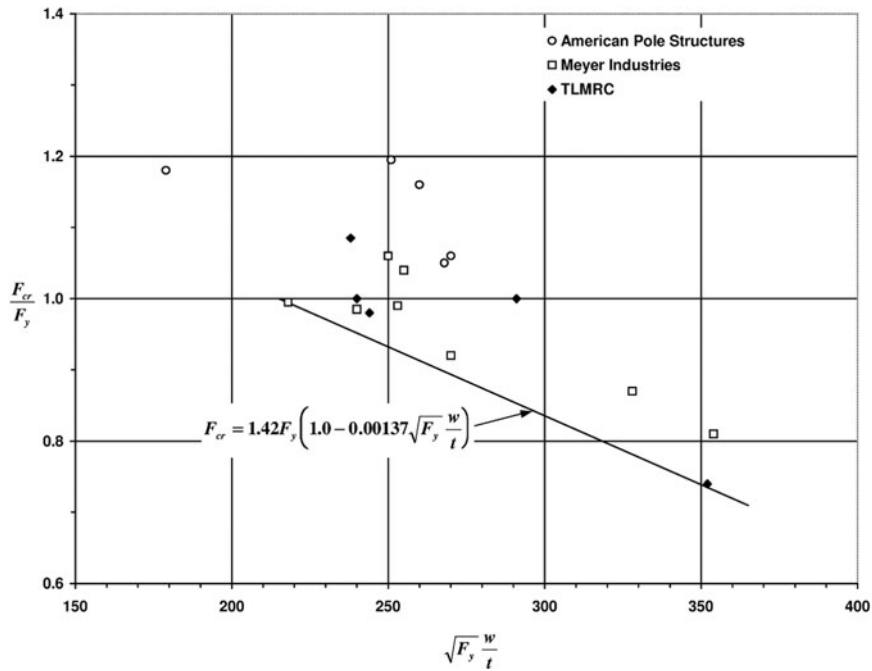


FIGURE C5-3. Local Buckling Test Data for Hexdecagonal Tubes.

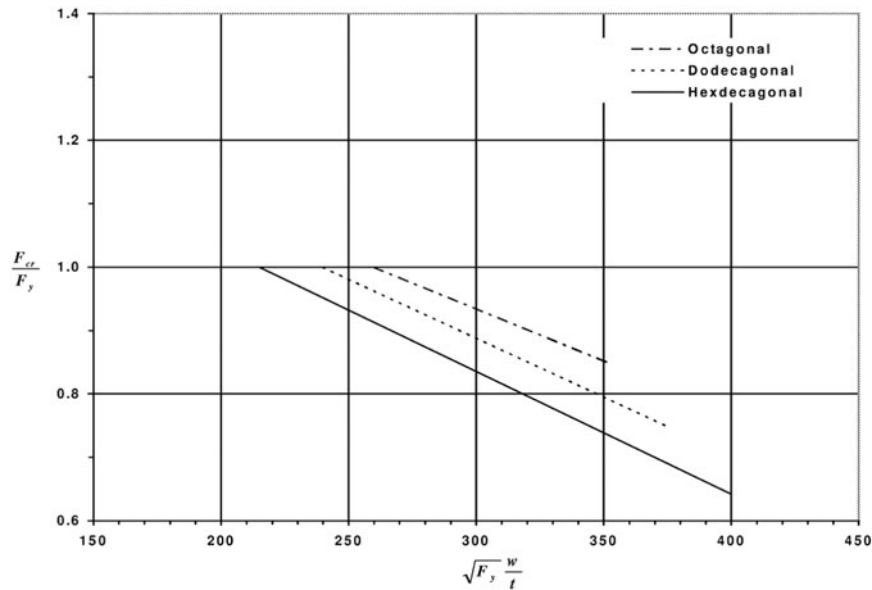


FIGURE C5-4. Comparison of Local Buckling Equations.

used only when the primary loading is bending. If the axial stress, f_a , is greater than 1 ksi (6.9 MPa), then Eqs. 5.2-9, 5.2-10, and 5.2-11 should be used for tubes with eight or fewer sides.

Eqs. 5.2-8, 5.2-11, and 5.2-14 are the elastic local buckling stresses based on $E = 29,000$ ksi

(200 GPa) and a plate buckling coefficient of 4.0. The use of polygonal shapes in these ranges of w/t is uncommon.

C5.2.3.2.4 Round Members Eq. 5.2-17 is the Plantema formula [C5-10], [C5-11] where $E = 29,000$ ksi

(200 GPa). Fig. C5-5 [Ref. C5-12] shows it to be a good lower bound on the test results of axially compressed manufactured round tubes.

Manufactured tubes are classified as tubes produced by piercing, forming and welding, cupping, extruding, or other methods in a facility devoted specifically to the production of tubes.

Eq. 5.2-19 is a modification of the Plantema formula derived from the test results shown in

Fig. C5-6 and provides a good lower bound. The tests shown herein are from Refs. [C5-11] and [C5-12].

The use of circular tubes with D_o/t values exceeding the upper limits established by Eqs. 5.2-17 and 5.2-19 is uncommon, and no allowable stress equations are provided for them. To establish such equations, an adequate test program would be needed.

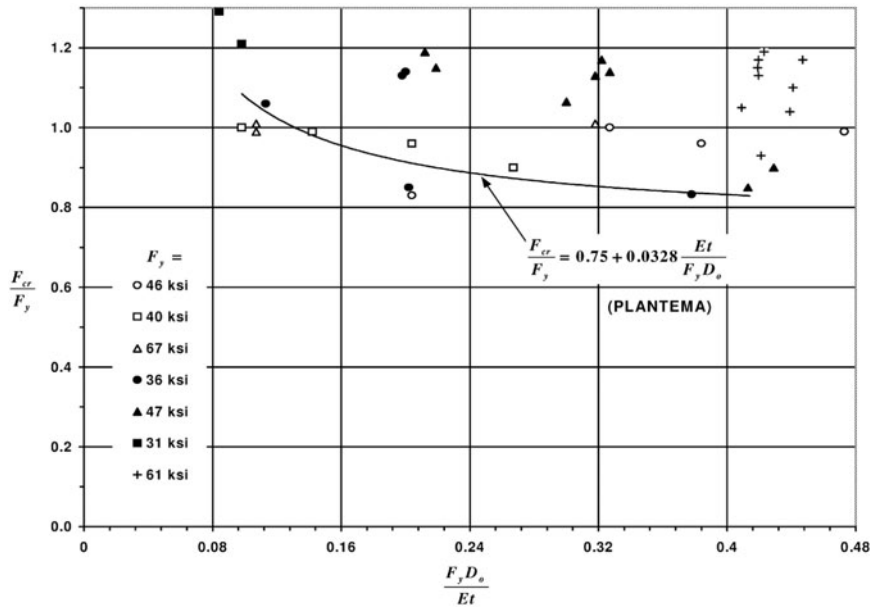


FIGURE C5-5. Local Buckling Test Data for Round Tubes in Compression.

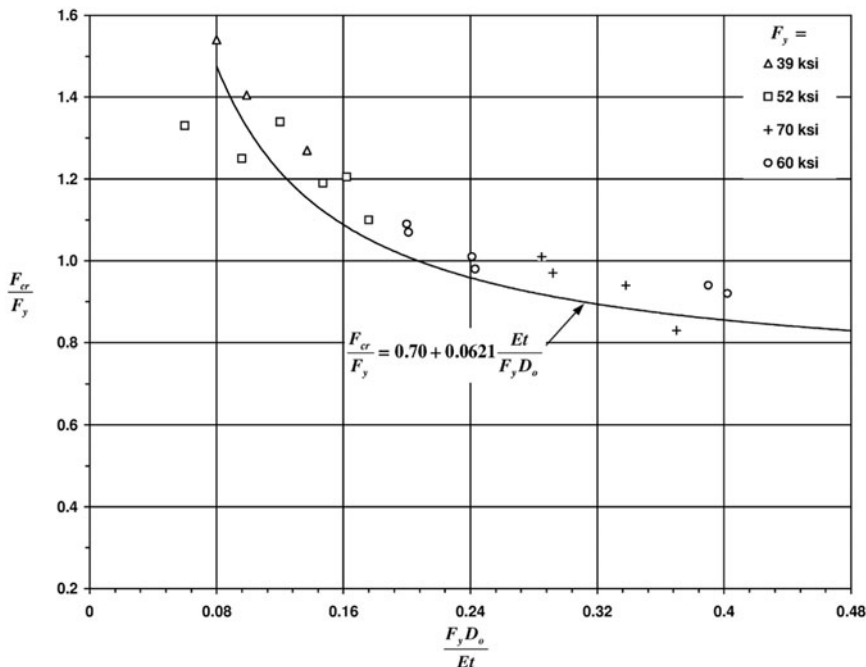


FIGURE C5-6. Local Buckling Test Data for Round Tubes in Bending.

C5.2.4 Shear

Eq. 5.2-20 is a rounded value of the yield stress in shear ($F_y/\sqrt{3}$) based on the distortion-energy criterion.

C5.2.5 Bending

A reduction in the design stress to account for lateral-torsional buckling is not necessary for tubular members because of their superior torsional stiffness.

F_a is based on local buckling only since stability will have been verified by nonlinear analysis.

C5.2.6 Combined Stresses

Combinations of shear stresses and normal stresses have been evaluated by the distortion-energy (Hencky-Mises) yield criterion. More conservative criteria may be used. Stresses should be properly combined at a given point on the cross section. They are not necessarily the addition of the maximum stresses. For example, the maximum normal stress occurs at an extreme fiber, while the maximum shear stress occurs at the neutral axis. Normally, the highest stress results from combining the maximum normal stress with the shear stress occurring at the same point.

C5.3 GUYS

C5.3.1 Material Properties

Zinc coated steel wire strand per ASTM A475 and aluminum clad steel strand per ASTM B416 are commonly used for guys. Capacities of these strands are stated as the minimum rated breaking strength.

Physical properties, such as minimum rated breaking strength and modulus of elasticity, for other types of wire strands or ropes should be specified by the Owner.

C5.3.2 Tension

The level of force represented by 65% of the rated breaking strength of a guy is a reasonable measure of the point at which the deformation rate begins to become nonlinear. This is analogous to the yield strength of other steel members.

Forces greater than 65% of the rated breaking strength of a guy have been permitted (NESC). However, when stressed above 65% of the rated breaking strength, inelastic stretching of the guys may occur, which is outside the scope of this standard. For further information see Chapter 6 of "Design of Guyed Electrical Transmission Structures," [C5-13]. Additionally, the guys should be retensioned or

replaced after the occurrence of such an event to prevent excessive structure deflections or stresses as a result of the inelastic stretching of the guys.

REFERENCES

- [C5-1] American Institute of Steel Construction. (1989). *Specification for Structural Steel Buildings*, Chicago, IL.
- [C5-2] American Iron and Steel Institute. (1980). *Specification for the Design of Cold-Formed Steel Structural Members*, New York, NY.
- [C5-3] American Society of Civil Engineers. (2000). "Design of latticed steel transmission structures." *ASCE 10-97*, New York, NY.
- [C5-4] American Institute of Steel Construction. (1986). *Load and Resistance Factor Design Specification for Structural Steel Buildings*, Chicago, IL.
- [C5-5] American Society of Civil Engineers. (1990). "Design of Steel Transmission Pole Structures." *ASCE Manuals and Reports on Engineering Practice No. 72*, New York, NY.
- [C5-6] Thevendran, V., and Wang, C. M. (1993). "Stability of nonsymmetric cross-bracing systems," *Journal of Structural Engineering*, Vol. 119, No. 1, pp. 169–180, ASCE, Reston, VA.
- [C5-7] Khadivar, K. (1990). "Strength of tension/compression x-bracing systems with parallel and non-parallel posts," Report No. TLMRC-89-R4, Transmission Line Mechanical Research Center, P.O. Box 220, Haslet, TX.
- [C5-8] Cannon, D. D., and LeMaster, R. A. (1987). "Local buckling strength of polygonal tubular poles," Report No. TLMRC-87-R3, Transmission Line Mechanical Research Center, P.O. Box 220, Haslet, TX.
- [C5-9] Currance, W. C. (1974). "Local buckling stability of polygonal cross sections in bending," paper presented at ASCE National Water Resources Meeting, Los Angeles, CA.
- [C5-10] Plantema, F. J. (1946). "Collapsing stresses of circular cylinders and round tubes," Report No. S.280, Nat. Luchtvaartlaboratorium, Amsterdam, The Netherlands.
- [C5-11] Schilling, C. G. (1965). "Buckling strength of circular tubes," *Journal of the Structural Division*, Vol. 91, No. ST5, Proc. Paper 4520, pp. 325–348, ASCE, Reston, VA.
- [C5-12] "Tests on round tubes in bending." Union Metal Manufacturing Company, Canton, OH, unpublished internal report.

[C5-13] American Society of Civil Engineers. (1997). "Design of Guyed Electrical Transmission Structures." *ASCE Manuals and Reports on Engineering Practice No. 91*, New York, NY.

C6.0 DESIGN OF CONNECTIONS

C6.1 INTRODUCTION

Transmission structures have traditionally been designed based on ultimate strength methods using factored loads. The design stresses of this specification are derived from the American Institute of Steel Construction Allowable Stress Design Specification, 9th Edition. AISC allowable stresses are applicable to equations where the member forces are the resultant of unfactored loads. The design stress values in this section are based on the allowable stresses in the AISC specification, with the values adjusted upward (by factors ranging from 1.5 to 2.0) for use in ultimate strength design and to compensate for the equivalent safety factors built into the AISC values.

C6.2 BOLTED AND PINNED CONNECTIONS

Bolted connections for steel transmission pole structures are normally designed as shear, slip-critical, or tension type connections.

Pinned connections are ones in which the attachments should be free to rotate about at least one axis, while under load.

The minimum end and edge distances determined by the provisions of this section do not include allowances for fabrication tolerances.

Typical anchor bolt holes in base plates are 0.375–0.5 in. (10–13 mm) oversized.

C6.2.1 Materials

Commonly used fastener specifications for steel transmission pole structures are A325, A354, A394, A449, and A490 for bolts, and A563 for nuts.

C6.2.2 Shear Stress in Bearing Connections

An average shear stress at failure for A325 and A490 bolts is 65% of the specified minimum tensile stress of the bolt. The approximate level at which the deformation rate begins to increase significantly is

70% of the average shear stress. Thus, the value of $0.45F_u$ results from $(70\%)(65\%)F_u$.

C6.2.3 Bolts Subject to Tension

The specified tensile stress approximates the point at which the rate of elongation of the bolt begins to significantly increase. The ASTM proof-load stress is approximately equal to the yield stress. Where a proof-load or yield stress is not specified, $0.60F_u$ provides a conservative estimate.

Permanent elongation will occur in bolts if design stress exceeds the yield stress. This could cause the nuts to loosen and affect the integrity of the joint.

C6.2.6 Minimum Edge Distances and Bolt Spacing for Bolted Connections

The provisions of this section are applicable to sheared and mechanically guided flame cut edges.

The first equation (6.2-6) provides the edge distance required for strength. The required edge distance is a function of the load being transferred by the bolt, the tensile strength of the connected part, and the thickness of the connected part. Test data confirm that relating the ratio of end distance to bolt diameter to the ratio of bearing stress to tensile strength gives a lower bound to the published test data for single fastener connections with standard holes [C6-1]. The edge distance required by the above expression has been multiplied by 1.2 to account for uncertainties in the edge distance strength of the members (Kulak et al. 1987). For adequately spaced multiple bolt connections, this expression is conservative.

The second equation (6.2-7) is a lower bound on edge distance that has been successfully used in practice in stressed members.

Latitude is provided to use the minimum edge distances and to determine the allowable bearing stress for this condition. The first and second equations (6.2-6 and 6.2-7) determine which combination of bearing value and edge distance satisfies the engineering and detailing requirements. The third equation (6.2-8) places an edge distance restriction on thick members such that punching the holes does not create a possible breakout condition. If the holes are drilled in members where the edge distance would be governed by the third equation (6.2-8), this requirement is not necessary. Satisfactory punching of the holes in thick material is dependent on the ductility of the steel, the adequacy of the equipment (capability of the punching equipment and proper maintenance of punches and dies), the allowed tolerance between

the punch and die, and the temperature of the steel. The following guidelines have been satisfactorily used:

For 36 ksi (248 MPa) yield steel, the thickness of the material should not exceed the hole diameter;

For 50 ksi (345 MPa) yield steel, the thickness of the material should not exceed the hole diameter minus 1/16 in. (1.6 mm); and

For 65 ksi (448 MPa) yield steel, the thickness of the material should not exceed the hole diameter minus 1/8 in. (3.2 mm).

The fourth equation (6.2-9) provides a check for shear (tearout), with shear planes developing at each side of the bolt through the end of the member.

The fifth equation (6.2.10) provides a requirement for minimum bolt spacing.

The minimum bolt spacing is the minimum allowed by the American Institute of Steel Construction Allowable Stress Design Specification, 9th Edition. This requirement is not intended for tension-type connections.

C6.2.7 Bearing Stress in Pinned Connections

Single bolt framing connections and insulator or guy shackle attachments are considered to be pinned connections. The design stress is less than that for bolted connections to account for the rotation that is typical of a pinned-type connection.

C6.2.8 Minimum Edge Distances for Pinned Connections

The first equation (6.2-12) provides a check for tension across the net section, perpendicular to the load. The second equation (6.2-13) provides a check for shear (tearout), with shear planes developing at each side of the pin through the end of the member. Here the ratio of the diameter of the hole to the diameter of the pin must be less than 2. This ratio represents the range of experience over which the equation (6.2-13) has been used in practice.

Oversized holes are commonly used as load attachment points for insulator strings, overhead ground wires, and guys. These holes are not used where connections are designed for load reversal. Factored design loads should be used with Eqs. 6.2-11, 6.2-12, and 6.2-13 of Sections 6.2.7 and 6.2.8. These recommendations do not exclude the use of other attachment holes or slots designed by rational analysis. No adjustment to the equations is required for slight chamfering of the holes. For attachment plates subject to bending,

additional analysis is required to determine the plate thickness.

To avoid indentation and excessive wear of the material under everyday loading, the following should be met:

$$P \leq 0.5 dt F_u \quad (\text{Eq. C6.2-1})$$

where

P = force transmitted by the pin;
 d = nominal diameter of the pin;
 t = member thickness; and
 F_u = specified minimum tensile stress of the member.

Everyday loading can be defined as the sustained loading resulting from the bare wire weight at 60°F (16°C) final sag. If the location is subject to steady prevailing wind, the everyday loading can be considered to be the resultant load caused by the bare wire weight and the prevailing wind at 60°F (16°C) final sag.

C6.3 WELDED CONNECTIONS

C6.3.3 Design Stresses

The design stresses in Tables 6.3, 6.4, 6.5, and 6.6 for welds are those of the AISC Allowable Stress Design Specification, 9th Edition, multiplied by 1.67. Punching shear stress should be considered in connection designs.

C6.3.3.1 Through-Thickness Stress

This restriction is applicable to plates welded perpendicular to or near perpendicular to the longitudinal axis of members (e.g., baseplates, flange plates, arm bracket, etc.) and takes into consideration the possible deficiencies in the tensile strength through the thickness of the plates, which may result in lamellar tearing. Lamellar tearing can occur in a plate of any thickness and is often caused by improper weld joint detailing and/or improper welding methods.

C6.4 FIELD CONNECTIONS OF MEMBERS

C6.4.1 Slip Joints

Fabrication and erection tolerances should be included when establishing lap length requirements. Experience has shown that an overlap of 1.42 to

1.52 times the maximum inside diameter (across flats) of the outer section is sufficient to develop the required strength of the connected 12-sided polygonal sections, provided there are no significant gaps between the mating sections and the manufacturer's recommended assembly force has been used.

Maximum lap should be restricted by practical factors such as maintaining the minimum height of the assembled structure, minimum clearances between crossarms, interference with climbing devices, etc. For frame structures where leg-length tolerances are critical, the structure designer may consider using bolted flange connections as a substitute for slip joints.

C6.4.2 Base and Flange Plate Connections

Theoretical methods of analysis for base plate design have not been published. It is recommended that details and practices proven through testing be used. Appendix VI provides a proposed method to determine the plate thickness for a base plate supported by anchor bolts with leveling nuts.

In certain types of structures (e.g., guyed poles or frame structures), the calculated design loads may be significantly less than the load capacity of the tubular member at the base plate or flange joint. It is not considered good engineering practice to size the base or flange plate connection for loads significantly lower than the tube capacity. Thus 50% of tube capacity has been established as a minimum strength requirement for such welded joint connections.

C6.5 TEST VERIFICATION

Theoretical methods of analysis for arm connections have not been published. It is recommended that details and practices proven through testing be used.

REFERENCE

[C6-1] Kulak, G. L., Fisher, J. W., and Struik, J. H. A. (1987). *Guide to Design Criteria for Bolted and Riveted Joints*, 2nd ed., John Wiley & Sons, New York.

C7.0 DETAILING AND FABRICATION

C7.1 DETAILING

C7.1.1 Drawings

The design of steel transmission poles, including the preparation of shop detail and erection drawings, is typically performed by the Fabricator. Occasionally,

the Owner provides shop detail drawings as part of the contract documents, and their correctness is the responsibility of the Owner. Differences between the Owner's drawing requirements and the Fabricator's shop practices need to be resolved prior to commencement of fabrication.

C7.1.2 Drawing Review

The Structure Designer's review of drawings includes responsibility for the strength of members and connections. The correctness of dimensional detail calculations is the responsibility of the Fabricator. Review of drawings does *not* include approval of means, methods, techniques, sequences, procedure of construction, or safety precautions and programs.

The Owner's review is for determining conformance with the contract requirements. It does not relieve the Fabricator of the responsibility for the accuracy of the structural detailing.

C7.1.3 Erection Drawings

The erection drawings are prepared as an aid in assembly and erection. They can be used with, but do not eliminate the need for, a construction specification. Erection drawings should show the position and lead of all guys.

C7.1.4 Shop Detail Drawings

The shop detail drawings are prepared as the communication, or link, between the design and the fabrication processes. As such, comprehensive detailing of fabrication requirements is very important. Sections 7.1.4.1 through 7.1.4.5 provide standard requirements of the shop detail drawings. Shop detail drawings facilitate quality assurance checks both before and after fabrication.

C7.1.4.2 Dimensions and Tolerances

Clearance and appearance requirements are normally established by the Owner, while strength and assembly requirements are established by the Structure Designer. Foundation type, structure design, and construction methods are factors that should be considered when establishing tolerances.

The Owner should coordinate dimensioning of mating parts obtained from different sources. The Structure Designer or the Owner should either impose tolerances that will ensure ease of assembly or require preassembly and match marking of mating parts by the Fabricator. The Structure Designer should establish tolerances to control critical cross-section properties and to control the magnitude of the internal reactions. For example, a maximum variation of -5% for section modulus is recommended. This is within

tolerances set for standard structural members covered by the ASTM A6 specification.

C7.1.4.4 Corrosion and Finish Considerations

Surface preparation should reference a Steel Structures Painting Council (SSPC) specification when possible. Drawings should show painting requirements including the paint system, surface preparation, mil coverage, number of coats, and color. Paint manufacturer's application recommendations should be available.

Galvanizing should reference the applicable ASTM specification. ASTM A123 is typically referenced for plates and shapes. ASTM A153 is referenced for hardware. Venting and draining details should be indicated.

Metallizing requirements should be shown including type of metallizing (e.g., zinc, aluminum, etc.), surface preparation, mil coverage, and sealing. Application instructions should be documented and available. AWS C2.18 Guide for the Protection of Steel with Thermal Sprayed Coatings of Aluminum and Zinc and Their Alloys and Composites is a good reference.

C7.1.4.5 Other Requirements

Examples of specific requirements include the following:

1. "Drilled-hole" for holes specified as drilled and not punched;
2. "Hot-bend" when forming is to be done hot and not cold; and
3. "Acceptable welding processes" when one or more processes are unacceptable.

C7.2 FABRICATION

C7.2.1 Material

A wide variety of steels are used for steel pole structures. This requires the Fabricator to carefully maintain the material identity throughout fabrication.

C7.2.2 Material Preparation

Material preparation includes cutting, bending, and machining. This standard defines the performance requirements, but does not specify the methods to be used to accomplish these operations.

C7.2.2.1 Cutting

Cutting includes operations such as shearing, torch cutting, and sawing. Material that is to have straight edges can be cut to size with a shear; however, care must be taken to prevent cracks or other defects from forming at the sheared edge. Limitations of sec-

tion size and length of the shear must be considered to ensure a good cut.

Any curved or straight edge can be cut with a burning torch. Care must be taken to prevent cracks or other notch defects from forming at the prepared edge, and all slag must be removed. Wherever practical, the torch should be mechanically guided. Edges prepared for welding or subject to high stresses should be free from sharp notches. Reentrant cuts should be rounded. Edges cut with a handheld torch may require grinding or other edge preparation to remove sharp notches. Steel can be cut with a reciprocating band saw—type blade, circular stone saw, or friction saw.

C7.2.2.2 Forming

Braking, rolling, stretch bending, or thermal bending (cambering) are forming processes. Tubes of various cross sections, as well as open shapes (clips and brackets, for example), can be produced by braking.

Roll forming is normally used for circular cross sections. In roll forming, the plate is either formed around an internal mandrel or rolled by forcing with external rolls. Either constant cross-section or tapered tubes can be made this way.

Tubes of various cross sections and tapers can be made by pressing plates in specifically profiled punch and die sets. Completed straight or tapered tubes can also be pressed into a die set to form curved crossarms.

Members may be straightened or cambered by mechanical means or by carefully supervised application of a limited amount of localized heat. The temperature of heated areas as measured by approved methods shall not exceed 1,100°F (593°C) for quenched and tempered steel or 1,200°F (649°C) for other steels.

There are limits on the tightness of a bend that can be made in a piece of steel. They are usually expressed as a ratio of the inside radius of the bend to the material thickness. Some of the factors that affect the limits for a particular plate are the angle and the length of the bend to be made, the mechanical properties and direction of the final rolling of the plate, the preparation of the free edges at the bend line, and the temperature of the metal. Separation of the steel can occur during forming because of the method used, radii and temperature, and/or imperfections in the material.

Hot bending will allow smaller bend radii to be used than cold bending. Improper temperature during bending can adversely affect the material. Proper temperatures can be obtained from the steel producer, testing, or various AISC publications.

C7.2.2.3 Holes

Typically holes may be punched in steel when the relationship between the material thickness and the hole diameter meets the recommendations of C6.2.6. If the steel is to be galvanized, precautions against steel embrittlement listed in ASTM A143 should be followed.

Holes can be drilled in plates of any thickness. Care should be taken to maintain accuracy when drilling stacks of plates. Holes can be torch cut. The torch should be machine-guided, and care should be taken that the cut edges are reasonably smooth and suitable for the stresses transmitted to them.

C7.2.2.4 Identification

Piece marks are typically at least 0.50 in. (13 mm) in height. They are generally made either by stamping or by a weld deposit, prior to any finish application.

C7.2.3 Welding

Welding may be performed using many different processes and procedures, but should be in conformance with AWS D1.1. AWS D1.1 applies to steels equal to or greater than 0.12 in. (3 mm), while AWS D1.3 applies to steel less than or equal to 0.188 in. (5 mm) thick. The shielded metal arc welding (SMAW), flux cored arc welding (FCAW), gas metal arc welding (GMAW), submerged arc welding (SAW), and resistance seam welding (RSEW) are the weld processes most commonly used.

Workmanship and quality of welds are critical to the integrity of transmission pole structures. These structures often have large base and/or flange plate to shaft thickness ratios; thus, it is important that preheating be performed correctly. Improper preheating can result in significant base/flange plate distortion and premature weld failures.

If field welding is required, it should conform to the requirements of shop welding, except that the weld process may vary.

C8.0 TESTING**C8.1 INTRODUCTION**

In a traditional proof test, the test setup is made to conform to the design conditions; that is, only static loads are applied, the prototype has level, well-designed foundations, and the resultants at the load points are the same as in the design model. This type of test will verify the adequacy of the main components of the prototype and their connections to with-

stand the static design loads specified for that structure as an individual entity under controlled conditions. Proof tests provide insight into actual stress distribution of unique configurations, fit-up verification, performance of the structure in a deflected position, and other benefits. The test cannot confirm how the structure will react in the transmission line where the loads may be more dynamic, the foundations may be less than ideal, and there is some restraint from intact wires at load points.

The Structure Designer is responsible for ensuring that the structural design meets the loading, deflection, clearance, and other design specifications set forth in the contract. The Structure Designer should approve the proposed procedure for prototype testing. Also, the Structure Designer or designated representative should be present at all times during the testing sequence and approve each decision made during the process. The Owner should review the testing arrangement for compliance with the contract documents and the intent of the test. The number, location, direction, holding time, sequence, and increments of the test loads and the number, location, and direction of deflection readings should be specified by the Owner. The method of attaching the test loads to the prototype, applying the test loads, measuring and recording the test loads, locations and type of strain gages, and measuring and recording the deflections should be approved by the Owner before testing begins.

Testing is commonly performed with the prototype in an upright position. Horizontal tests may be useful for component development and may be used for full prototype testing, providing all gravity loads are added or deducted as appropriate. Horizontal testing of full-scale structures may be used to prove the ability of a pole to withstand maximum design stress. All critical points along the pole shaft should be tested to this maximum stress level. Horizontal testing is primarily used to verify the structural integrity of freestanding, single pole structures. One method of horizontal testing is shown in Appendix III.

C8.2 FOUNDATIONS

The type, rigidity, strength, and moment reactions of the actual attachments of a prototype to a test bed may affect the ability of the members to resist the applied loads. Therefore, the restraint conditions of the test foundation should be as close as possible to the expected design conditions.

Pole structures that are designed to be attached to foundations through anchor bolts should be tested on

an anchor bolt arrangement attached to the test facility foundation in a manner that will best simulate the design conditions. Leveling nuts, if used, should be set at approximately the same height that will be used during line construction.

Normally, for direct-embedded structures, only the above-ground portion of the structure is tested by having all of the controlling design load cases applied. The prototype should be furnished with special base sections that can be attached to the test facility foundation through anchor bolts or by direct welding. If the structure has been designed for a point of fixity below ground line, the length of the main shaft or shafts should be extended to ensure the point of maximum moment on the shaft is tested.

Since soil properties at a test facility probably will not match the properties of the soil on the transmission line, foundation tests, when required, should be done at the line site. For most structures, a simplified, one-load case test that develops the critical overturning moment and associated vertical load will be sufficient.

C8.3 MATERIAL

All prototype material should conform to the minimum requirements of the material specified in the design. Because of the alloying methods and rolling practices used by the steel mills, all steel plates have yield strength variations. Although desirable, it is impractical to limit the maximum yield strengths of the materials used for the fabrication of a prototype. Test loads should not be increased as a means of accounting for material yield strengths that are in excess of the specified minimum values.

C8.4 FABRICATION

Normally, the finish is not applied to the prototype for the test unless specified by the Owner. Nonstructural hardware attachments such as ladders, step bolts, etc., are not normally installed on the prototype.

C8.5 STRAIN MEASUREMENTS

Stress determination methods, primarily strain gaging, may be used to monitor the loads in individual members during testing. Comparison of the measured unit stress is useful in validating the proof test and refining analysis methods. Care must be exercised when instrumenting with strain gages, as to both

location and number, to ensure valid correlation with design stress levels.

C8.6 ASSEMBLY AND ERECTION

It may be desirable to specify detailed methods or sequences for erecting the prototype to prove the acceptability of the proposed field erection method. Pick-up points designed into the structure should be used as part of the test procedure.

After the prototype has been assembled, erected, and rigged for testing, the Owner should review the testing arrangement for compliance with the contract documents.

Safety guys or other safety features may be loosely attached to the prototype. They are used to minimize consequential damage to the prototype or to the testing equipment in the event of a failure, especially if a test-to-destruction is specified. Load effects of the safety guys should be minimized during the test.

C8.7 TEST LOADS

Destruction is defined as the inability of the prototype to withstand the application of additional load. The destruction case should have a maximum percent overload established prior to testing.

C8.8 LOAD APPLICATION

V-type insulator strings should be loaded at the point where the insulator strings intersect. If the insulators for the structures in service are to be a style that will not support compression, it is recommended that wire rope be used for simulated insulators in the test. If strut or post insulators are planned for the structures, members that will simulate the insulators should be used.

As the prototype deflects under load, load lines may change their direction of pull. Adjustments should be made in the applied loads so that the vertical, transverse, and longitudinal vectors at the load points in the deflected shape are the loads specified in the loading schedule.

C8.9 LOADING PROCEDURE

It is customary that load cases having the least influence on the results of successive tests be tested first.

Another consideration should be to simplify the operations necessary to carry out the test program. Normally loads are applied to 50%, 75%, 90%, and 100% of the factored design loads. The 100% load for each load case should be held for 5 minutes. Unloading should be controlled to avoid possible damage or overload to the prototype.

Loads should be reduced to a minimum level between load cases except for noncritical load cases where, with the Structure Designer's approval, the loads may be adjusted as required for the next load case.

C8.10 LOAD MEASUREMENT

All applied loads should be measured as close to the point of attachment to the prototype as practical. The effects of pulley friction should be minimized. Load measurement by monitoring the load in a single part of a multipart block and tackle should be avoided.

C8.11 DEFLECTIONS

Points to be monitored should be selected to verify the deflections predicted by the design analysis.

Also, it should be realized that measured and calculated deflections might not agree. There are two main reasons for this. First, the calculations for deflections generally do not include the effect of deflection and distortion within the joints and connections. Second, the actual stresses reached during testing often approach the yield strength of the material, which, by definition, includes some permanent set in the steel.

Upon release of test loads after a critical test case, a prototype normally will not return fully to its undeflected starting position.

C8.12 FAILURES

The prototype is normally considered acceptable if it is able to support the specified loads with no structural failure of prototype members or parts and has no visible local deformation after unloading. If a retest is required, failed members affected by consequential damage should be replaced. The load case that caused the failure should then be repeated. After completion of testing, the prototype should be dismantled and inspected.

C8.13 POSTTEST INSPECTION

The Owner should indicate any special inspection requirements in the contract documents.

C8.14 DISPOSITION OF PROTOTYPE

An undamaged prototype is usually accepted for use in the transmission line after all components are inspected in accordance with the test procedure and are found to be structurally sound and within the fabrication tolerances.

C8.15 REPORT

The following information is typically included in the test report:

1. The designation and description of the prototype tested.
2. The name of the Owner.
3. The name of the person or organization (Line Designer) that specified the loading, electrical clearances, technical requirements, and general arrangement of the prototype.
4. The name of the Structure Designer.
5. The name of the Fabricator.
6. A brief description and the location of the test facility.
7. The names and affiliations of the test witnesses.
8. The dates of each test-load case.
9. Design and detail drawings of the prototype, including any changes made during the testing program.
10. A rigging diagram with details of the attachment points to the prototype.
11. Calibration records of the load-measuring devices.
12. A loading diagram for each load case tested.
13. A tabulation of deflections for each load case tested.
14. In case of failure:
 - a. Photographs of prototype and all failed members.
 - b. Loads at the time of failure.
 - c. A brief description of the failure.
 - d. The remedial actions taken.
 - e. The measured dimensions of the failed members.
 - f. Test coupon reports of failed members.
15. Photographs of the overall testing arrangement and rigging.

16. Air temperature, wind speed and direction, any precipitation, and any other pertinent meteorological data.
17. Mill test reports submitted in accordance with Section 8.3.
18. Foundation condition information.
19. Additional information specified by the Owner.

C9.0 STRUCTURAL MEMBERS AND CONNECTIONS USED IN FOUNDATIONS

C9.1 INTRODUCTION

The material in Section 9.0 covers structural members and connections normally supplied by the steel pole fabricator. Numerous factors enter into the selection of a foundation type, including, but not limited to, the following:

- geotechnical considerations;
- foundation loading;
- base size of structure;
- rotation and deflection limitations;
- economics;
- aesthetics;
- contractor experience;
- available equipment;
- site accessibility; and
- environmental concerns.

Many different foundation systems have been developed to meet the variety of steel pole support needs. Three foundation types have become prevalent and are addressed in this standard: drilled shaft with anchor bolts (Fig. C9-1); direct-embedded foundation (Fig. C9-2); and embedded casing foundation

(Fig. C9-3). Other types of foundations (spread, pile, rock anchor foundations, etc.) may be considered for specific applications and should be designed according to an appropriate engineering standard.

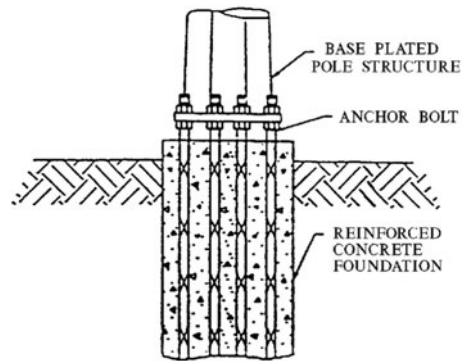


FIGURE C9-1. Drilled Shaft Foundation with Anchor Bolts.

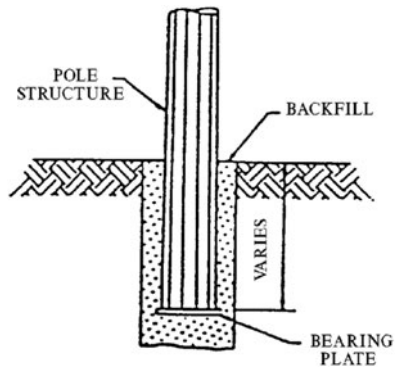


FIGURE C9-2. Direct-Embedded Pole.

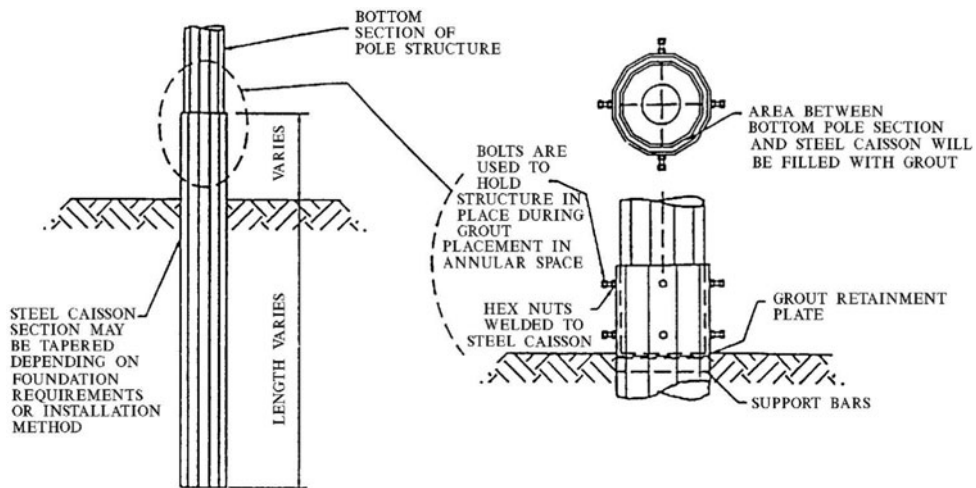


FIGURE C9-3. Embedded Casing Foundation.

C9.2 GENERAL CONSIDERATIONS

In selecting the type of foundation, the Owner should consider the type of structure, importance of the structure, allowable foundation movement or rotation, and geotechnical conditions.

Foundation type, point of design fixity, rotation, deflection, and reveal have a significant impact on structure loading and cost and are of particular importance to the Structure Designer.

The following should be considered in foundation design:

Soil Characteristics: Adequate geotechnical exploration is necessary to determine the best type and size of foundation for the given soil or rock characteristics. The geotechnical report developed from the exploration should include design criteria for assessing the axial and lateral capacity as well as displacements. Chemical tests also are appropriate if corrosion is a problem. The cost of additional exploration should be compared against a more conservative foundation design. The savings realized from optimally designed foundations can more than offset the cost of the geotechnical evaluation.

Displacements: Foundation displacement and rotation should be considered in the line and structure design. Excessive displacement or rotation can create an undesirable appearance, cause load redistribution, impact conductor sag adversely, and require future plumbing or adjustment of the structure.

Loads: All foundation loads are to be supplied by the Structure Designer. Foundation designs should provide for all dead and live loads, horizontal shear, overturning moment, torsion, uplift, or compression loads. The Owner has the responsibility for selecting minimum factors of safety used in the foundation design. Care should be taken to avoid combining load factors used in the structure design and additional factors of safety applied in the geotechnical analysis.

Corrosion protection: Embedded steel shafts/casings may require special protection. In some cases, it may be necessary to apply an additional protective coating, such as a bitumastic compound, polyurethane coating, galvanizing, or paint to the steel. Cathodic protection can be used to inhibit corrosion. Consideration may also be given to adding a ground sleeve or to increasing the thickness of steel members exposed to corrosive ground conditions. Concrete encasement or reinforced concrete foundations are often used for poles located in highly corrosive environments, such as ash pits, industrial drainage areas, and oil refineries.

C9.3 ANCHOR BOLTS

The drilled shaft is a type of foundation that is used extensively with anchor bolts. The minimum foundation diameter is determined by the diameter of the bolt circle, bolt diameter, and the necessary concrete clear cover. The minimum length of the anchor bolts should be determined by the Structure Designer in accordance with the number and size of bolts used. Typical reinforcing methods include development-length anchor bolts plus reinforcing steel as well as full-length anchor bolt cages, either with or without additional reinforcing steel. Depending on the geotechnical conditions and the foundation loads, the use of full-length anchor bolts can provide cost savings.

Most design codes do not address the design of anchor bolts and anchor bolt embedment. Typically the Structure Designer designs the anchor bolt to resist the groundline forces. The Foundation Engineer designs the foundation for the same groundline forces plus any additional loads that would produce a maximum foundation bending moment.

Threaded reinforcing bar is the most common type of anchor bolt used for connecting steel transmission pole structures to concrete foundations. For threaded reinforcing bar, the anchor bolt material should be limited to ASTM A615, grade 60 for bars #5 through #18 and grade 75 for bars #11 through #18 and #18J (ASTM A615M, grade 400 for bars 10M–55M and grade 500 for bars 35M–55M).

C9.3.1 Bolts Subject to Tension

The load factor(s) applied to the structure loads, and the ratio of (F_u/F_y) will provide some additional factors of safety above that computed by the equations.

C9.3.2 Shear Stress

The shear is transmitted from the bolt to the concrete through the bearing of the bolt at the surface, forming a concrete wedge approximately 1/4 of the bolt diameter in depth.

C9.3.3 Combined Shear and Tension

For steel transmission poles, anchor bolts are bearing-type connections that should include threads in the shear plane when sizing the bolt. The literature presents various equations for approximating the shear and tension interaction. For the interaction equation to be valid, the anchor bolts should have no more than 2 bolt diameters separating the bottom of the base plate and the top of the concrete. If the distance is greater than 2 bolt diameters, then bending in the bolt should be included when sizing the anchor bolt.

C9.3.4 Development Length

The #18J (55M) reinforcing bar meeting ASTM A615 grade 75 (500) has been successfully used for anchor bolts by the industry for many years. Until 1989, anchor bolt embedment length calculations have been based upon the ACI 318 development-length provisions for the deformed reinforcing bar. Revisions to ACI 318 in 1989, 1995, and 1999 first increased and then decreased the development-length requirements. The committee decided to continue the industry practice of using the development-length provisions of ACI 318-83 for determining embedment length threaded, deformed reinforcing bars used as anchor bolts.

The development-length calculations are applicable only to uncoated reinforcing bars. Development length and anchorage value calculations for headed anchor bolts are shown in Appendix IV.

C9.4 DIRECT-EMBEDDED POLES

Direct-embedded pole foundations utilize the bottom portion of the steel pole as the foundation member reacting against the soil, rock, and/or backfill.

A direct-embedded pole foundation typically is designed to transfer overturning moments to the *in situ* soil, rock, or backfill by means of lateral resistance. Axial loads can be resisted by a bearing plate installed on the base of the pole. Additional bearing capacity can be realized by installing base expanding devices. The quality of backfill, method of placement, and the degree of compaction greatly affect the strength and rotation of the foundation system and, thereby, the design of the embedded pole. Direct-embedded pole foundations have become popular because of their relatively low installation cost. When using direct-embedded poles where there is a high water table, buoyancy of the pole should be considered.

C9.5 EMBEDDED CASINGS

Embedded steel casing foundations are round or regular polygonal tubular steel members that serve as the foundation to which the bottom of the steel pole is attached.

The bottom of the steel pole structure is attached to the casing by either a “socket” or “base plate” type connection. In a “socket” type connection, the above-ground structure is set inside the steel casing. The annular space, usually from 3 to 9 in. (76 to 229 mm) between the structure and the steel casing, is then filled with either grout or concrete.

In a “base plate” connection, the flange of the above-ground structure is bolted to a flange on the steel casing. Bolting can be done on either the inside or the outside of the casing. The structure can be plumbed by adjusting leveling nuts.

Vibratory steel caisson foundations have been used to support steel structures. The steel caisson is vibrated into the ground by the use of a vibratory hammer. The steel caisson is commonly fitted with reinforcing plates or “driving ears” for the purpose of attaching the vibratory hammer.

The wall thickness of the vibratory steel caissons should be sized not only to resist the stresses due to the groundline reactions, but also to prevent buckling or fatigue cracking during installation. A minimum wall thickness of 3/8 in. (10 mm) is common. The geotechnical design parameters for the design of vibratory steel caissons in looser soils are improved because of densification caused by the vibratory installation.

C10.0 QUALITY ASSURANCE/QUALITY CONTROL

C10.1 INTRODUCTION

A well-planned and executed quality assurance (QA)–quality control (QC) program is necessary to ensure delivery of acceptable material in a timely manner. The objective of the program is to establish that materials are in conformance with the specifications of the purchase contract. A clear and concise contract between the Owner and the Fabricator is an important part of the procedure necessary to obtain acceptable steel transmission pole structures. The responsibilities of the Owner and the Fabricator should be defined in the contract so that no part of the process used to purchase, design, manufacture, inspect, test, construct, or deliver material is omitted.

C10.2 QUALITY ASSURANCE

The Owner’s bid documents should outline the QA methods, types of inspections, and records that will be required to determine the acceptability of the product at each stage of the design, manufacturing, structure testing, and field construction process.

Quality assurance is responsible for the methods followed to establish appropriate review and interface with the Fabricator’s quality control procedures. This will ensure that the contract can proceed smoothly, that proper communication channels are established

with the responsible personnel to minimize confusion, that the Owner's requirements are properly met, and that proper guidance and adequate technical support are provided throughout the period of the contract.

The Owner should determine, by site visit if required, that the Fabricator's equipment and process facilities are adequate to meet the requirements of the quality assurance specification, that fabrication procedures are satisfactory, that tolerances are within specified limits, and that the existing quality control program is satisfactory.

C10.2.1 Design and Drawings

The quality assurance specification should specify the procedure for reviewing the stress analyses of the main structure and all component parts, including attachments and connections. The Fabricator's drawings should be checked to ensure that they contain proper and sufficient information for fabrication and erection in accordance with the requirements of the Owner's specification.

C10.2.4 Nondestructive Testing

The Owner may specify that the Fabricator furnish copies of testing and inspection reports. The Owner may also perform independent random sample testing to verify results of the Fabricator's testing.

C10.2.5 Tolerances

Dimensional variations can affect the structural performance, ease of assembly, electrical clearances, and structure appearance. The Fabricator and the Owner should agree on the fabrication tolerances that will achieve the specified performance.

C10.2.6 Surface Coatings

Blast cleaning of weathering steel structures may be specified if a clean and uniformly weathered appearance is important in the structure's initial years of exposure. In time, even a nonblast cleaned steel structure will usually develop a uniform oxide coating.

C10.2.7 Shipping

Prior to the start of fabrication, the Owner should review the Fabricator's methods and procedures for packing and shipping and agree upon the mode of transportation.

When receiving materials, the Owner is responsible for checking to see that all materials listed on the accompanying packing lists are accounted for. When a discrepancy is detected, both the carrier and the Fabricator should be notified.

C10.3 QUALITY CONTROL

A quality control program should be established in a manner that provides open avenues of communication throughout the Fabricator's plant. It should be headed by a manager with the overall authority and responsibility to establish, review, maintain, and enforce the program. As a minimum, the QC program should identify key personnel who are responsible for planning and scheduling, engineering, drafting, purchasing, production, testing, shipping, and appropriate quality control checks. The quality control inspectors are responsible for determining that the product meets the level of quality established by the Fabricator's standards and the specific requirements of the Owner.

C10.3.1 Materials

The Fabricator's records should show all pertinent information on all component parts. This may take the form of a "traveler" on major components. The traveler generally contains pertinent information on items such as materials, welding procedures, welder's identification, type of inspection, inspector's test results, records of all visual and nondestructive testing, inspector's identification, and other items agreed upon by the Owner and the Fabricator.

C10.3.3 Dimensional Inspection

Any structure that is of unique and/or complex design should be shop assembled prior to shipment. Mating parts should be matchmarked.

C10.3.4 Surface Coating Inspection

The surface of structural steel prepared for spraying should be inspected visually. The metallized coating should be inspected for thickness by a magnetic thickness gauge. Any metallized surface that exhibits visible moisture, rust, scale, or other contamination should be reblasted before spraying. Defective areas should be sandblasted clean prior to respraying, except where the rejection results from insufficient thickness.

C10.3.5 Weld Inspection

Not all inspection personnel need to be qualified to AWS QCI. Visual inspection may be performed by noncertified inspectors under the supervision of a certified welding inspector (CWI).

After galvanizing, nondestructive weld testing should be considered to ensure that there have been no

adverse effects to the finished product. This is especially important for large “T” type weld joints such as base plate welds.

The Fabricator should establish written nondestructive testing procedures and train nondestructive testing personnel in accordance with the guidelines of The American Society for Nondestructive Testing Recommended Practice No. SNT-TC-IA.

Nondestructive testing can be used to detect material and welding flaws. Present methods include visual, magnetic particle, dye penetrant, ultrasonic, radiographic, and eddy current. Each of these methods has inherent limitations.

Magnetic particle (MT) is a practical method for detecting tight surface cracks. MT inspection should be in accordance with ASTM E709.

Dye penetrant (PT) is a very reliable method for detecting any cracks or porosity that are open to the test surface. PT inspection should be in accordance with ASTM E165.

Ultrasonic (UT) is the only practical method of determining weld quality in the base and flange connection welds. It is also very reliable in detecting small cracks and internal flaws in other complete penetration welds. It should be noted that AWS D1.1/D1.1M does not provide any specific guidelines for ultrasonic testing of plate less than 5/16 in. (8 mm) thick or for welds using backing bars. It is recommended that the Fabricator follow the procedure established by AWS D1.1/D1.1M, Section 6.27.1, in developing a specific inspection procedure.

Radiographic (RT) is a method that provides a permanent record of the test results. However, its use is limited on many types of weldments (e.g., base and flange connections) where it is difficult, if not impossible, to position the film to record the entire weld joint. It is also possible to miss tight cracks that lie normal to the RT source and film.

Eddy current (ET) techniques have limited application in the determination of weld penetration and the detection of cracks.

Additional information on the limitations and complementary use of each method is explained in ANSI/AWS B1.10, Guide for Nondestructive Inspection of Welds.

C10.3.6 Shipment and Storage

The quality control program should establish procedures that specify the methods, materials, documentation, and Owner’s special requirements for handling, storing, preserving, packaging, packing, marking, material releasing, and shipment.

C11.0 ASSEMBLY AND ERECTION

C11.1 INTRODUCTION

This commentary provides information supporting and explaining the requirements of Section 11.0.

Additional relevant information on assembly and erection of steel transmission pole structures can be found in Appendix V. Section 11.0 identifies assembly and erection practices that are required to ensure adherence to structure design assumptions and to prevent actions that could compromise structural integrity, but does not address all aspects of structure installation. The formulation of a complete installation specification is the responsibility of the Line Designer. Additional information and recommendations for structure assembly and erection may be obtained from the IEEE Guide to the Assembly and Erection of Metal Transmission Structures (IEEE Publication 951).

C11.2 HANDLING

The specifications, design, and detailing of pole structures should consider limits to length, size, and weight of individual members because of shipping, handling, terrain, and equipment restrictions. In setting weight limits, the Owner should consider that actual structure weights can deviate by as much 15% from the Fabricator’s calculated weights because of mill and fabrication tolerances.

Pole sections can be stored at a centralized marshaling yard or at the installation site. Poles stored at a marshaling yard can be partially or fully assembled prior to transportation to the installation site.

Care to prevent damage to protective coatings should be taken in both the shipping and the handling of pole members. Pole sections should be protected from chain tie-downs on trucks by plastic or nylon sheets. Slings for lifting should be nylon or other non-metallic material.

Pole sections should be stored on blocks and cribbing to prevent contact with the ground. The amount and spacing of the cribbing should be arranged to prevent excessive deflection during storage.

C11.3 SINGLE POLE STRUCTURES

The decision to use aerial or ground assembly depends on individual site considerations and the Owner’s preference. To minimize the need to install equipment in

the air, davit arms, line hardware, insulators, stringing blocks, ropes, and grounds as applicable are usually installed on the structure prior to erection.

C11.3.1 Slip Joints

Poles assembled on the ground should have sections blocked level prior to joint assembly. Care should be taken to properly align the sections using marks specified by the Fabricator and as shown on the Fabricator's drawings, and proper orientation of arms, brackets, and climbing accessories should be verified. The maximum and minimum lap lengths should be marked on the lower section. The sections should be overlapped as far as possible prior to application of jacks or other mechanical assembly equipment. Final assembly should be made using jacking force or other means as specified. Movement of one section during final assembly using a boom or other effective means will aid in the successful assembly of the slip joint.

When slip joints are assembled in the air, the bottom pole section is set on the foundation, or embedded in the excavation, and plumbed. The section being added should be as plumb as possible during lowering so as to prevent binding of the sections during overlapping. The upper section should be slowly lowered onto the lower section. Mechanical means to complete the joint assembly should be employed as specified by the Structure Designer. The weight of the upper section alone can produce a slip joint that is difficult to disassemble, so it is especially important to ensure proper alignment of sections when assembling in the air.

Special lubricants to aid in the assembly of slip joints are generally not required. If used, the lubricant should be nonstaining and water-soluble. The use and type of lubricant should be approved by the Structure Designer.

Sections should be carefully aligned to produce a tight, even joint without major gaps between the two sections. The use of shims to fill gaps between poorly mated sections in a slip joint is not recommended. Slip joints transfer load through friction between the section surfaces, and the use of shims will interfere with the load transfer and reduce the load transfer capacity of the joint.

C11.3.2 Bolted Flange Joints

The flange bolts should be brought to a snug-tight condition. As flange bolts are brought to a snug-tight condition, all of the faying surface may not be in contact.

Final bolt tensioning should follow a sequence to provide for even tensioning of all bolts and to ensure

section alignment. A pair of bolts on opposite sides of the joint should be tensioned followed by a similar pair until all bolts are tensioned.

Proper bolt tensioning in flange joints is required because of the cyclic nature of the loading. High-strength bolts are susceptible to cracking when subjected to high stress fluctuations, and pretensioning of the bolts by the turn-of-nut or other approved method ensures a more constant bolt stress and prevents bolt failure.

Flange plates used for pole joints are relatively thick as compared to material common to joints in other types of structures, and acceptable fabrication misalignments or plate distortion can result in small gaps between the flanges, even after final bolt tensioning. These gaps, within permitted limits, are not injurious to the load transfer capability of the joint. Larger gaps may be filled by shims.

C11.3.3 Attachments to Pole Sections

Some attachments to pole sections, such as arms that use box or bracket type connections in which the bolts act as pin connectors, do not have true faying surfaces and are intentionally loose-fitting.

C11.3.4 Erection of Assembled Structures

The structure should be laid out at the installation site to minimize erection effort and ensure safety. A temporary link between slip-jointed sections should be installed to prevent loosening or separation of the sections during lifting. The jacking attachment nuts can often be used for attachment of the link.

Poles may be erected using lifting lugs (if installed) or a choker. The lift point for the choker will be field-determined and is dependent upon the assembled arrangement of the pole, including accessories such as line hardware. Tall, slender poles, such as guyed structures, can require two-point lifting or other special rigging to prevent excessive deflection and/or stress during the lift.

C11.4 FRAME TYPE STRUCTURES

The most common type of frame structure is the H-frame. Another typical frame structure is the four-legged A-frame commonly used as a substation termination structure. The assembly process for frame structures is similar to that used for single pole structures, and the same discussion and recommendations given in Section C11.3 apply.

C11.4.1 Slip Joints in Frames

Slip-jointed legs of frame structures should be assembled on the ground to allow variations in leg lengths caused by slip tolerance to be compensated for by adjusting the anchor bolt system or embedment length.

C11.4.2 Erection

Crossarms and cross bracing, if used, can be installed on the ground and the structure erected as a unit. Special care should be taken to maintain structure geometry. The correct distance between the legs should be ensured before tightening the connections.

A spreader bar or yoke should be used between the two legs of an H-frame type structure during lifting. Tag lines or equipment such as bulldozers, trucks, or tractors can be used to guide the structure to the foundation.

Installation on anchor bolt foundations could require installing one leg on its foundation, and then moving the second leg to position for installation on its foundation. Chain hoists, winches, or other means may be employed for this alignment as permitted by the Owner. Care should be taken to protect the anchor bolt threads from damage during erection and alignment of the structure. Once placed on the foundation, the structure should be plumbed and the anchor bolts tightened.

Frame structures with single-piece legs, or flange-bolted leg joints, are recommended for aerial assembly applications. H-frame structures can be erected one leg at a time, followed by the top section consisting of the crossarm and static masts either assembled and lifted as a unit or lifted and assembled individually. Cross bracing can be added as the final pieces in the structure assembly.

Routine fabrication and construction tolerances will require adjustment and alignment of members during assembly. Assembly of larger frames can require mechanical aid to deflect or rotate members to align connections. To facilitate the erection and assembly process, maximum adjustability should be maintained in a frame structure during assembly by leaving all connections loosely bolted. When assembly is complete, connection bolts should be tightened and the structure checked for vertical alignment (either plumbed or raked as required by the Line Designer).

C11.5 INSTALLATION ON FOUNDATION

For related information concerning helicopter erection, see Appendix V.

C11.5.1 Anchor Bolt and Base Plate Installation

The anchor bolt and base plate foundation system typically uses two nuts to attach each anchor bolt to the pole base plate. One nut is set below the base plate, and the other nut is set above the base plate. The base plate does not directly bear on the foundation surface, and bearing is not considered in the structure design.

Prior to structure erection, one nut is installed on each anchor bolt and turned down on the bolt to allow installation of the pole base plate and the top nut. The pole is lifted and set on the anchor bolts and bottom nuts, and the top nuts are installed and hand tightened. The pole is checked for alignment and plumb or, if a compensating deflection is being set, the pole is leaned to provide the desired deflection by adjusting both top and bottom nuts as required. For frame structures being assembled in the air, the anchor bolt nuts should be left snug tight to allow for movement until assembly is complete.

Tightening of anchor bolt nuts is accomplished by snug tightening all top nuts first, and then snug tightening all bottom nuts. Bottom nuts are checked to ensure firm contact with the base plate, and then all top nuts are tightened in accordance with the Fabricator's requirements.

Following installation, anchor bolt nuts can be secured to prevent loosening during service. The nuts may be secured by mechanically damaging the bolt threads, using a mechanical locking system, using a jam nut, or applying a tack weld between the anchor bolt nut and the base plate. Welds should not be applied to the bolt.

C11.5.2 Direct-Embedded Poles

The pole section is placed in the excavation, aligned, and oriented. Then the excavation is back-filled. Care should be taken during the backfilling and compaction process to prevent damage to the protective coating of the embedded pole section.

Specific recommendations and requirements should be made by the Line Designer as to the type of material and method of placement of backfill. This helps ensure that the in-service behavior of the pole will be in accordance with design assumptions regarding pole rotation at groundline.

C11.6 GUYING

C11.6.1 Guy Anchor Location

The accurate location of guy anchors is critical to the proper distribution of loads in the structure.

Changes in guy angles, either horizontal or vertical, and guy lengths can cause dramatic changes in structure forces from those predicted in design. It is vital that any field conditions that require a change in guy geometry be referred to the Structure Designer for review.

C11.6.2 Guy Installation

The Structure Designer should identify to the Line Designer the need for timely guy installation and any temporary guying required to provide structure stability prior to line completion. Some designs require immediate guy installation to resist even routine wind loading, while other designs use guys only to resist applied conductor and ground wire loads. Additional information for installation of guys can be found in Chapter 7, "Design of Guyed Electrical Transmission Structures," ASCE Manuals and Reports on Engineering Practice No. 91.

C11.7 POSTERECTION PROCEDURES

For additional information concerning recommended maintenance practices, refer to Appendix V.

C11.7.1 Inspection

Structures assembled in the air, where joints were initially assembled loosely bolted, should have all joints tightened and inspected for conformance with the Fabricator's requirements. Damage to protective coatings should be noted and touch-up repairs should be made. Final checks of alignment and plumb should be made.

C11.7.2 Grounding

In some cases bonding jumpers may be required to provide electrical continuity across structural joints to ensure a continuous ground path through the structure.

C11.7.3 Coating Repair

The damaged area of a galvanized coating should be cleaned using a wire brush and solvent, if necessary, to remove rust, grease, and other foreign matter. When dry, the area should be coated with a cold galvanizing product, as approved by the Owner, with as many coats applied as necessary to reach the required dry film thickness. Refer to ASTM A780 for additional information.

The damaged areas of paint coatings should be cleaned using a wire brush, scraper, and/or solvent as

necessary to remove rust, grease, and other foreign matter. It might be desirable to lightly sand the edges of the repair area to feather the touch-up paint into the existing coating. The damaged areas should be dry prior to coating. If damage is limited to the finish or top coat, apply one coat of properly mixed paint to the required dry film thickness. If damage includes the primer, the appropriate touch-up primer should be applied to the required dry film thickness and allowed to properly cure prior to application of the top coat. Care should be taken to ensure that the paint manufacturer's recommendations are followed during field application.

C11.7.4 Unloaded Arms

Conductors or ground wires attached to arms provide a vibration dampening effect to the arms. When conductors or ground wires will not be installed on the arms integrally with the line construction, the arms might be susceptible to damage from wind-induced oscillations of the unloaded arm. The symmetrical shape of the arms and the absence of the vibration dampening effect of attached conductors, ground wires, and assemblies can result in damaging oscillatory movements, even in relatively low wind velocities. The tension-compression cycling of the arms can cause fatigue cracking and arm failure.

When arms are installed without the planned conductor or ground wires, it may be necessary to provide remedial measures, either in the original design and fabrication or after installation in the field, to dampen the oscillations. Examples of these measures are internal or external dampening devices, internal cables, installing weights, temporary tiebacks, and insulator assemblies. The Structure Designer should be consulted to determine what measures, if any, should be employed for each specific circumstance.

For additional information concerning wind-induced vibration and oscillation of structures and members, see Appendix V.

C11.7.5 Hardware Installation


Aeolian vibration of conductors and static wires is a common occurrence. The severity of the vibration is dependent upon the tension-to-strength ratio of the installed conductors, span lengths, wind speed, and average annual minimum temperature. It is common practice to require installation of vibration dampers within two weeks of conductor installation. Without damper installation, wind-induced oscillations could be transmitted from the conductors and cause vibration of the structure components.

APPENDIX I NOTATION

The following symbols are used in the standard:

- A = cross-sectional area, in.² (mm²);
 A_{BC} = total anchor bolt cage net cross-sectional area, in.² (mm²);
 A_{eff} = foundations effective projected stress area of concrete, in.² (mm²);
 A_g = gross cross-sectional area, in.² (mm²);
 A_n = net cross-sectional area, in.² (mm²);
 A_r = cross-sectional area at root of the threads, in.² (mm²);
 A_s = tensile stress area of bolt, in.² (mm²);
 $A_{s(req'd)}$ = required tensile stress area of bolt, in.² (mm²);
 A_t = tensile stress area, in.² (mm²);
 BR = effective bend radius, in. (mm);
 c = distance from neutral axis to point where stress is checked, in. (mm);
 c_x = distance from Y-Y axis to point where stress is checked, in. (mm);
 c_y = distance from X-X axis to point where stress is checked, in. (mm);
 C_c = column slenderness ratio separating elastic and inelastic buckling;
 d = diameter of bolt, in. (mm);
 d_h = diameter of hole, in. (mm);
 D_o = outside diameter of tubular section, in. (mm);
 E = modulus of elasticity, 29,000 ksi (200 GPa);
 f_a = stress, in tension or compression, on a member, ksi (MPa);
 F_a = permitted compressive stress, ksi (MPa);
 f_b = bending stress on a member, ksi (MPa);
 f_{br} = bearing stress, ksi (MPa);
 F_b = permitted bending stress, ksi (MPa);
 f'_c = specified compressive strength of concrete at 28 days, ksi (MPa);
 F_c = effective concrete tensile capacity, ksi (MPa);
 F_{cr} = critical stress for local buckling, ksi (MPa);
 F_t = permitted tensile stress, ksi (MPa);
 $F_{t(v)}$ = permitted axial tensile stress in conjunction with shear stress, ksi (MPa);
 F_u = specified minimum tensile stress, ksi (MPa);
 f_v = shear stress, ksi (MPa);
 F_v = permitted shear stress, ksi (MPa);
 F_y = specified minimum yield stress, ksi (MPa);
 I = moment of inertia, in.⁴ (mm⁴);
 I_{BCx} = anchor bolt cage moment of inertia about X-X axis, in.⁴ (mm⁴);
 I_{BCy} = anchor bolt cage moment of inertia about Y-Y axis, in.⁴ (mm⁴);
 I_x = moment of inertia about X-X axis, in.⁴ (mm⁴);
 I_y = moment of inertia about Y-Y axis, in.⁴ (mm⁴);
 J = torsional constant of cross section, in.⁴ (mm⁴);
 K = effective length factor;
 KL/r = slenderness ratio;
 L = unbraced length, in. (mm);
 l_d = basic development length of anchor bolt, in. (mm);
 L_d = minimum development length (embedment) of anchor bolt, in. (mm);
 L_e = minimum distance, parallel to the load, from center of hole to edge of the member, in. (mm);
 L_s = minimum distance, perpendicular to the load, from center of hole to edge of the member, in. (mm);
 M = bending moment, in-kip (mm-N);
 M_t = resultant groundline moment, in.-kip (mm-N);
 M_x = bending moment about X-X axis, in.-kip (mm-N);
 M_y = bending moment about Y-Y axis, in.-kip (mm-N);
 n = number of threads per unit length, in. (mm); total number of bolts;
 P = axial load, tension, or compression, on member or guy, kips (N); actual force transmitted by bolt or pin, kips (N);
 P_{max} = maximum tension force permitted in the guy, kips (N);
 RBS = minimum rated breaking strength of guy, kips (N);
 Q = moment of section about neutral axis, in.³ (mm³);
 r = governing radius of gyration, in. (mm);
 s = center-to-center spacing between bolt holes, in. (mm);
 t = thickness of element, in. (mm);
 T = torsional moment, in-kip (mm-N);
 T_s = bolt tensile force, kips (N);
 V = shear force, kips (N);
 w = flat width of element, in. (mm);
 x_i = distance of bolt from Y-Y axis, in. (mm);
 y_i = distance of bolt from X-X axis, in. (mm);
 α = unit factor as specified in the text;
 β = unit factor as specified in the text;
 γ = ratio of required tensile area to the gross area of the anchor bolt;
 Ω = unit factor as specified in the text;
 Φ = unit factor as specified in the text;
 Γ = unit factor as specified in the text; and
 Θ = unit factor as specified in the text.

APPENDIX II PROPERTIES OF VARIOUS TUBULAR SECTIONS

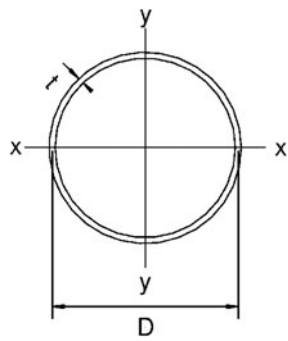

$$A_g = 3.14 \cdot D \cdot t$$

$$r = 0.354 \cdot D$$

$$I_x = I_y = 0.393 \cdot D^3 \cdot t$$


$$\text{Max. } \frac{Q}{I_t} = \frac{0.637}{D \cdot t}$$

$$C_x = 0.5 \cdot (D + t) \cdot \cos(a)$$

$$C_y = 0.5 \cdot (D + t) \cdot \sin(a)$$

$$\text{Max. } \frac{C}{J} = \frac{0.637 \cdot (D + t)}{(D^3 \cdot t)}$$

FIGURE A-II-1. Properties of Round Sections.

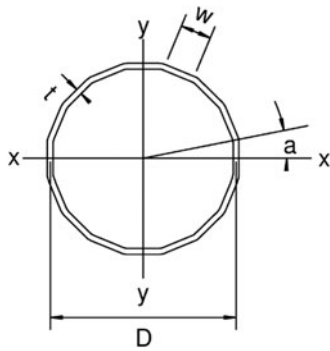

$$A_g = 3.19 \cdot D \cdot t$$

$$r = 0.356 \cdot D$$

$$I_x = I_y = 0.403 \cdot D^3 \cdot t$$

$$\text{Max. } \frac{Q}{I_t} = \frac{0.634}{D \cdot t}$$

$$C_x = 0.510 \cdot (D + t) \cdot \cos(a)$$


$$C_y = 0.510 \cdot (D + t) \cdot \sin(a)$$

$$\text{Max. } \frac{C}{J} = \frac{0.628 \cdot (D + t)}{(D^3 \cdot t)}$$

$$a = 11.25^\circ$$

$$w = 0.199 \cdot (D - t - 2 \cdot BR)$$

FIGURE A-II-2. Properties of Hexdecagonal (16-Sided Polygon) Sections.

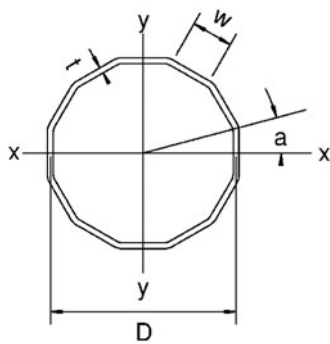

$$A_g = 3.22 \cdot D \cdot t$$

$$r = 0.358 \cdot D$$

$$I_x = I_y = 0.411 \cdot D^3 \cdot t$$

$$\text{Max. } \frac{Q}{I_t} = \frac{0.631}{D \cdot t}$$

$$C_x = 0.518 \cdot (D + t) \cdot \cos(a)$$


$$C_y = 0.518 \cdot (D + t) \cdot \sin(a)$$

$$\text{Max. } \frac{C}{J} = \frac{0.622 \cdot (D + t)}{(D^3 \cdot t)}$$

$$a = 15^\circ$$

$$w = 0.268 \cdot (D - t - 2 \cdot BR)$$

FIGURE A-II-3. Properties of Dodecagonal (12-Sided Polygon) Sections.

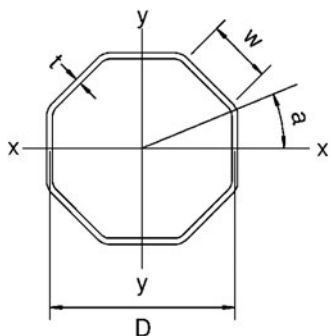

$$A_g = 3.32 \cdot D \cdot t$$

$$r = 0.364 \cdot D$$

$$I_x = I_y = 0.438 \cdot D^3 \cdot t$$

$$\text{Max. } \frac{Q}{I_t} = \frac{0.618}{D \cdot t}$$

$$C_x = 0.541 \cdot (D + t) \cdot \cos(a)$$


$$C_y = 0.541 \cdot (D + t) \cdot \sin(a)$$

$$\text{Max. } \frac{C}{J} = \frac{0.603 \cdot (D + t)}{(D^3 \cdot t)}$$

$$a = 22.5^\circ$$

$$w = 0.414 \cdot (D - t - 2 \cdot BR)$$

FIGURE A-II-4. Properties of Octagonal (8-Sided Polygon) Sections.

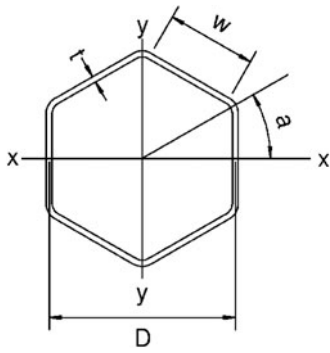

$$A_g = 3.46 \cdot D \cdot t$$

$$r = 0.373 \cdot D$$

$$I_x = I_y = 0.481 \cdot D^3 \cdot t$$

$$\text{Max. } \frac{Q}{I_t} = \frac{0.606}{D \cdot t}$$

$$C_x = 0.577 \cdot (D + t) \cdot \cos(a)$$


$$\text{Max. } \frac{C}{J} = \frac{0.577 \cdot (D + t)}{(D^3 \cdot t)}$$

$$C_y = 0.577 \cdot (D + t) \cdot \sin(a)$$

$$w = 0.577 \cdot (D - t - 2 \cdot BR)$$

$$a = 30^\circ$$

FIGURE A-II-5. Properties of Hexagonal (6-Sided Polygon) Sections.

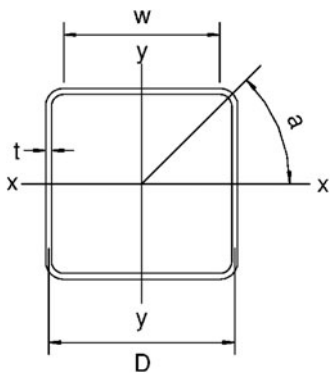

$$A_g = 4.00 \cdot D \cdot t$$

$$r = 0.408 \cdot D$$

$$I_x = I_y = 0.666 \cdot D^3 \cdot t$$

$$\text{Max. } \frac{Q}{I_t} = \frac{0.563}{D \cdot t}$$

$$C_x = 0.707 \cdot (D + t) \cdot \cos(a)$$

$$\text{Max. } \frac{C}{J} = \frac{0.500 \cdot (D + t)}{(D^3 \cdot t)}$$

$$C_y = 0.707 \cdot (D + t) \cdot \sin(a)$$

$$w = (D - t - 2 \cdot BR)$$

$$a = 45^\circ$$

FIGURE A-II-6. Properties of Square Sections.

NOTE: For polygon sections of Figs. A-II-1 to 6, all properties except flat width (*w*) assume sharp cornered section.

Notation for Appendix II

- A_g = gross area;
- a = angle between the *x*-axis and the corner of the polygon;
- BR = effective bend radius (actual or 4 times *t*, whichever is smaller);
- C_x = distance from *y*-axis to point;
- C_y = distance from *x*-axis to point;
- D = $D_o - t$ = mean diameter (measured to mid-point of thickness across flats on polygonal sections);
- D_o = outside diameter (measured across flats on polygonal sections);
- I = moment of inertia;
- J = polar moment of inertia;
- $Q/I_{t(\text{max})}$ = value for determining maximum flexural shear stress;
- $C/J_{(\text{max})}$ = value for determining maximum torsional shear stress;
- r = radius of gyration;
- t = thickness; and
- w = flat width of a side of a polygon.

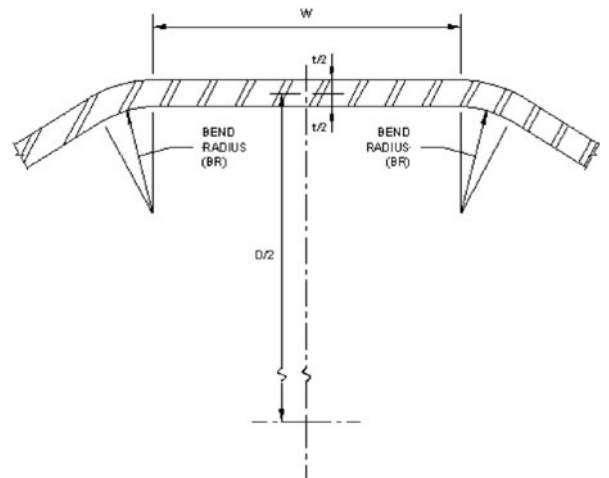


FIGURE A-II-7. Typical Dimensions of Polygon Sections.

APPENDIX III HORIZONTAL TESTING

The structure is normally placed in a horizontal position as shown in Fig. A-III-1 below. An assembled pole is typically bolted to an identical bottom section. This bottom section is secured near the base plate to an uplift foundation while the other end rests on a compression pad. One or more locations along the shaft will be selected as the load pulling points. The purpose of the load pull(s) will be to duplicate maximum design stress at all critical points in the shaft based on the cross-sectional geometry of the shaft and yield strength of the material. (Critical points are those points on the shaft with the highest stress.) Axial, shear, and torsional stresses cannot be directly applied to the structure because of the test configuration. To develop comparable maximum stresses, the applied moment may be greater than the design moment.

Test Equipment

The vertical loads are pulled at predetermined points along the shaft by cranes or other suitable pulling devices. Loads may be measured using calibrated load cells located in the pulling lines. A transit set up a safe distance away from the test structure may be used to measure deflections.

Test Procedure for Pole Test

Dead Load Increase. Calculation of test loads should compensate for the dead weight of the structure in its horizontal position.

Design Load Test. Incremental loads should be pulled, as indicated in the test requirements, with deflection readings being taken at predetermined points along the structure and at the uplift and com-

pression points. Each incremental load should be held for the required time before proceeding to the next load increment. After testing the structure, it should be unloaded to the dead load so final deflection readings can be taken. A final inspection should be made of the structure.

APPENDIX IV HEADED ANCHOR BOLTS

For headed bolts, materials used should be limited to ASTM A36, A193 (grade B7), A307 (grade B), A325, and A354 (grade BC).

Headed Bolts Development Length

The development length for headed bolts is defined as the following:

$$l_d = 25d \quad (\text{Eq. A IV-1})$$

where

l_d = embedment length of anchor bolt; and
 d = bolt diameter.

Headed anchor bolts should have as a minimum a clear cover of two bolt diameters and 3 in. (76 mm) clear cover between the anchor bolts and reinforcing steel.

Background

In lieu of following ACI’s methodology, where one must ensure that there is sufficient concrete area to resist the tensile forces, the object is to get the tensile load from the bolt to the adjacent vertical reinforcing bars.

Twenty-five diameters for a development length for a headed anchor bolt will closely approximate the

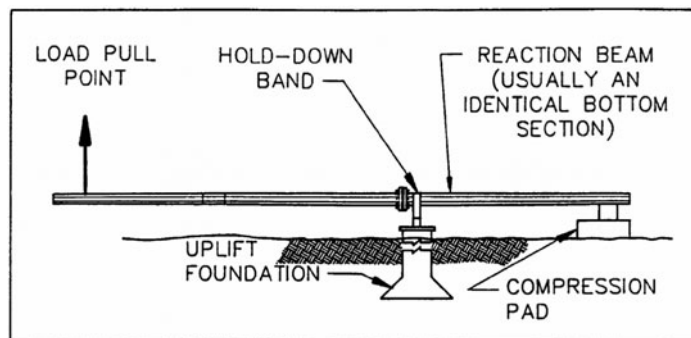


FIGURE A-III-1. Horizontal Test Setup.

development length for the rebar following ACI 318 plus 3 in. for top cover and 3 in. for cover between rebar and anchor bolt. In this way the Structure Designer will provide the Foundation Designer adequate bolt length to provide sufficient vertical reinforcement for calculating reinforcing requirements.

APPENDIX V ASSEMBLY AND ERECTION

Introduction

This appendix provides supplemental information to Section 11 concerning the assembly and erection of steel transmission pole structures.

Helicopter Erection

Helicopter erection requires coordination between the Owner and the Fabricator as to the techniques to be employed, weight limitations, special brackets, and other similar items unique to helicopter lifts. Special guides, which can be provided by the helicopter contractor, can eliminate the need for workers to be under the structure as it is being set or as sections are being added.

Helicopters can be used to transport pole sections from the marshaling yard to the structure site, or they can be used to erect structures already transported to the site. This latter technique can be employed when restrictions limit the size of construction equipment at the pole site.

To lift the structure, a sling is attached to an electrically operated hook on the underside of the helicopter. A load cell is normally used to monitor the effective weight of the payload, which includes the effects of the aerodynamic drag and rotor downwash. The hook is controlled by the helicopter pilot, who can release the load if necessary. The slings should be attached to the structure so as to not overstress or excessively deflect or distort the structure.

Structures to be guyed can be flown with guys attached to the structure. Guys should be coiled and attached to the structure in such a manner as to prevent contact with the ground, trees, fences, or other objects during flight. Coils should be reachable from the ground once the structure is set, and each guy should be marked to identify the proper ground anchor for attachment.

Unguyed structures should be secured on the foundation prior to release of the structure by the helicopter. Guyed structures should also have guys secured to the anchors prior to release by the helicopter.

In-Service Structure Maintenance and Inspection

After installation, a routine program of structure inspection is recommended for all steel transmission pole structures. This program should be designed to guard against structural degradation resulting from environmental wear, corrosion, accidental damage, and vandalism. Included among the items in a typical routine inspection program are the following:

1. Inspection of protective coatings and touch-up of damaged areas;
2. Inspection of self-weathering structures for localized areas of continual moisture and excessive corrosion;
3. Visual inspection of bolted connections and spot check of bolt tightness in selected connections;
4. Visual inspection of welded connections and seams to detect cracks;
5. Visual inspection of the groundline area to ensure that soil and vegetation are not in contact with or otherwise creating a corrosive environment for the steel structure; and
6. Inspection of climbing hardware and attachments for continued integrity and to ensure inaccessibility to unauthorized climbing.

Wind-Induced Vibration

Structures and members. Vortex shedding of wind forces by structures and structure members can result in oscillation of slender arms, poles, or other elements. Tall steel pole structures used for substation lightning masts are examples of a structure type commonly subjected to noticeable wind oscillations. Where such movement is predicted or observed with a pole or a structure member, the installation of vibration damping devices might be considered to prevent fatigue damage. When the potential for such movement is anticipated by the Structure Designer, decreasing the slenderness ratio of the member (L/r) can be considered as an alternative to the installation of damping devices.

Attached Conductors and Static Wires. Aeolian vibration of aerial conductors and static wires is a common occurrence. The severity of the vibration is dependent upon the tension to strength ratio of the installed conductors, span lengths, wind speed, and average annual minimum temperature. Where such vibrations are calculated to be of such a magnitude range that wire damage could occur, it is common practice to install vibration dampers. The use of these dampers should