



STANDARD

**ANSI/ASHRAE Standard 125-2016**  
(Supersedes ANSI/ASHRAE Standard 125-1992 [RA 2011])

# Method of Testing Thermal Energy Meters for Liquid Streams in HVAC Systems

Approved by ASHRAE on December 31, 2015, and by the American National Standards Institute on December 31, 2015.

ASHRAE Standards are scheduled to be updated on a five-year cycle; the date following the Standard number is the year of ASHRAE approval. The latest edition of an ASHRAE Standard may be purchased on the ASHRAE website ([www.ashrae.org](http://www.ashrae.org)) or from ASHRAE Customer Service, 1791 Tullie Circle, NE, Atlanta, GA 30329-2305. E-mail: [orders@ashrae.org](mailto:orders@ashrae.org). Fax: 678-539-2129. Telephone: 404-636-8400 (worldwide) or toll free 1-800-527-4723 (for orders in US and Canada). For reprint permission, go to [www.ashrae.org/permissions](http://www.ashrae.org/permissions).

© 2016 ASHRAE

ISSN 1041-2336



**ASHRAE Standing Standard Project Committee 125**  
**Cognizant TCs: TC 6.1, Hydronic and Steam Equipment and Systems,**  
**and TC 6.7, Solar Energy Utilization**  
**SPLS Liaison: Ronald H. Howell**

Gerald R. Guinn, *Chair*  
Charles J. Cromer, *Vice-Chair*  
Lawrence R. Brand  
Dieter R. Goettling  
Joern Huusom

David J. Keegan  
Tom Michel  
Peter P. Philips  
Alexander H. Sleiman  
Sherwood G. Talbert

William H. Thrasher  
Jerrold F. Zimmer  
Dong Tian-Lu

---

**ASHRAE STANDARDS COMMITTEE 2015–2016**

Douglass T. Reindl, *Chair*  
Rita M. Harrold, *Vice-Chair*  
James D. Aswegan  
Niels Bidstrup  
Donald M. Brundage  
John A. Clark  
Waller S. Clements  
John F. Dunlap  
James W. Earley, Jr.  
Keith I. Emerson

Steven J. Emmerich  
Julie M. Ferguson  
Walter T. Grondzik  
Roger L. Hedrick  
Srinivas Katipamula  
Rick A. Larson  
Lawrence C. Markel  
Arsen K. Melikov  
Mark P. Modera  
Cyrus H. Nasser

Heather L. Platt  
David Robin  
Peter Simmonds  
Dennis A. Stanke  
Wayne H. Stoppelmoor, Jr.  
Jack H. Zarour  
Julia A. Keen, *BOD ExO*  
James K. Vallort, *CO*

Stephanie C. Reiniche, *Senior Manager of Standards*

---

**SPECIAL NOTE**

This American National Standard (ANS) is a national voluntary consensus Standard developed under the auspices of ASHRAE. *Consensus* is defined by the American National Standards Institute (ANSI), of which ASHRAE is a member and which has approved this Standard as an ANS, as "substantial agreement reached by directly and materially affected interest categories. This signifies the concurrence of more than a simple majority, but not necessarily unanimity. Consensus requires that all views and objections be considered, and that an effort be made toward their resolution." Compliance with this Standard is voluntary until and unless a legal jurisdiction makes compliance mandatory through legislation.

ASHRAE obtains consensus through participation of its national and international members, associated societies, and public review.

ASHRAE Standards are prepared by a Project Committee appointed specifically for the purpose of writing the Standard. The Project Committee Chair and Vice-Chair must be members of ASHRAE; while other committee members may or may not be ASHRAE members, all must be technically qualified in the subject area of the Standard. Every effort is made to balance the concerned interests on all Project Committees.

The Senior Manager of Standards of ASHRAE should be contacted for

- a. interpretation of the contents of this Standard,
- b. participation in the next review of the Standard,
- c. offering constructive criticism for improving the Standard, or
- d. permission to reprint portions of the Standard.

**DISCLAIMER**

ASHRAE uses its best efforts to promulgate Standards and Guidelines for the benefit of the public in light of available information and accepted industry practices. However, ASHRAE does not guarantee, certify, or assure the safety or performance of any products, components, or systems tested, installed, or operated in accordance with ASHRAE's Standards or Guidelines or that any tests conducted under its Standards or Guidelines will be nonhazardous or free from risk.

**ASHRAE INDUSTRIAL ADVERTISING POLICY ON STANDARDS**

ASHRAE Standards and Guidelines are established to assist industry and the public by offering a uniform method of testing for rating purposes, by suggesting safe practices in designing and installing equipment, by providing proper definitions of this equipment, and by providing other information that may serve to guide the industry. The creation of ASHRAE Standards and Guidelines is determined by the need for them, and conformance to them is completely voluntary.

In referring to this Standard or Guideline and in marking of equipment and in advertising, no claim shall be made, either stated or implied, that the product has been approved by ASHRAE.

## CONTENTS

### ANSI/ASHRAE Standard 125-2016 Method of Testing Thermal Energy Meters for Liquid Streams in HVAC Systems

| SECTION   | PAGE |
|---|------|
| Foreword.....   | 2    |
| 1 Purpose .....   | 2    |
| 2 Scope .....   | 2    |
| 3 Definitions.....  | 2    |
| 4 Nomenclature .....  | 2    |
| 5 Classifications.....                                      | 3    |
| 6 Requirements .....  | 3    |
| 7 Facility Instrumentation.....                             | 4    |
| 8 Apparatus and Method of Testing .....                     | 4    |
| 9 Test Procedures and Computations .....                    | 6    |
| 10 Data to be Recorded and Test Report.....                 | 9    |
| 11 References .....   | 9    |
| Informative Annex A: Bibliography of Related Standards..... | 9    |

#### NOTE

Approved addenda, errata, or interpretations for this standard can be downloaded free of charge from the ASHRAE Web site at [www.ashrae.org/technology](http://www.ashrae.org/technology).

© 2016 ASHRAE

1791 Tullie Circle NE • Atlanta, GA 30329 • [www.ashrae.org](http://www.ashrae.org) • All rights reserved.

ASHRAE is a registered trademark of the American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.  
ANSI is a registered trademark of the American National Standards Institute.

(This foreword is not a part of this standard. It is merely informative and does not contain requirements necessary for conformance to the standard. It has not been processed according to the ANSI requirements for a standard and may contain material that has not been subject to public review or a consensus process.)

## FOREWORD

This is a revision of Standard 125-1992 (RA 2011). This standard was prepared under the auspices of ASHRAE. It may be used, in whole or in part, by an association or government agency with due credit to ASHRAE. Adherence is strictly on a voluntary basis and merely in the interests of obtaining uniform standards throughout the industry. This 2016 revision updates references in the standard.

## 1. PURPOSE

The purpose of this standard is to provide a method of testing factory-assembled thermal energy meters used to measure the thermal energy added to or extracted from a liquid stream supplying an HVAC system.

## 2. SCOPE

**2.1** The test methods, procedures, and facility descriptions in this standard are intended for use in determining measurement accuracy, pressure losses, service flow rate limits, temperature difference limits, and reliability effects of mounting attitude.

**2.2** This standard is limited to applications in which the fluid remains in a completely liquid state while traversing the thermal energy meter.

**2.3** The applications of this standard include, but are not limited to, thermal energy meters used for billing or revenue metering for hydronic applications.

**2.4** This standard does not apply to meters using principles of change-of-state of the fluid, simple elapsed time, or measured indoor or outdoor temperature difference to allocate consumption among various end-use customers.

## 3. DEFINITIONS

**3.1** Figure 1 illustrates the elements of a thermal energy meter.

**3.2** The following definitions apply:


**accuracy:** the ability of an instrument to indicate the true value of the measured physical quantity.

**Btu meter:** see *thermal energy meter*.

**flowmeter:** see *flow sensor*.

**flow sensor:** a sensor capable of providing a signal (output) that is related to the volumetric flow of liquid through the sensor.

**heat meter:** see *thermal energy meter*.

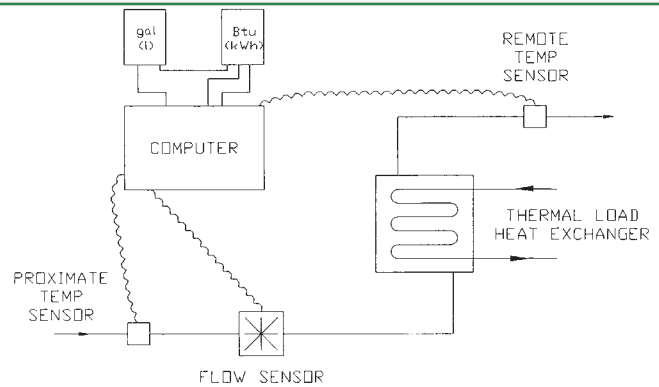

**Figure 1** Elements of a thermal energy meter (i.e., test article) in an open-loop configuration.

**integrator:** a device using signals from temperature and flow sensors through time for computing thermal energy transferred.

**negative sense:** a test condition in which the temperature of the remote sensor is less than the temperature of the proximate sensor.

**positive sense:** a test condition in which the temperature of the remote sensor is greater than the temperature of the proximate sensor.

**precision:** the closeness of agreement among repeated measurements of a constant physical quantity.

**proximate sensor:** the temperature sensor located in the same temperature stream as the flow sensor.

**remote sensor:** the temperature sensor located in a stream whose temperature is different from the temperature of the proximate sensor.

**temperature differential sensor:** a sensor system, composed of two temperature sensors, which is capable of providing a signal that is related to the temperature differential of the two sensors.

**temperature sensor:** a sensor, located in the liquid circuit, which is capable of producing a signal (output) that is related to the temperature of the sensor.

**thermal energy meter:** a metering system capable of measuring the thermal energy added to or extracted from a liquid stream.

**thermal energy meter error:** for a set of test conditions, the difference between the indicated quantity of energy and the exact quantity of energy passing through a thermal energy meter, divided by the exact quantity of energy, expressed as a percentage.

**thermal meter:** see *thermal energy meter*.

## 4. NOMENCLATURE

$C_p$  = specific heat of liquid, Btu/(lb·°F) (kJ/(kg·K))  
 $E$  = thermal energy meter error, %