

ANSI/ASHRAE Standard 28-1996 (RA 2010)
(Reaffirmation of ANSI/ASHRAE Standard 28-1996 [RA 2006])



ASHRAE STANDARD

Methods of Testing Flow Capacity of Refrigerant Capillary Tubes

Approved by the ASHRAE Standards Committee on June 21, 1996, and reaffirmed on January 23, 2010.
Approved by the ASHRAE Board of Directors on June 27, 1996, and reaffirmed on January 27, 2010.
Approved by the American National Standards Institute on September 6, 1996, and reaffirmed on January 28, 2010.

ASHRAE Standards are scheduled to be updated on a five-year cycle; the date following the standard number is the year of ASHRAE Board of Directors approval. The latest edition of an ASHRAE Standard may be purchased on the ASHRAE Web site (www.ashrae.org) or from ASHRAE Customer Service, 1791 Tullie Circle, NE, Atlanta, GA 30329-2305. E-mail: orders@ashrae.org. Fax: 404-321-5478. Telephone: 404-636-8400 (worldwide) or toll free 1-800-527-4723 (for orders in US and Canada). For reprint permission, go to www.ashrae.org/permissions.

© Copyright 2010 American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.

ISSN 1041-2336



**American Society of Heating, Refrigerating
and Air-Conditioning Engineers, Inc.**
1791 Tullie Circle NE, Atlanta, GA 30329
www.ashrae.org

ASHRAE Standing Standard Project Committee 28
Cognizant TC: TC 8.8, Refrigerant System Controls and Accessories
SPLS Liaison: William E. Murphy

Piotr A. Domanski, *Chair**
Byron R. Horak, *Secretary**
Chinmoy Banerjee
Robert L. Cushman*
William H. Mapes, III*

Thompson J. Matambo*
Michael B.Pate*
Roberto Pereira*
Clyde Wayne Siltanen*
R. Eddie Stanton*

**Denotes members of voting status when the document was approved for publication*

ASHRAE STANDARDS COMMITTEE 2009–2010

Steven T. Bushby, *Chair*
H. Michael Newman, *Vice-Chair*
Robert G. Baker
Michael F. Beda
Hoy R. Bohanon, Jr.
Kenneth W. Cooper
K. William Dean
Martin Dieryckx
Allan B. Fraser
Katherine G. Hammack
Nadar R. Jayaraman
Byron W. Jones
Jay A. Kohler
Carol E. Marriott

Merle F. McBride
Frank Myers
Janice C. Peterson
Douglas T. Reindl
Lawrence J. Schoen
Boggarm S. Setty
Bodh R. Subherwal
James R. Tauby
James K. Vallort
William F. Walter
Michael W. Woodford
Craig P. Wray
Wayne R. Reedy, *BOD ExO*
Thomas E. Watson, *CO*

Stephanie Reiniche, *Manager of Standards*

SPECIAL NOTE

This American National Standard (ANS) is a national voluntary consensus standard developed under the auspices of the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE). *Consensus* is defined by the American National Standards Institute (ANSI), of which ASHRAE is a member and which has approved this standard as an ANS, as "substantial agreement reached by directly and materially affected interest categories. This signifies the concurrence of more than a simple majority, but not necessarily unanimity. Consensus requires that all views and objections be considered, and that an effort be made toward their resolution." Compliance with this standard is voluntary until and unless a legal jurisdiction makes compliance mandatory through legislation.

ASHRAE obtains consensus through participation of its national and international members, associated societies, and public review.

ASHRAE Standards are prepared by a Project Committee appointed specifically for the purpose of writing the Standard. The Project Committee Chair and Vice-Chair must be members of ASHRAE; while other committee members may or may not be ASHRAE members, all must be technically qualified in the subject area of the Standard. Every effort is made to balance the concerned interests on all Project Committees.

The Manager of Standards of ASHRAE should be contacted for:

- a. interpretation of the contents of this Standard,
- b. participation in the next review of the Standard,
- c. offering constructive criticism for improving the Standard, or
- d. permission to reprint portions of the Standard.

DISCLAIMER

ASHRAE uses its best efforts to promulgate Standards and Guidelines for the benefit of the public in light of available information and accepted industry practices. However, ASHRAE does not guarantee, certify, or assure the safety or performance of any products, components, or systems tested, installed, or operated in accordance with ASHRAE's Standards or Guidelines or that any tests conducted under its Standards or Guidelines will be nonhazardous or free from risk.

ASHRAE INDUSTRIAL ADVERTISING POLICY ON STANDARDS

ASHRAE Standards and Guidelines are established to assist industry and the public by offering a uniform method of testing for rating purposes, by suggesting safe practices in designing and installing equipment, by providing proper definitions of this equipment, and by providing other information that may serve to guide the industry. The creation of ASHRAE Standards and Guidelines is determined by the need for them, and conformance to them is completely voluntary.

In referring to this Standard or Guideline and in marking of equipment and in advertising, no claim shall be made, either stated or implied, that the product has been approved by ASHRAE.

CONTENTS

ANSI/ASHRAE Standard 28-1996 (RA 2010) Methods of Testing Flow Capacity of Refrigerant Capillary Tubes

SECTION	PAGE
Foreword.....	2
1 Purpose	2
2 Scope	2
3 Definitions.....	2
4 Apparatus for Traditional Method	2
5 Test Procedure for Traditional Method.....	3
6 Data to Be Recorded for Traditional Method	3
7 Correction to Standard Basis for Traditional Method.....	3
8 Presentation of Data.....	4
9 Suggestion for Acceptable Variation in Test Results.....	4
10 Apparatus for Alternative Method	5
11 Test Procedure for Alternative Method.....	5
12 Correction to Standard Basis for Alternative Method	5
13 References	6

NOTE

When addenda, errata, or interpretations to this standard have been approved, they can be downloaded free of charge from the ASHRAE Web site at www.ashrae.org/technology.

© Copyright 2010 American Society of Heating,
Refrigerating and Air-Conditioning Engineers, Inc.

1791 Tullie Circle NE
Atlanta, GA 30329
www.ashrae.org
All rights reserved.

(This foreword is not part of this standard. It is merely informative and does not contain requirements necessary for conformance to the standard. It has not been processed according to the ANSI requirements for a standard and may contain material that has not been subject to public review or a consensus process. Unresolved objectors on informative material are not offered the right to appeal at ASHRAE or ANSI.)

FOREWORD

This is a reaffirmation of ASHRAE Standard 28-1996 (RA 2006). This standard was prepared under the auspices of the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE). It may be used, in whole or in part, by an association or government agency with due credit to ASHRAE. Adherence is strictly on a voluntary basis and merely in the interests of obtaining uniform standards throughout the industry. This version updates the references section, removes the dates of the references from the body of the standard, includes additional verbiage for Section 3 Definition of capillary tube "with length over diameter ratio greater than 20", capitalizes the term section and corrects the I-P units in section 4c and 10d.

1. PURPOSE

This standard provides uniform methods for laboratory testing of the flow capacity of refrigerant capillary tubes.

2. SCOPE

2.1 This standard prescribes two test methods, a traditional method and an alternative method, for determining the flow capacity of capillary tubes such as are used for refrigerant metering in refrigeration systems. Both methods use dry nitrogen and provide comparable results, but the alternative method is more convenient if electronic devices are used.

2.2 The results obtained by the prescribed procedures are indicative of the refrigerant flow characteristics of the tube but are not intended to represent the actual refrigerant flow characteristics in a refrigerating cycle.

2.3 The scope of this standard does not include specifications of tolerances on tube diameters or nitrogen flow capacity; however, acceptable variation in test results is suggested.

3. DEFINITIONS

capillary tube: tube of small bore (diameters generally ranging down to 0.50 mm [0.02 in.] ID with length over diameter ratio greater than 20) used for the simultaneous purposes of metering the refrigerant and of accomplishing the expansion process between condenser and evaporator in those refrigeration systems in which it is used.

nitrogen capacity: the volumetric flow rate, L/s (cfm), equivalent to the mass flow rate of dry nitrogen that would be passed for a specified inlet pressure if discharge had been to standard atmospheric pressure of 101.325 kPa (14.696 psi) absolute.

4. APPARATUS FOR TRADITIONAL METHOD

The arrangement of the traditional test apparatus shall be in accordance with Figure 1. The apparatus is described in terms of basic measurement devices (e.g., thermometers, pressure gauges) with the understanding that more sophisticated devices can be used if they satisfy the required measurement accuracy specified in this standard.

The essential elements of the apparatus are listed below.

- A supply of dry nitrogen (1) at a minimum pressure of 850 kPa gauge (123.3 psig) and a maximum dew point of -32°C (-25.6°F).
- A filter (2), which will remove any solid or liquid contaminants that may inadvertently be in the supply lines.
- An adjustable regulator (3) by means of which any test pressure between 15 and 700 kPa gauge (2.2 and 101.5 psig) can be maintained steadily ($\pm 5\%$ or ± 7 kPa [1 psi], whichever is smaller) during the test.
- A tempering coil (4) (if necessary) to ensure that the nitrogen entering the test specimen is maintained at the ambient temperature of the apparatus, which shall be $21^{\circ}\text{C} \pm 3^{\circ}\text{C}$ ($70^{\circ}\text{F} \pm 5^{\circ}\text{F}$).
- A temperature-measuring instrument (5) with an accuracy of $\pm 0.3^{\circ}\text{C}$ (0.5°F). Mounting shall ensure that the temper-

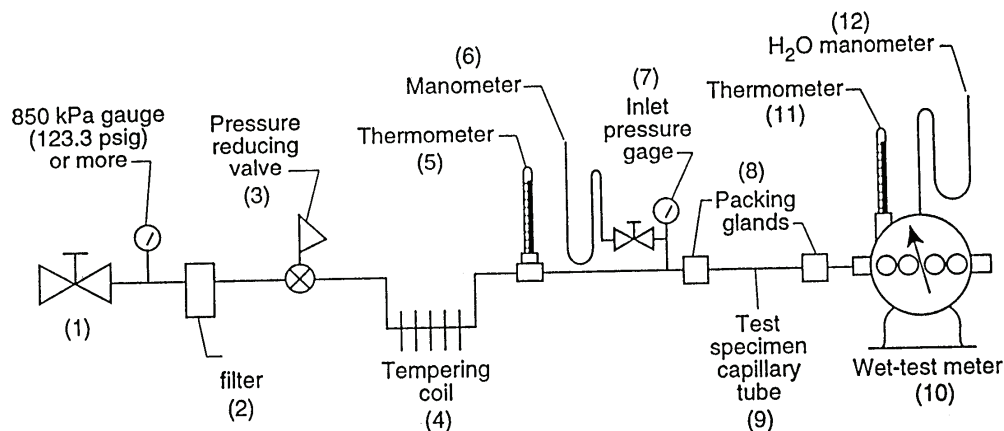


Figure 1 Test apparatus for determining nitrogen flow capacity of capillary tube (traditional method). Connecting tubes and packing glands shall be sized to ensure negligible pressure drop between the inlet pressure gauge and the capillary tube entrance and between the capillary tube exit and the wet-test meter.