



**American Water Works
Association**

Dedicated to the World's Most Important Resource®

ANSI/AWWA B306-15
(Revision of ANSI/AWWA B306-07)

AWWA Standard

Aqua Ammonia (Liquid Ammonium Hydroxide)

Effective date: May 1, 2015.

First edition approved by AWWA Board of Directors Jan. 24, 2007.

This edition approved Jan. 24, 2015.

Approved by American National Standards Institute Jan. 12, 2015.




AWWA Standard

This document is an American Water Works Association (AWWA) standard. It is not a specification. AWWA standards describe minimum requirements and do not contain all of the engineering and administrative information normally contained in specifications. The AWWA standards usually contain options that must be evaluated by the user of the standard. Until each optional feature is specified by the user, the product or service is not fully defined. AWWA publication of a standard does not constitute endorsement of any product or product type, nor does AWWA test, certify, or approve any product. The use of AWWA standards is entirely voluntary. This standard does not supersede or take precedence over or displace any applicable law, regulation, or code of any governmental authority. AWWA standards are intended to represent a consensus of the water supply industry that the product described will provide satisfactory service. When AWWA revises or withdraws this standard, an official notice of action will be placed in the Official Notice section of *Journal - American Water Works Association*. The action becomes effective on the first day of the month following the month of *Journal - American Water Works Association* publication of the official notice.

American National Standard

An American National Standard implies a consensus of those substantially concerned with its scope and provisions. An American National Standard is intended as a guide to aid the manufacturer, the consumer, and the general public. The existence of an American National Standard does not in any respect preclude anyone, whether that person has approved the standard or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standard. American National Standards are subject to periodic review, and users are cautioned to obtain the latest editions. Producers of goods made in conformity with an American National Standard are encouraged to state on their own responsibility in advertising and promotional materials or on tags or labels that the goods are produced in conformity with particular American National Standards.

CAUTION NOTICE: The American National Standards Institute (ANSI) approval date on the front cover of this standard indicates completion of the ANSI approval process. This American National Standard may be revised or withdrawn at any time. ANSI procedures require that action be taken to reaffirm, revise, or withdraw this standard no later than five years from the date of ANSI approval. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036; 212.642.4900; or emailing info@ansi.org.

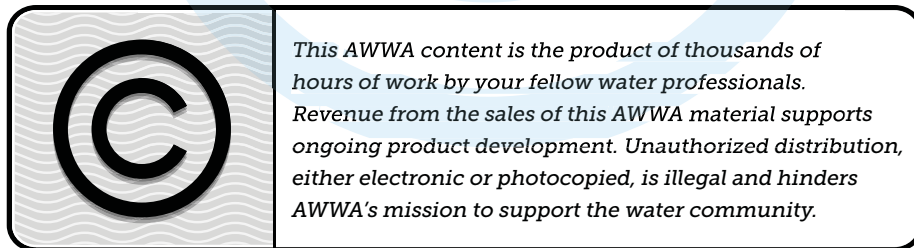

ISBN-13, print: 978-1-62576-071-5

eISBN-13, electronic: 978-1-61300-326-8

DOI: <http://dx.doi.org/10.12999/AWWA.B306.15>

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopy, recording, or any information or retrieval system, except in the form of brief excerpts or quotations for review purposes, without the written permission of the publisher.

Copyright © 2015 by American Water Works Association
Printed in USA

Committee Personnel

The AWWA subcommittee that developed this standard had the following personnel at the time:

| | |
|--|--------|
| D.B. Binder, Tanner Industries Inc., Southampton, Pa. | (AWWA) |
| R. Cannon, La Roche Industries, Atlanta, Ga. | (AWWA) |
| J.C. Cranor, Littleton, Colo. | (AWWA) |
| W.B. Huebner, Siemens, Mine Hill, N.J. | (AWWA) |
| M.F. Knudson, Portland Bureau of Water Works, Portland, Ore. | (AWWA) |
| B.C. Lauer,* Standards Group Liaison, AWWA, Denver, Colo. | (AWWA) |
| B. Lonsdale, Terra Industries, Courtright, Ont., Canada | (AWWA) |
| E.R. Saxon, Beaufort-Jasper Water and Sewer Authority, Okatie, S.C. | (AWWA) |
| K.B. Stark, Disinfectants Committee Liaison, NSF International, Ann Arbor, Mich. | (AWWA) |

The AWWA Standards Committee on Disinfectants, which reviewed and approved this standard, had the following personnel at the time:

K. Blake Stark, Chair

General Interest Members

| | |
|---|--------|
| M.P. Chaulk, CBCL Limited Consultants Limited, Halifax Region Municipality, N.S., Canada | (AWWA) |
| M.C. Graves, HDR Engineering, Austin, Texas | (AWWA) |
| H. Huddle, Camp Dresser & McKee, Falls Church, Va. | (AWWA) |
| S.J. Posavec,* Standards Group Liaison, AWWA, Denver, Colo. | (AWWA) |
| K.J. Rehg, Baxter & Woodman Inc., Crystal Lake, Ill. | (AWWA) |
| M. Sivaganesan, US Environmental Protection Agency, Cincinnati, Ohio | (AWWA) |
| K.B. Stark, NSF International, Ann Arbor, Mich. | (AWWA) |
| D.R. Wilkes,* O'Brien and Gere, Atlanta, Ga. | (AWWA) |


Producer Members

| | |
|---|--------|
| T. Cirone, Chlorine Institute, Arlington, Va. | (AWWA) |
| W.B. Huebner, Siemens, Mine Hill, N.J. | (AWWA) |
| M. McLaughlin, Olin Chlor Alkali Products, Cleveland, Tenn. | (AWWA) |

* Liaison, nonvoting

User Members

| | |
|---|--------|
| R.C. Lorenz, Westerville Water Plant, Westerville, Ohio | (AWWA) |
| C.L. McLain, Moorhead Public Service, Moorhead, Minn. | (AWWA) |
| F. Noce, Division of Water, Cleveland, Ohio | (AWWA) |
| A.T. Segars, Miami-Dade Water and Sewer, Hialeah, Fla. | (AWWA) |

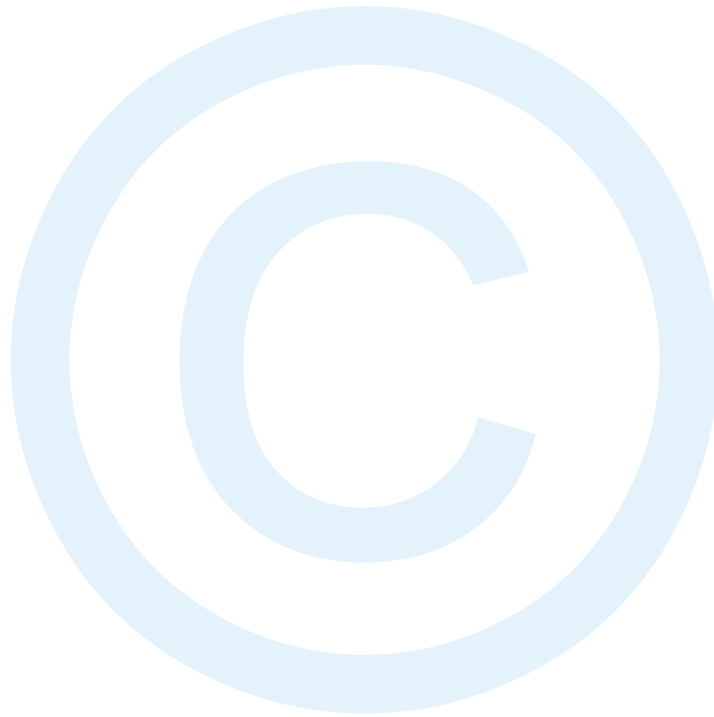


Contents

All AWWA standards follow the general format indicated subsequently. Some variations from this format may be found in a particular standard.

| SEC. | PAGE | SEC. | PAGE |
|-----------------|------------------------------------|-----------------|--|
| Foreword | | 5 | Verification |
| I | vii | 5.1 | Sampling..... 4 |
| I.A | vii | 5.2 | Test Procedures 5 |
| I.B | vii | 5.3 | Acceptance 6 |
| I.C | vii | 5.4 | Notice of Nonconformance 7 |
| II | viii | 6 | Delivery |
| III | viii | 6.1 | Marking 7 |
| III.A | viii | 6.2 | Packaging and Shipping 8 |
| | viii | 6.3 | Affidavit of Compliance 9 |
| III.B | ix | Appendix | |
| IV | ix | A | Tables..... 11 |
| V | ix | Tables | |
| Standard | | A.1 | Aqua-Ammonia Physical Properties 11 |
| 1 | General | A.2 | °Baumé/Specific Gravity/Temperature/ Concentration for Ammonium Hydroxide 13 |
| 1.1 | Scope 1 | A.3 | Corrections to Aqua Ammonia Specific Gravity Readings to Compensate for Sampling Temperature Variations 16 |
| 1.2 | Purpose 1 | A.4 | Corrections to Aqua Ammonia Baumé Readings to Compensate for Sampling Temperature Variations 17 |
| 1.3 | Application..... 1 | | |
| 2 | References 2 | | |
| 3 | Definitions 2 | | |
| 4 | Requirements | | |
| 4.1 | Physical Requirements..... 3 | | |
| 4.2 | Chemical Requirements/Assay..... 3 | | |
| 4.3 | Impurities..... 3 | | |

This page intentionally blank.

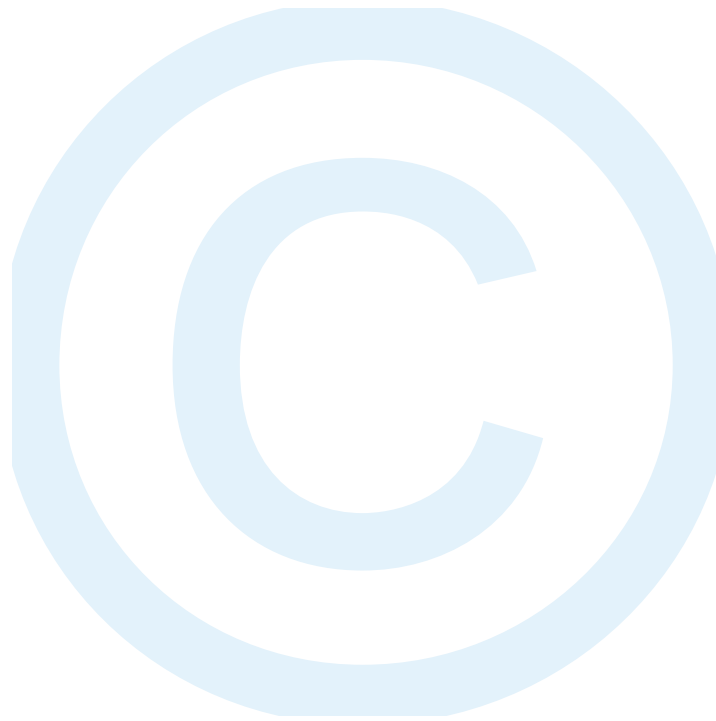

Foreword

This foreword is for information only and is not a part of ANSI/AWWA B306.

I. Introduction.

I.A. *Background.* Aqua ammonia (liquid ammonium hydroxide) is a pungent, colorless liquid at room temperature and atmospheric pressure. Aqua ammonia is a solution produced commercially by reacting anhydrous ammonia with water to form a solution the concentration of which is generally less than 30 percent ammonia by weight. Typical commercial grades include 19 percent and 29 percent; however, users may require other concentrations specific to their needs. In the water industry, aqua ammonia is combined with chlorine to form chloramine.

I.B. *History.* The first edition of ANSI/AWWA B306, Aqua Ammonia, was approved by the AWWA Board of Directors on Jan. 24, 2007. This edition was approved on Jan. 24, 2015.

I.C. *Acceptance.* In May 1985, the US Environmental Protection Agency (USEPA) entered into a cooperative agreement with a consortium led by NSF International (NSF) to develop voluntary third-party consensus standards and a certification program for direct and indirect drinking water additives. Other members of the original consortium included the Water Research Foundation[†] (formerly AwwaRF) and the Conference of State Health and Environmental Managers (COSHEM). The American Water Works Association (AWWA) and the Association of State Drinking Water Administrators (ASDWA) joined later.

In the United States, authority to regulate products for use in, or in contact with, drinking water rests with individual states.[‡] Local agencies may choose to impose requirements more stringent than those required by the state. To evaluate the health effects of products and drinking water additives from such products, state and local agencies may use various references, including two standards developed under the direction of NSF[§]: NSF/ANSI 60, Drinking Water Treatment Chemicals—Health Effects, and NSF/ANSI 61, Drinking Water System Components—Health Effects.

Various certification organizations may be involved in certifying products in accordance with NSF/ANSI 60. Individual states or local agencies have authority to accept

* American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

† Water Research Foundation, 6666 West Quincy Avenue, Denver, CO 80235.

‡ Persons outside the United States should contact the appropriate authority having jurisdiction.

§ NSF International, 789 North Dixboro Road, Ann Arbor, MI 48105.

or accredit certification organizations within their jurisdictions. Accreditation of certification organizations may vary from jurisdiction to jurisdiction.

Annex A, "Toxicology Review and Evaluation Procedures," to NSF/ANSI 60 does not stipulate a maximum allowable level (MAL) of a contaminant for substances not regulated by a USEPA final maximum contaminant level (MCL). The MALs of an unspecified list of "unregulated contaminants" are based on toxicity testing guidelines (noncarcinogens) and risk characterization methodology (carcinogens). Use of Annex A procedures may not always be identical, depending on the certifier.

ANSI/AWWA B306 addresses additives requirements in Sec. 4.3.4 of the standard. The transfer of contaminants from chemicals to processed water or to residual solids is becoming a problem of great concern. The language in Sec. 4.3.4 is a recommendation only for direct additives used in the treatment of potable water to be certified by an accredited certification organization in accordance with NSF/ANSI 60, Drinking Water Treatment Chemicals—Health Effects. However, users of the standard may opt to make this certification a requirement for the product. Users of this standard should also consult the appropriate state or local agency having jurisdiction in order to

1. Determine additives requirements, including applicable standards.
2. Determine the status of certifications by parties offering to certify products for contact with, or treatment of, drinking water.

3. Determine current information on product certification.

II. Special Issues. This standard has no applicable information for this section.

III. Use of This Standard. It is the responsibility of the user of an AWWA standard to determine that the products described in that standard are suitable for use in the particular application being considered.

III.A. *Purchaser Options and Alternatives.* The following information should be provided by the purchaser:

1. Standard used—that is, ANSI/AWWA B306, Aqua Ammonia, of latest revision.

2. Whether compliance with NSF/ANSI 60, Drinking Water Treatment Chemicals—Health Effects, is required.

3. Size and type of bulk storage container to be used and details on transfer equipment available for receiving bulk shipments. If bulk storage is not used, state required container sizes.

4. Details of other federal, state or provincial, and local requirements (Section 4).

5. Physical form(s) and quantity (Sec. 4.1).

6. Tolerances allowed for concentrations (Sec. 4.2).
7. Specific maximum impurity content limits, if required (Sec. 4.3).

8. Whether the purchaser will reject product from containers or packaging with missing or damaged seals. The purchaser may reject product from bulk containers or packages with missing or damaged seals unless the purchaser's tests of representative samples, conducted in accordance with Sec. 5.1 and Sec. 5.2, demonstrate that the product meets the standard. Failure to meet the standard or absence of, or irregularities in, seals may be sufficient cause to reject a shipment.

9. Whether alternative security measures have been adopted to replace or augment the security measures set out in Sec. 6.2.4 and 6.2.5.

10. An affidavit of compliance or certified analysis or both, if required (Sec. 6.3).


III.B. *Modification to Standard.* Any modification to the provisions, definitions, or terminology in this standard must be provided by the purchaser.

IV. Major Revisions. Major changes made to the standard in this revision include the following:

1. Inclusion of the use of this material for wastewater and reclaimed water as well as definitions of these terms (Sections 1 and 3).
2. Inclusion of a requirement for compliance with the Safe Drinking Water Act and other federal regulations (Section 4).
3. Inclusion of guidance for rejection of the material and concentration variation (Sec. 5.3 and 5.4).
4. Inclusion of a requirement for tamper-evident packaging (Sec. 6.2.4 and 6.2.5).

V. Comments. If you have any comments or questions about this standard, please call AWWA Engineering and Technical Services at 303.794.7711, FAX at 303.795.7603; write to the department at 6666 West Quincy Avenue, Denver, CO 80235-3098; or email at standards@awwa.org.

This page intentionally blank.

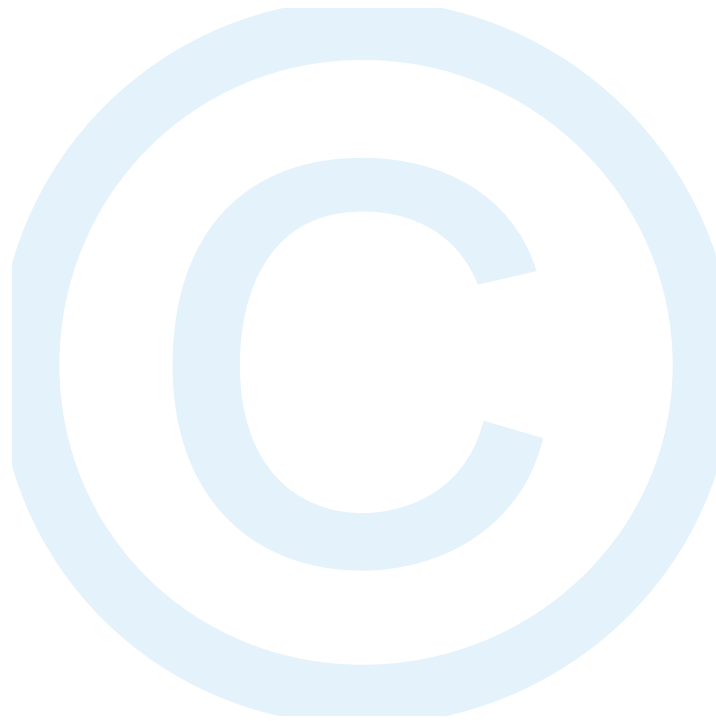



**American Water Works
Association**

Dedicated to the World's Most Important Resource®

ANSI/AWWA B306-15
(Revision of ANSI/AWWA B306-07)

AWWA Standard

Aqua Ammonia (Liquid Ammonium Hydroxide)

SECTION 1: GENERAL

Sec. 1.1 Scope

This standard describes aqua ammonia (liquid ammonium hydroxide) for use in the treatment of potable water, wastewater, or reclaimed water.

Sec. 1.2 Purpose

The purpose of this standard is to provide the minimum requirements for aqua ammonia, including physical, chemical, sampling, packaging, shipping, and testing requirements.

Sec. 1.3 Application

This standard can be referenced in documents for purchasing and receiving aqua ammonia and can be used as a guide for testing the physical and chemical properties of aqua ammonia samples. The stipulations of this standard apply when this document has been referenced and then only to aqua ammonia used in the treatment of potable water, wastewater, or reclaimed water.