



**American Water Works
Association**

ANSI/AWWA C530-12
(Revision of ANSI/AWWA C530-07)

The Authoritative Resource on Safe Water®

AWWA Standard

Pilot-Operated Control Valves



Effective date: Dec. 1, 2012.

First edition approved by AWWA Board of Directors June 24, 2007.

This edition approved June 10, 2012.

Approved by American National Standards Institute Sept. 17, 2012.

6666 West Quincy Avenue
Denver, CO 80235-3098
T 800.926.7337
www.awwa.org

Advocacy
Communications
Conferences
Education and Training
Science and Technology
Sections

AWWA Standard

This document is an American Water Works Association (AWWA) standard. It is not a specification. AWWA standards describe minimum requirements and do not contain all of the engineering and administrative information normally contained in specifications. The AWWA standards usually contain options that must be evaluated by the user of the standard. Until each optional feature is specified by the user, the product or service is not fully defined. AWWA publication of a standard does not constitute endorsement of any product or product type, nor does AWWA test, certify, or approve any product. The use of AWWA standards is entirely voluntary. This standard does not supersede or take precedence over or displace any applicable law, regulation, or codes of any governmental authority. AWWA standards are intended to represent a consensus of the water supply industry that the product described will provide satisfactory service. When AWWA revises or withdraws this standard, an official notice of action will be placed on the first page of the Official Notice section of *Journal - American Water Works Association*. The action becomes effective on the first day of the month following the month of *Journal - American Water Works Association* publication of the official notice.

American National Standard

An American National Standard implies a consensus of those substantially concerned with its scope and provisions. An American National Standard is intended as a guide to aid the manufacturer, the consumer, and the general public. The existence of an American National Standard does not in any respect preclude anyone, whether that person has approved the standard or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standard. American National Standards are subject to periodic review, and users are cautioned to obtain the latest editions. Producers of goods made in conformity with an American National Standard are encouraged to state on their own responsibility in advertising and promotional materials or on tags or labels that the goods are produced in conformity with particular American National Standards.

CAUTION NOTICE: The American National Standards Institute (ANSI) approval date on the front cover of this standard indicates completion of the ANSI approval process. This American National Standard may be revised or withdrawn at any time. ANSI procedures require that action be taken to reaffirm, revise, or withdraw this standard no later than five years from the date of ANSI approval. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036; (212) 642-4900, or emailing info@ansi.org.

ISBN-13, print: 978-1-58321-905-8
ISBN-10, print: 1-58321-905-6

eISBN-13, electronic: 978-1-61300-200-1
eISBN-10, electronic: 1-61300-200-9

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopy, recording, or any information or retrieval system, except in the form of brief excerpts or quotations for review purposes, without the written permission of the publisher.

Copyright © 2012 by American Water Works Association
Printed in USA

Committee Personnel

The AWWA Standards Committee on Pilot-Operated Control Valves, which reviewed and approved this standard, had the following personnel at the time:

Amzad Ali, Chair

Fred Fuller, Vice Chair

General Interest Members

A. Ali, Greater Vancouver Water District, Burnaby, B.C., Canada	(AWWA)
M.L. Altland, Hatch Mott Macdonald, Millburn, N.J.	(AWWA)
F.H. Hanson, Albert A. Webb Assoc., Riverside, Calif.	(AWWA)
E.M. Norum, California State University Center for Irrigation Technology, Fresno, Calif.	(AWWA)
T.J. McCandless,* Standards Engineer Staff Advisor, AWWA, Denver, Colo.	(AWWA)
D. Rhodes, Dayton & Knight Ltd., Vancouver, B.C., Canada	(AWWA)
R.M. Schwecke, HDR Engineering Inc., Phoenix, Ariz.	(AWWA)
J. Vorheis, CH2M HILL, San Antonio, Texas	(AWWA)
R.A. Waggenspack, Owen & White Inc., Baton Rouge, La.	(AWWA)

Producer Members


B. Andersson, Flomatic Corp., Glen Falls, N.Y.	(AWWA)
B. Clarke, Singer Valve Inc., Surrey B.C., Canada	(AWWA)
B. Gardner, Bermad Control Valves Inc., Houston, Texas	(AWWA)
S.D. Jernigan, OCV Control Valves, Tulsa, Okla.	(AWWA)
W.J. Nicholl, GA Industries Inc., Cranberry Township, Pa.	(AWWA)
V. Roberts, Cla-Val, Newport Beach, Calif.	(AWWA)
A. Ross, Ross Valve Manufacturing Company Inc., Troy, N.Y.	(AWWA)

User Members

G. Baptist, Calgary Waterworks, Calgary, Alta., Canada	(AWWA)
T.M. Curry, Laurel, Md.	(AWWA)
M.H. Johnson, Massachusetts Water Resources Authority, Reading, Mass.	(AWWA)

* Liaison, nonvoting

D. Larson* Standards Council Liaison, Jefferson County, Barnhart, Mo.	(AWWA)
N.R. Kochan, Onondaga County Water Authority, Syracuse, N.Y.	(AWWA)
D.C. Stone, Denver Water, Denver, Colo.	(AWWA)
J.V. Young, City of Richmond, Richmond, B.C., Canada	(AWWA)

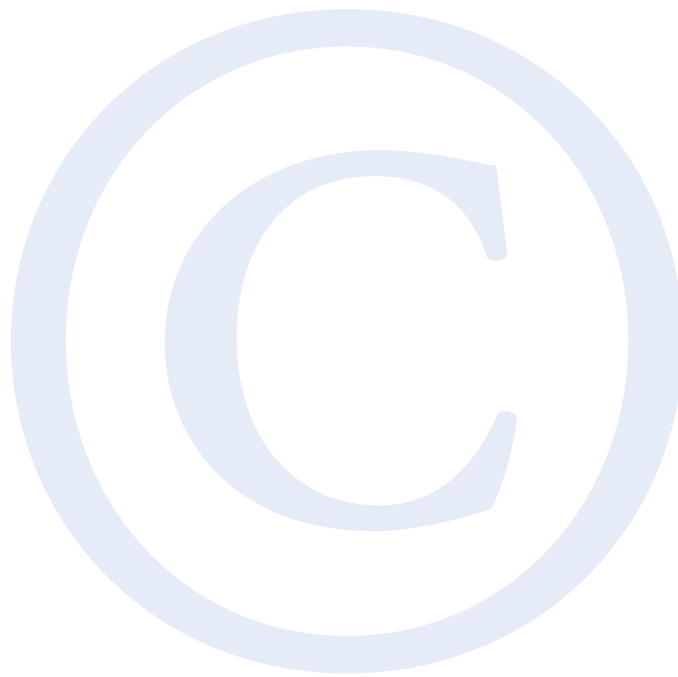

* Alternate

Contents

All AWWA standards follow the general format indicated subsequently. Some variations from this format may be found in a particular standard.

SEC.	PAGE	SEC.	PAGE
Foreword		3	Definitions3
I	Introduction.....vii	4	Requirements
I.A	Background.....vii	4.1	Data Provided by Manufacturer5
I.B	History.....vii	4.2	Materials6
I.C	Acceptance.....vii	4.3	General Design7
II	Special Issues.....viii	4.4	Workmanship and Painting..... 11
III	Use of This Standardix	4.5	Permeation 11
III.A	Purchaser Options and Alternativesix	5	Verification
III.B	Laying Length.....x	5.1	Inspection 12
III.C	Performance Test.....x	5.2	Testing 12
III.D	Valve Test Media.....xi	5.3	Notice of Nonconformance 13
III.E	Modification to Standardxi	6	Delivery
IV	Major Revisions.....xi	6.1	Markings..... 13
V	Commentsxi	6.2	Shipping..... 13
		6.3	Affidavit of Compliance 14
Standard		Appendix	
1	General	A	Installation, Operation, and Maintenance Pilot-Operated Control Valves..... 15
1.1	Scope1		
1.2	Purpose2		
1.3	Application.....2		
2	References2		

This page intentionally blank.



Foreword

*This foreword is for information only and is not a part of ANSI*AWWA C530.*

I. Introduction.

I.A. *Background.* Pilot-operated control valves have been in use since the early 1900s in pipelines that carry liquids. Manufacturers of pilot-operated control valves have developed tight-closing, rubber-, and metal-seated products for pipeline use in water distribution and power generation. This standard describes two types of pilot-operated control valves: the piston and diaphragm types. Both pilot-operated control valve types are sold in a globe, wye, or angle body configuration.

Since the late 1940s, pilot-operated control valves have gained increased acceptance for use in water treatment plants, water supply and distribution, and in building heating, ventilation, and air-conditioning (HVAC) applications because they (1) provide tight shutoff, (2) provide for large pressure drops across the valves, (3) are suitable for many functions depending on the pilot system, and (4) are relatively easy to operate and maintain.

I.B. *History.* The need for a standard addressing pilot-operated control valves was recognized by the American Water Works Association (AWWA) in November 2001. A committee was appointed for the task of standardization; at the first inaugural meeting in June 2003, a subcommittee was appointed by the chair to develop a standard. The first edition was approved by the AWWA Board of Directors on June 24, 2007. This edition was approved on June 10, 2012.

I.C. *Acceptance.* In May 1985, the US Environmental Protection Agency (USEPA) entered into a cooperative agreement with a consortium led by NSF International (NSF) to develop voluntary third-party consensus standards and a certification program for direct and indirect drinking water additives. Other members of the original consortium included the Water Research Foundation (formerly AwwaRF) and the Conference of State Health and Environmental Managers (COSHEM). The American Water Works Association and the Association of State Drinking Water Administrators (ASDWA) joined later.

In the United States, authority to regulate products for use in, or in contact with, drinking water rests with individual states.[†] Local agencies may choose to impose

* American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

† Persons outside the United States should contact the appropriate authority having jurisdiction.

requirements more stringent than those required by the state. To evaluate the health effects of products and drinking water additives from such products, state and local agencies may use various references, including

1. An advisory program formerly administered by USEPA, Office of Drinking Water, discontinued on Apr. 7, 1990.
2. Specific policies of the state or local agency.
3. Two standards developed under the direction of the NSF, NSF*/ANSI 60, Drinking Water Treatment Chemicals—Health Effects, and NSF/ANSI 61, Drinking Water System Components—Health Effects.
4. Other references, including AWWA standards, *Food Chemicals Codex*, *Water Chemicals Codex*,[†] and other standards considered appropriate by the state or local agency.

Various certification organizations may be involved in certifying products in accordance with NSF/ANSI 61. Individual states or local agencies have authority to accept or accredit certification organizations within their jurisdiction. Accreditation of certification organizations may vary from jurisdiction to jurisdiction.

Annex A, Toxicology Review and Evaluation Procedures, of NSF/ANSI 61 does not stipulate a maximum allowable level (MAL) of a contaminant for substances not regulated by a USEPA final maximum contaminant level (MCL). The MALs of an unspecified list of unregulated contaminants are based on toxicity testing guidelines (noncarcinogens) and risk characterization methodology (carcinogens). Use of Annex A procedures may not always be identical, depending on the certifier.

ANSI/AWWA C530 does not address additive requirements. Users of this standard should consult the appropriate state or local agency having jurisdiction in order to

1. Determine additive requirements, including applicable standards.
2. Determine the status of certification by parties offering to certify products for contact with, or treatment of, drinking water.
3. Determine current information on product certification.

II. Special Issues. Conditions under which the pilot-operated control valve is to be operated must be evaluated carefully by the purchaser. This evaluation must include determination of the hydraulic characteristics of the system in which the valve will be installed and the pilot devices required for operation of the valve, including (1) maximum and static differential pressures across the valve and (2) the range of

* NSF International, 789 N. Dixboro Road, Ann Arbor, MI 48113.

† Both publications available from National Academy of Sciences, 500 Fifth Street, NW, Washington, DC 20001.

flow rates through the valve under the most adverse operating conditions. Velocities exceeding 15 ft/sec (4.6 m/sec) should be discussed with the manufacturer. When selecting a type of valve, it must be noted that there are various types of control valves with different combinations of pilots and actuation mechanisms.

III. Use of This Standard. It is the responsibility of the user of an AWWA standard to determine that the products described in that standard are suitable for use in the particular application being considered.

III.A. *Purchaser Options and Alternatives.* The following information should be provided by the purchaser.

1. Standard used, that is, the latest revision of ANSI/AWWA C530, Pilot-Operated Control Valves.

2. Whether compliance with NSF/ANSI 61, Drinking Water System Components—Health Effects, is required.

3. Size of valve.

4. Quantity required.

5. Maximum nonshock inlet pressure.

6. Minimum and maximum pressure drop across the seat.

7. Maximum head loss, if required.

8. Maximum transient pressure and characteristics, if known.

9. Requirements for anticavitation trim material.

10. State special devices or features, if required, including number and location of isolation valves for pilot lines, type of pilot filter element, open–close time speed control requirements, position indication, remote control devices, remote and externally mounted three-position control switches (open–close–auto), pressure gauges, and/or pressure transmitters on inlet and outlet flange taps.

11. Consideration relating to anticipated problems with rubber components exposed to line content containing chlorine, chloramines, or other chemicals. If these problems are anticipated, the purchaser should identify the maximum expected concentrations of these chemicals and other factors, such as pH and temperature ranges, that may affect the corrosivity of these chemicals. The purchaser should consult with the manufacturer and, if appropriate, specify special requirements for these components.

12. Required rate of flow for normal flow conditions and for minimum and maximum flow conditions (Sec. 1.1).

13. Body style (globe, wye, or angle) (Sec. 1.1.1).

14. Flow port area (nominal diameter or reduced port) (Sec. 3.0).

15. Certified drawings to be provided by the manufacturer (Sec. 4.1.1).

16. Laying length dimension (Sec. 4.1.1.1).
17. Maximum height from valve centerline to position indicators, including on-site dismantling height requirements (Sec. 4.1.1.1).
18. Maximum space width, including control piping (Sec. 4.1.1.1).
19. Application and pilot type (Sec. 4.1.1.2).
20. Type of pilot-operated control valve, whether diaphragm or piston (Sec. 4.1.1.2).
21. Additional information for remote operation, such as position transmitters, variable pressure control pilots, limit switches, and/or other configurations (Sec. 4.1.1.2).
22. Installation, operation, and maintenance manual requirements (Sec. 4.1.3).
23. Details of other federal, state or provincial, and local requirements (Sec. 4.2.1).
24. Seat and body material (Sec. 4.2.2).
25. Type of material for pilot lines (stainless steel, copper, or other preferred material) (Sec. 4.2.2).
26. Type of end connection, flanged, groove-joint, or National Pipe Thread (NPT) (Sec. 4.3.4).
27. Body flange class (cast iron class 125 and/or class 250 in accordance with ASME B16.1 and ductile iron class 150, class 250 in accordance with ASME B16.42, or steel class 150 or class 300 in accordance with ASME B 16.5) (Sec. 4.3.4.1).
28. Specify flange bolt hole drilling pattern class if different from a recognized ANSI pressure class (Sec. 4.3.4.1).
29. Shop inspection by the purchaser, if required (Sec. 5.1.1).
30. Requirement for an affidavit of compliance (Sec. 6.3).

III.B. *Laying Length.* Pilot-operated control valves do not have uniform laying lengths. Interchangeability between various manufacturers may not be possible without modification to the existing piping system. The purchaser is cautioned to obtain this information from the manufacturers for verification prior to purchase.

III.C. *Performance Test.* This standard does not require the manufacturer to conduct the performance test on a fully assembled valve. Sec. 5.2 allows the manufacturer to conduct the tests separately on the main valve and the related pilots. If the purchaser desires the performance test to be conducted on the fully assembled valve, this requirement should be specified in the purchase documents.

III.D. *Valve Test Media.* The purchaser should review Sec. 5.2.1 of this standard and inform the supplier of the preferred valve test media. The standard allows testing valves with air at 90 psi and water at 1.5 times the rated design pressure of the valve.


III.E. *Modification to Standard.* Any modification of the provisions, definitions, or terminology in this standard must be provided by the purchaser.

IV. Major Revisions. Major changes made to the standard in this revision include the following:

1. Manufacturer is required to deliver installation, operation, and maintenance manuals (Sec. 4.1.3).
2. Materials shall comply with regulations for potable water, wastewater, and reclaimed water systems as applicable (Sec. 4.2.1).
3. Elastomers are included under physical and chemical requirements (Sec. 4.2.2).
4. Changes to flange requirements (Sec. 4.3.4.1).
5. Changes to disc retainer material requirements (Sec. 4.3.7.1.4).
6. Model number and serial number were added to the marking requirements (Sec. 6.1).

V. Comments. If you have any comments or questions about this standard, please call AWWA Engineering and Technical Services at 303.794.7711, FAX at 303.795.7603, write to the department at 6666 West Quincy Avenue, Denver, CO 80235-3098, or email at standards@awwa.org.

This page intentionally blank.

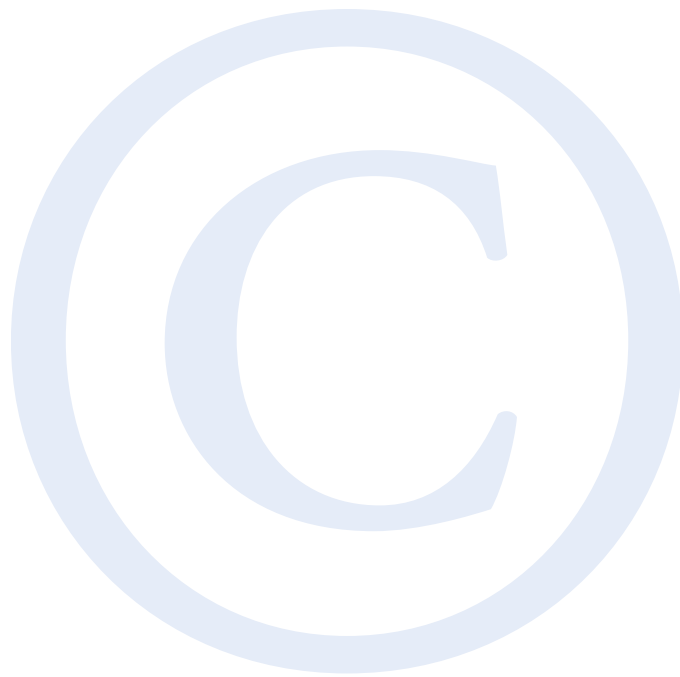



**American Water Works
Association**

AWWA Standard

Pilot-Operated Control Valves

SECTION 1: GENERAL

Sec. 1.1 Scope

This standard establishes minimum requirements for pilot-operated control valves of globe, angle and wye body styles with various end connections in sizes from 1½ in. through 60 in. (375 mm through 1,500 mm) in diameter, with water having a pH range from 6 to 9 and a temperature range from 40° to 125° F (4.4° to 52°C). The standard covers piston- and diaphragm-type valves suitable for a maximum steady-state fluid working pressure of 300 psig (2,070 kPa), a maximum steady-state differential pressure of 300 psig (2,070 kPa), and a maximum line velocity of 15 ft/sec (4.6 m/sec).

1.1.1 *Body type and class.* The valves described in this standard are provided in three body types (globe, angle, and wye) with various pilot-operating methods in pressure classes described as follows:

1.1.1.1 Angle body type: Class 125, 150, 250, and 300, ASME flanges, National Pipe Thread (NPT) and grooved joint ends in sizes 1½ in. to 60 in. (375 mm to 1,500 mm).

1.1.1.2 Globe body type: Class 125, 150, 250, and 300, ASME flanges, NPT and grooved joint ends in sizes 1½ in. to 60 in. (375 mm to 1,500 mm).

1.1.1.3 Wye body type: Class 125, 150, 250, and 300; ASME flanges, NPT and grooved joint ends in sizes 1½ in. to 60 in. (375 mm to 1,500 mm).