



**American Water Works  
Association**

ANSI/AWWA C701-12  
(Revision of ANSI/AWWA C701-07)

The Authoritative Resource on Safe Water®

---

---

*AWWA Standard*

---

---

# Cold-Water Meters— Turbine Type, for Customer Service



Effective date: March 1, 2012.

First edition approved by AWWA Board of Directors May 24, 1923.

This edition approved Jan. 22, 2012.

Approved by American National Standards Institute Nov. 30, 2011.

---

---

6666 West Quincy Avenue  
Denver, CO 80235-3098  
T 800.926.7337  
www.awwa.org

Advocacy  
Communications  
Conferences  
Education and Training  
Science and Technology  
Sections

## **AWWA Standard**

This document is an American Water Works Association (AWWA) standard. It is not a specification. AWWA standards describe minimum requirements and do not contain all of the engineering and administrative information normally contained in specifications. The AWWA standards usually contain options that must be evaluated by the user of the standard. Until each optional feature is specified by the user, the product or service is not fully defined. AWWA publication of a standard does not constitute endorsement of any product or product type, nor does AWWA test, certify, or approve any product. The use of AWWA standards is entirely voluntary. This standard does not supersede or take precedence over or displace any applicable law, regulation, or codes of any governmental authority. AWWA standards are intended to represent a consensus of the water supply industry that the product described will provide satisfactory service. When AWWA revises or withdraws this standard, an official notice of action will be placed in the official notice section of *Journal - American Water Works Association*. The action becomes effective on the first day of the month following the month of *Journal - American Water Works Association* publication of the official notice.

## **American National Standard**

An American National Standard implies a consensus of those substantially concerned with its scope and provisions. An American National Standard is intended as a guide to aid the manufacturer, the consumer, and the general public. The existence of an American National Standard does not in any respect preclude anyone, whether that person has approved the standard or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standard. American National Standards are subject to periodic review, and users are cautioned to obtain the latest editions. Producers of goods made in conformity with an American National Standard are encouraged to state on their own responsibility in advertising and promotional materials or on tags or labels that the goods are produced in conformity with particular American National Standards.

CAUTION NOTICE: The American National Standards Institute (ANSI) approval date on the front cover of this standard indicates completion of the ANSI approval process. This American National Standard may be revised or withdrawn at any time. ANSI procedures require that action be taken to reaffirm, revise, or withdraw this standard no later than five years from the date of publication. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036; (212) 642-4900, or e-mailing [info@ansi.org](mailto:info@ansi.org).

---

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopy, recording, or any information or retrieval system, except in the form of brief excerpts or quotations for review purposes, without the written permission of the publisher.

Copyright © 2012 by American Water Works Association  
Printed in USA

## Committee Personnel

The AWWA Subcommittee on Current-Type Meters, which developed this standard, had the following personnel at the time:

Donald J. Kullmann, *Chair*

S. Bartram, Elster AMCO Water Inc., Ocala, Fla.	(AWWA)
T.D. Bianchi, Neptune Technology Group Inc., Tallassee, Ala.	(AWWA)
M.C. Bowen, City of Columbus, Division of Water, Columbus, Ohio	(AWWA)
S. Bruneau, Master Meter Inc., Mansfield, Texas	(AWWA)
T. Butler, Itron, Silver Springs, Fla.	(AWWA)
M.D. Cole, Infinity Metering Company, Ocala, Fla.	(AWWA)
G.H. De Jarlais, Badger Meter Inc., Milwaukee, Wis.	(AWWA)
A. Dudley, Itron, Greenwood, S.C.	(AWWA)
G. Gomez, Badger Meter Inc., Milwaukee, Wis.	(AWWA)
D.E. Hood, M.E. Simpson Company Inc., Valparaiso, Ind.	(AWWA)
J.E. Jackson, Sensus Technologies Inc., Texarkana, Texas	(AWWA)
R.N. Koch, Master Meter Inc., Pittsburgh, Pa.	(AWWA)
D.J. Kullmann, Neptune Technology Group Inc., Marietta, Ga.	(AWWA)
G.G. Land, Dallas Water Utilities, Dallas, Texas	(AWWA)
J. Panek Jr., McCrometer Inc., Rowley, Iowa	(AWWA)
J.A. Reiss, Elster AMCO Water Inc., Ocala, Fla.	(AWWA)
S.M. Swanson, Sensus Technologies Inc., Uniontown, Pa.	(AWWA)

The AWWA Standards Committee on Water Meters, which reviewed and approved this standard, had the following personnel at the time of approval:

Michael J. Kebles, *Chair*

Thomas Gwynn, *Secretary\**

*General Interest Members*

R.C. Graff, Poway, Calif.	(AWWA)
D.E. Hood, M.E. Simpson Company Inc., Valparaiso, Ind.	(AWWA)

---

\* Nonvoting

M.C. Johnson, Utah State University, Logan, Utah	(AWWA)
M.J. Kebles, Water Industry Consultant, Las Vegas, Nev.	(AWWA)
F.S. Kurtz,* Standards Engineer Liaison, AWWA, Denver, Colo.	(AWWA)
R.A. Richter, National Institute of Standards and Technology, Gaithersburg, Md.	(AWWA)
F.S. Salser Jr., Floyd S. Salser Jr. & Associates Mars Company, Ocala, Fla.	(AWWA)
R. San Giacomo, R & D Engineering P.C., Orchard Park, N.Y.	(AWWA)
J.A. Welsh, Measurement Canada, Ottawa, Ont.	(AWWA)

*Producer Members*

S. Bartram,† Elster AMCO Water Inc., Ocala, Fla.	(AWWA)
T.D. Bianchi,† Neptune Technology Group Inc., Tallassee, Ala.	(AWWA)
T. Butler, Itron, Silver Springs, Fla.	(AWWA)
M.D. Cole, Infinity Metering Company, Ocala, Fla.	(AWWA)
G.H. De Jarlais,† Badger Meter Inc., Milwaukee, Wis.	(AWWA)
A. Dudley,† Itron, Greenwood, S.C.	(AWWA)
L.W. Fleury Jr., Mueller Group, Smithfield, R.I.	(AWWA)
G. Gomez, Badger Meter Inc., Milwaukee, Wis.	(AWWA)
A. Hendey Sr., Performance Meter Inc., Beaumont, Calif.	(AWWA)
R. Howard,† Performance Meter Inc., Banning, Calif.	(AWWA)
J.E. Jackson,† Sensus Metering Systems, Texarkana, Texas	(AWWA)
R.N. Koch, Master Meter Inc., Pittsburgh, Pa.	(AWWA)
D.J. Kullmann, Neptune Technology Group Inc., Marietta, Ga.	(AWWA)
M. Laird,† Metron-Farnier LLC, Boulder, Colo.	(AWWA)
J. Panek Jr.,† McCrometer Inc., Rowley, Iowa	(AWWA)
J. Potter,† Master Meter Inc., Mansfield, Texas	(AWWA)
M. Shamley, Metron-Farnier LLC, Boulder, Colo.	(AWWA)
S.M. Swanson, Sensus Technologies Inc., Uniontown, Pa.	(AWWA)
M.A. Thomas,† Mueller Systems, Cleveland, N.C.	(AWWA)
G.M. Voss, McCrometer Inc., Hemet, Calif.	(AWWA)
A.M. Watson, Elster AMCO Water Inc., Ocala, Fla.	(AWWA)

---

\* Liaison, nonvoting

† Alternate


*User Members*

M.L. Aigen, Boston Water and Sewer Commission, Roxbury, Mass.	(NEWWA)
J. Alongi, Kansas City Water Services Department, Kansas City, Mo.	(AWWA)
M.J. Aragon, Denver Water, Denver, Colo.	(AWWA)
M.C. Bowen, City of Columbus, Division of Water, Columbus, Ohio	(AWWA)
W.F. Dunnill, Consolidated Utility District of Rutherford County, Murfreesboro, Tenn.	(AWWA)
W.M. Garfield, Arizona Water Company, Phoenix, Ariz.	(AWWA)
D. Griffin, City of Winnipeg Water and Waste Department, Winnipeg, Man.	(AWWA)
N.D. Kaufman, Truckee Donner Public Utility District, Truckee, Calif.	(AWWA)
T.A. Kelly Jr., Washington Suburban Sanitary Commission, Laurel, Md.	(AWWA)
M.S. Krause, Desert Water Agency, Palm Springs, Calif.	(AWWA)
G.G. Land, Dallas Water Utilities, Dallas, Texas	(AWWA)
S.U. Mills,* Standards Council Liaison, City of Arlington, Arlington, Texas	(AWWA)
J.A. Novak, Milwaukee Water Works, Milwaukee, Wis.	(AWWA)
G.E. Raymond, Los Angeles Dept. of Water & Power, Los Angeles, Calif.	(AWWA)
S. Solotoff, Miami-Dade Water & Sewer, Miami, Fla.	(AWWA)
J.H. Standi Jr., Golden State Water Company, Fontana, Calif.	(AWWA)

---

\* Liaison, nonvoting

This page intentionally blank.

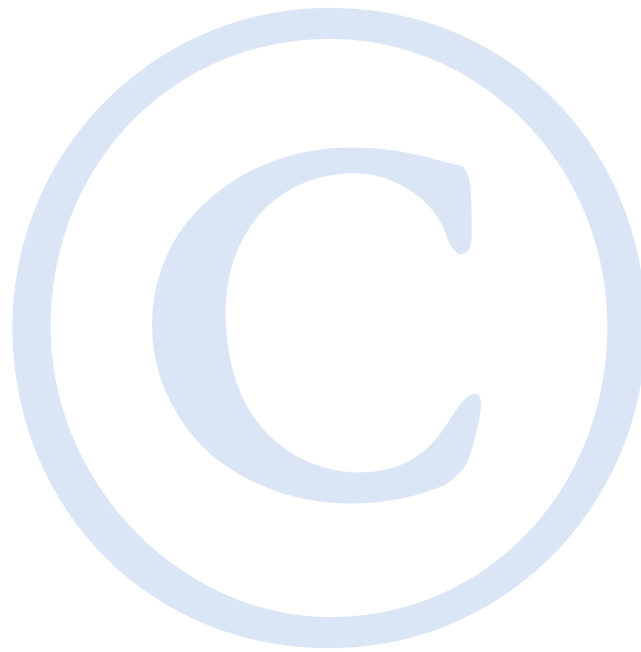


## Contents

*All AWWA standards follow the general format indicated subsequently. Some variations from this format may be found in a particular standard.*

SEC.	PAGE	SEC.	PAGE
<b>Foreword</b>		<b>6 Delivery</b>	
I	ix	6.1	13
I.A	ix	6.2	14
I.B	ix	6.3	14
I.C	x		
II	xi	<b>Appendix</b>	
III	xi	<b>A Supplemental Information</b>	
III.A	xi	A.1	15
	xi	A.2	15
III.B	xii	A.3	15
IV	xii	A.4	17
V	xiii	A.5	17
		A.6	19
		A.7	19
		A.8	20
<b>Standard</b>		<b>Tables</b>	
<b>1 General</b>		1	7
1.1	1	2	8
1.2	1	3	10
1.3	1	4	11
<b>2 References</b>	2	A.1	20
<b>3 Definitions</b>	3		
<b>4 Requirements</b>			
4.1	4		
4.2	6		
4.3	9		
<b>5 Verification</b>			
5.1	13		

This page intentionally blank.

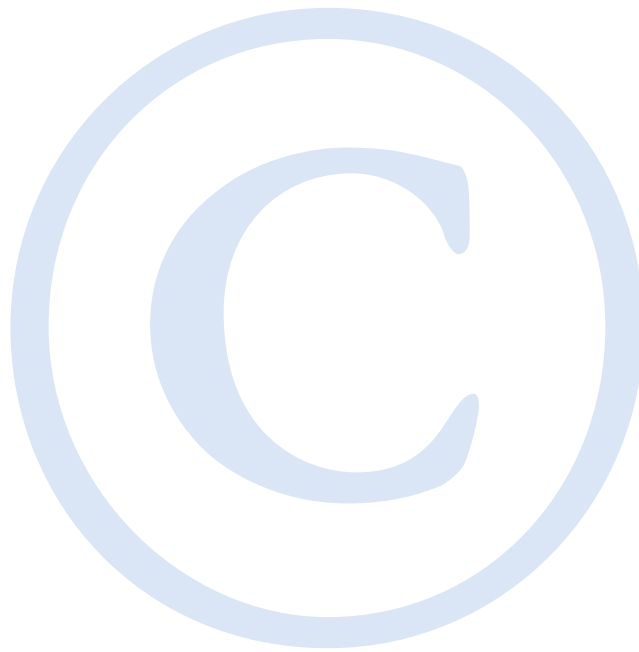

## Foreword

*This foreword is for information only and is not a part of ANSI\*/AWWA C701.*

### **I. Introduction.**

I.A. *Background.* A booklet published in Hamburg, Germany, in 1790 by Benjamin Gottlob Hoffman described a form of current meter developed by Reinhard Woltmann that may be considered the first practical meter for measuring flowing air and water. Originally, it was thought that the meter could not be adapted for use in enclosed pipe. However, through substantial changes in design and construction, the present current meter evolved.

I.B. *History.* The first AWWA standard specifications for water meters of various types were published in 1923. These were revised in later years, and the first standard that dealt solely with current-type meters was approved as tentative on Jan. 14, 1946, with the designation 7M.2-T. It was approved as a standard on July 25, 1947, and given the designation AWWA C701-47, Standard Specifications for Cold-Water Meters—Current Type. The standard was revised in 1970 and designated as ANSI/AWWA C701-70, Standard for Cold-Water Meters—Turbine Type, for Customer Service. It was approved by the AWWA Board of Directors on Jan. 26, 1970. Subsequent editions of C701 were approved on June 30, 1978; June 19, 1988; Jan. 20, 2002; and Jan. 21, 2007. This edition was approved Jan. 22, 2012.

Between 1923 and 1947, the propeller-type current meter was developed for pump-station discharge, irrigation, and main-line measurement. This meter differs from the original design in that it does not use a measuring cage around the turbine. The propeller operates directly within the pipeline itself or within the main meter body. The propeller-type meters had operating characteristics different from current-type meters. These differences led to the development of AWWA C704-50, Standard Specifications for Cold-Water Meters—Current Type, Propeller Driven. This standard was revised in 1970 and designated as ANSI/AWWA C704-70, Standard for Cold-Water Meters—Propeller Type for Main Line Applications. The 1970 version was reaffirmed without revision in 1975 and 1984 and revised in 1992 and 2002.

The 1978 revision of ANSI/AWWA C701 included an added distinction between class I and class II types of turbine meters. Class I meters are those previously covered by ANSI/AWWA C701-70, and class II meters are the newer in-line high-velocity

---

\* American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

type characterized by lower head loss, greater low-flow sensitivity, and tighter accuracy tolerances over a wider flow range. Details of the performance differences are listed in Table 1 of ANSI/AWWA C701.

The 2002 revision of ANSI/AWWA C701 expanded Table 1 for class I meters to show the operating characteristics for low-velocity horizontal-type meters and vertical shaft-type meters separately.

I.C. *Acceptance.* In May 1985, the US Environmental Protection Agency (USEPA) entered into a cooperative agreement with a consortium led by NSF International (NSF) to develop voluntary third-party consensus standards and a certification program for direct and indirect drinking water additives. Other members of the original consortium included the American Water Works Association Research Foundation (AwwaRF, now Water Research Foundation) and the Conference of State Health and Environmental Managers (COSHEM). The American Water Works Association (AWWA) and the Association of State Drinking Water Administrators (ASDWA) joined later.

In the United States, authority to regulate products for use in, or in contact with, drinking water rests with individual states.\* Local agencies may choose to impose requirements more stringent than those required by the state. To evaluate the health effects of products and drinking water additives from such products, state, local, and provincial agencies may use various references, including

1. An advisory program formerly administered by USEPA, Office of Drinking Water discontinued on Apr. 7, 1990.
2. Specific policies of the state or local agency.
3. Two standards developed under the direction of NSF, NSF<sup>†</sup>/ANSI<sup>‡</sup> 60, Drinking Water Treatment Chemicals—Health Effects, and NSF/ANSI 61, Drinking Water System Components—Health Effects.
4. Other references, including AWWA standards, *Food Chemicals Codex*, *Water Chemicals Codex*,<sup>§</sup> and other standards considered appropriate by the state, local, or provincial agency.

Various certification organizations may be involved in certifying products in accordance with NSF/ANSI 61. Individual states or local agencies have authority to accept

---

\* Persons outside the United States should contact the appropriate authority having jurisdiction.

† NSF International, 789 N. Dixboro Road, Ann Arbor, MI 48105.

‡ American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

§ Both publications available from National Academy of Sciences, 500 Fifth Street, N.W., Washington, DC 20001.

or accredit certification organizations within their jurisdiction. Accreditation of certification organizations may vary from jurisdiction to jurisdiction.

Annex A, "Toxicology Review and Evaluation Procedures," to NSF/ANSI 61 does not stipulate a maximum allowable level (MAL) of a contaminant for substances not regulated by a USEPA final maximum contaminant level (MCL). The MALs of an unspecified list of "unregulated contaminants" are based on toxicity testing guidelines (noncarcinogens) and risk characterization methodology (carcinogens). Use of Annex A procedures may not always be identical, depending on the certifier.

In an alternative approach to inadvertent drinking water additives, some jurisdictions (including California, Maryland, and Vermont, at the time of this writing) are calling for reduced lead limits for materials in contact with potable water. Various third-party certifiers have been assessing products against these lead content criteria, and a new ANSI-approved national standard, NSF/ANSI 372, Drinking Water System Components—Lead Content, was published in 2010.

ANSI/AWWA C701 does not address additives requirements. Users of this standard should consult the appropriate state or local agency having jurisdiction in order to

1. Determine additives requirements, including applicable standards.
2. Determine the status of certifications by parties offering to certify products for contact with, or treatment of, drinking water.
3. Determine current information on product certification.

**II. Special Issues.** The meters described in this standard are not designed to be used in water service piping intended to extinguish fire. Requirements for commercial and industrial applications in this regard are contained in ANSI/AWWA C703. Requirements for residential fire service products and combined residential domestic/fire service products are currently being developed as a part of a new ANSI/AWWA water meter standard.

**III. Use of This Standard.** It is the responsibility of the user of an AWWA standard to determine that the products described in that standard are suitable for use in the particular application being considered.

**III.A. Purchaser Options and Alternatives.** The following information should be provided by the purchaser:

1. Standard used—that is ANSI/AWWA C701, Cold-Water Meters—Turbine Type, for Customer Service, of latest revision.
2. Whether compliance with NSF/ANSI 372, Drinking Water System Components—Lead Content, NSF/ANSI 61, Drinking Water System Components—Health Effects, or an alternative lead content criterion is required.

3. If specific warranty provisions will be required.
4. Meter class—class I or class II (Sec. 1.1).
5. Details of other federal, state or provincial, and local requirements (Sec. 4.1).
6. Whether main casings are to be made of copper alloy; cast iron or fabricated steel treated for corrosion resistance; or cast or fabricated stainless steel (Sec. 4.1.2).
7. Whether there is a preference for the materials specified for the various meter components (Sec. 4.1.3 through 4.1.10).
8. Size of meter (Sec. 4.2.1 and Tables 1 and 2) and quantity required.
9. Type of connections for 1½-in. (40-mm) and 2-in. (50-mm) meters, whether couplings (tailpieces) are to be provided on meters with spuds, and whether round or oval flanges are required on flanged meters (Sec. 4.3.3).
10. Whether companion flanges, gaskets, bolts, and nuts (Sec. 4.3.4) are to be provided with flanged meters.
11. Details of register (Sec. 4.3.5) to be provided, including
  - a. unit of measure—US gallons, cubic feet, or cubic meters.
  - b. position—permanently sealed or open.
  - c. test hand—with or without sweep test hand.
  - d. register type—mechanical display type or electronic display type.
12. Whether a direct-reading remote register or an encoder-type register is required, including specification details (Sec. 4.3.6).
13. Whether an affidavit of compliance (Sec. 6.3) and certificate of testing for accuracy (Sec. A.3.3) are required.
14. Special materials required, if any, to resist corrosion if water is highly aggressive (Sec. A.5.3).

III.B. *Modification to Standard.* Any modification to the provisions, definitions, or terminology in this standard must be provided by the purchaser.

**IV. Major Revisions.** The major revisions to the standard in this edition include the following:


1. Class I meters of the low-velocity, horizontal type are no longer addressed in the standard.
2. Foreword Sec. I.C provides information on lead content criteria and the new NSF/ANSI Standard 372, Drinking Water System Components—Lead Content.
3. Foreword Sec. II cites that the meters described in this standard are not designed to be used in water service piping intended to extinguish fire. The requirements for residential fire service-type meters are not addressed in this standard.

4. Sec. 4.1.2, Meter and strainer main casing, provides for cast or fabricated austenitic stainless steel as listed in ASTM A276.


5. Sec. 4.3.5.2, Electronic display registers, has been expanded to include more comprehensive language and greater details on the requirements for electronic display registers.

6. Editorial clarifications have been provided throughout the standard.

**V. Comments.** If you have any comments or questions about this standard, please call AWWA Engineering and Technical Services at 303.794.7711, FAX at 303.795.7603, write to the department at 6666 West Quincy Avenue, Denver, CO 80235-3098, or e-mail at [standards@awwa.org](mailto:standards@awwa.org).

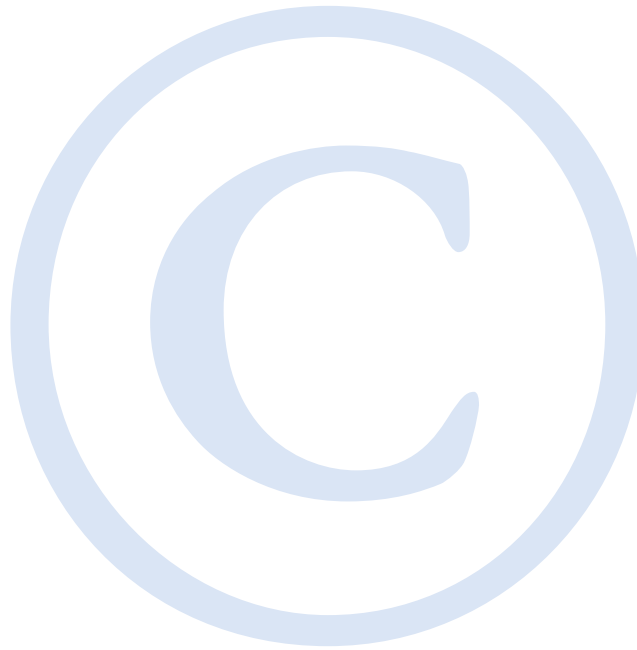

This page intentionally blank.

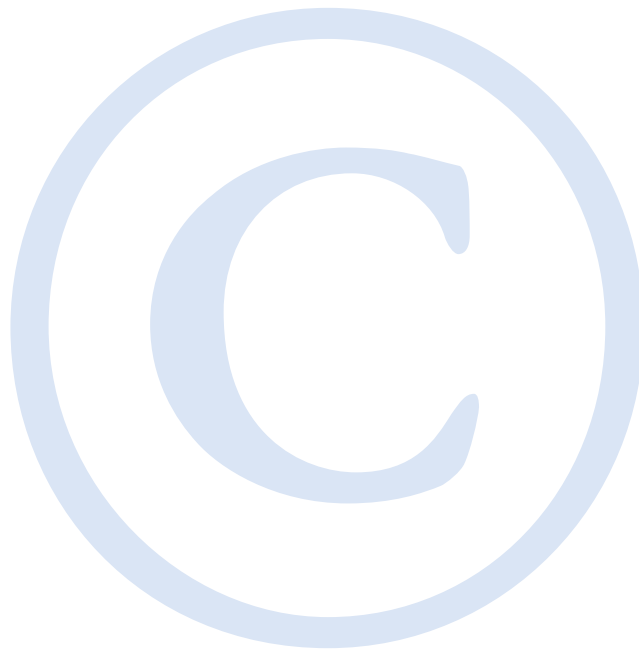



**American Water Works  
Association**

---

---

*AWWA Standard*

---

---

# **Cold-Water Meters—Turbine Type, for Customer Service**

---

## **SECTION 1: GENERAL**

---

### **Sec. 1.1 Scope**

This standard describes the various classes of cold-water turbine meters in sizes  $\frac{3}{4}$  in. (20 mm) through 20 in. (500 mm) for water supply customer service, mainline metering, and custody transfer of water among purveyors, and the materials and workmanship employed in their fabrication. The turbine meters described in this standard are divided into class I and class II meters. Both classes of meters register by recording the revolutions of a turbine set in motion by the force of flowing water striking its blades.

Class I meters are the vertical-shaft models. Class II meters are the in-line, horizontal-axis, high-velocity-type turbines characterized by lower head loss and a wider normal operating flow range than class I models.

### **Sec. 1.2 Purpose**

The purpose of this standard is to provide the minimum requirements for cold-water, turbine-type meters, including materials and design.

### **Sec. 1.3 Application**

This standard can be referenced in specifications for purchasing and receiving cold-water, turbine-type meters and can be used for manufacturing this type of