

ANSI/IICRC **S520**


ANSI/IICRC S520-2015

STANDARD FOR PROFESSIONAL MOLD REMEDIATION

Third Edition



IICRC
Institute of Inspection Cleaning
and Restoration Certification

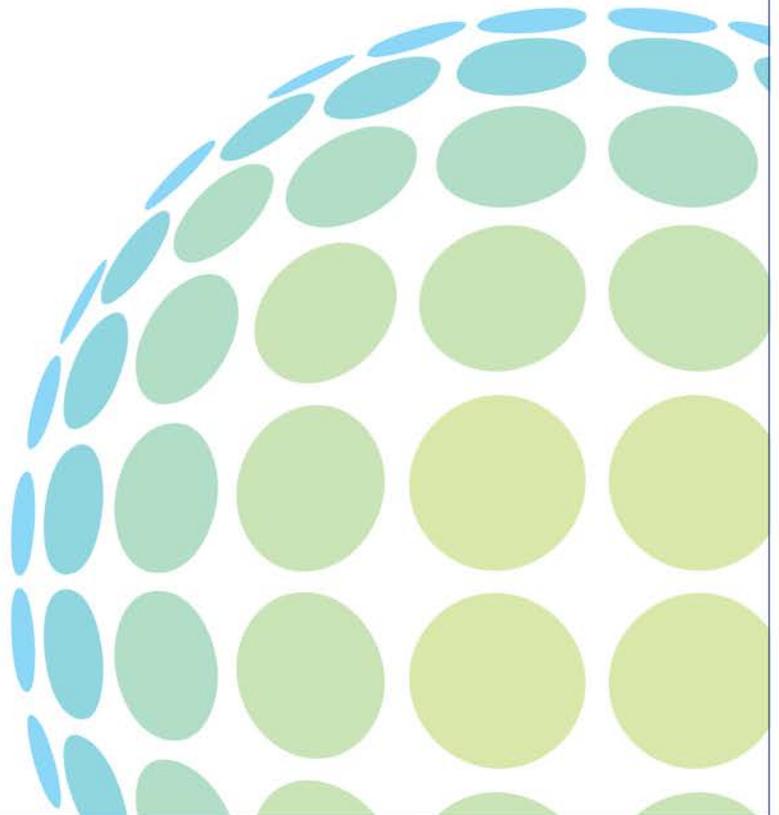

ANSI/IICRC S520

Standard for Professional Mold Remediation

Third Edition

Published December 2015

Institute of Inspection, Cleaning and Restoration Certification
4043 South Eastern Avenue
Las Vegas, NV, 89119 USA
(775) 553 5458 • www.iicrc.org

Copyright © 2015, 2008, 2003 by the Institute of Inspection, Cleaning and Restoration Certification (IICRC). All rights reserved. No part of this publication may be used or reproduced in any manner whatsoever without written permission from the IICRC.

Printed in the United States of America

Disclaimer

The Institute of Inspection, Cleaning and Restoration Certification S520 Standard for Professional Mold Remediation (referred to as the "Standard" or the "S520") is intended to provide information about the remediation of mold contaminated structures, systems and contents and to assist individuals and entities working in the mold remediation industry in establishing and maintaining their professional competence. Users of this document should stay updated and informed about developments in the field of mold remediation, implement changes in technology and procedures as appropriate, as well as follow applicable federal, state, provincial and local laws and regulations. Since every mold remediation project is unique, in certain circumstances, common sense, experience and professional judgment may justify a deviation from this Standard. Furthermore, this Standard is not intended to be either exhaustive or inclusive of all pertinent requirements, methods or procedures that might be appropriate on a particular mold remediation project. The information upon which this Standard is based is subject to change, which may invalidate any or all of the information contained herein.

This Standard was developed through a consensus standard development process, which brought together volunteers representing varied viewpoints and interests to achieve consensus on mold remediation issues. While the Institute of Inspection, Cleaning and Restoration Certification (IICRC) administers the process and establishes policies, procedures and guidelines to promote fairness in the development of consensus, it does not independently test, evaluate or verify the accuracy of any information or the soundness of any judgments contained in this Standard.

The IICRC, and all S520 consensus body members, contributors, and editorial consultants (hereinafter collectively referred to as the "IICRC") expressly disclaims, and shall not be liable for any and all damages of any nature whatsoever, whether direct or indirect, arising from or relating to the publication, use of or reliance on the information contained in this Standard, including without limitation, any and all special, incidental, compensatory, consequential, punitive or other damages (including damages for personal injury or bodily injury, property damage, loss of business, loss of profits, litigation or the like), whether based upon breach of contract, breach of warranty, tort (including negligence and gross negligence), product liability or otherwise, even if advised of the possibility of such damages. The foregoing negation of damages is a fundamental condition of the use of the information contained in this Standard and this document would not be published without such limitations.

While the information contained within this Standard is provided in good faith and is believed to be reliable, the IICRC makes no representations, warranties or guarantees as to the accuracy or completeness of any information contained in this Standard, or that following this Standard will result in compliance with any applicable laws, rules or regulations, or in safe, satisfactory or complete performance of a mold remediation project. ALL WARRANTIES, EXPRESS OR IMPLIED, ARE DISCLAIMED, INCLUDING WITHOUT LIMITATION, ANY AND ALL WARRANTIES CONCERNING THE ACCURACY OR COMPLETENESS OF THE INFORMATION, ITS FITNESS OR APPROPRIATENESS FOR A PARTICULAR PURPOSE OR USE, ITS MERCHANTABILITY, ITS NON-INFRINGEMENT OF ANY INTELLECTUAL PROPERTY RIGHTS, OR ANY OTHER MATTER.

In publishing this document, the IICRC is not undertaking to render scientific, professional, medical, legal or other advice or services for, or on behalf of, any person or entity, or to perform any duty owed by any person or entity to someone else. Any and all use of or reliance upon this Standard is at the user's own discretion and risk. Anyone using this document should understand the limitations with the use of this document, and rely on his or her own independent judgment, or as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given situation.

The IICRC has no power, nor does it undertake, to police or enforce compliance with the contents of this document. The IICRC does not list, certify, test, inspect or verify service or product compliance with this document, and does not assume any responsibility for user compliance with any applicable laws and regulations. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the IICRC and is solely the responsibility of the certifier or maker of the statement. The IICRC does not endorse proprietary products or methods.

Table of Contents

ANSI/IICRC S520 Standard for Professional Mold Remediation

Section 1 – Scope, Purpose and Application	13
Section 2 – References	14
Section 3 – Definitions	15
Section 4 – Principles of Mold Remediation	17
Section 5 – Equipment, Tools and Materials	19
Section 6 – Building and Material Science	22
Section 7 – Remediator Qualifications	24
Section 8 – Safety and Health	25
Section 9 – Administrative Procedures, Documentation and Risk Management	32
Section 10 – Inspection and Preliminary Determination	36
Section 11 – Limitations, Complexities, Complications and Conflicts	39
Section 12 – Structural Remediation	41
Section 13 – HVAC Remediation	52
Section 14 – Contents Remediation	55
Section 15 – Post-Remediation Verification	63
Section 16 – Indoor Environmental Professional	64
Section 17 – Final Documentation	64

Foreword

Awareness of mold growth in buildings has risen sharply in recent years. Several factors have contributed to this heightened awareness, including energy conservation measures, changes in building materials, the use of fast-track construction techniques, failure of occupants to manage moisture intrusion and humidity properly, and an increased reliance on mechanical Heating, Ventilating and Air Conditioning (HVAC) systems for comfort control. In addition, significant media focus and litigation have fueled increased consumer concern.

Response by public and private organizations to mold concerns led to the publication of several documents and guidelines that address mold remediation. They were written primarily for risk managers, building managers, occupational safety and health professionals, public health officials, and those making remediation decisions. The ANSI/IICRC S520 Mold Remediation Consensus Body has considered those existing documents; e.g., New York City Department of Health (NYCDOH) guidelines, Environmental Protection Agency (EPA) guidelines, and National Institute of Environmental Health Sciences (NIEHS), Recognition, Evaluation and Control of Indoor Mold (AIHA Green Book), ACGIH Bioaerosols: Assessment and Control, AIHA Field Guide for the Determination of Biological Contamination in Environmental Samples, in the development of this document.

In 1994, the Institute of Inspection, Cleaning and Restoration Certification (IICRC) first published the *Standard and Reference Guide for Professional Water Damage Restoration* (S500, revised 1999, 2006, 2015), which describes procedures for water damage restoration of structures, systems, and contents. While the S500 was a significant step forward in the water damage restoration industry and it recognized the problem of microbial growth associated with water damage, it was not intended to provide specific guidance on the subject of mold remediation. The ANSI/IICRC S520 *Standard for Professional Mold Remediation* attempts to combine essential scientific principles with practical procedures for remediators facing mold remediation challenges.

The ANSI/IICRC S520 is a procedural Standard. However, the information herein does not preclude use in performance-based scopes of work for mold remediation. It is based on reliable remediation principles, review of available scientific and industry literature and information, and practical experience. In addition, there has been extensive consultation with, and information obtained from, numerous other sources. These sources include, but are not necessarily limited to microbiologists and other scientists, government and public health professionals, industrial hygienists, international, national and regional trade associations serving the professional mold remediation industry, chemical formulators and equipment manufacturers, cleaning and remediation training schools, remediation firms, the insurance industry, allied trades persons and others with specialized experience. This document is subject to further revision as developments occur in technology and procedures.

This document is written for use by those involved in the mold remediation industry, primarily for mold remediation companies and workers, and secondarily, for others who investigate or assess mold complaints, prepare remediation specifications, protocols or procedures, and manage remediation projects, (e.g., indoor environmental professionals (IEPs), other specialized experts) and finally, for other potential materially interested parties (e.g., consumers and occupants, property owners and managers, insurance company representatives, government and regulatory bodies). The ANSI/IICRC S520 is a voluntary Standard. Although attempts have been made to ensure that this Standard is technically consistent with knowledge about mold remediation at the date of its publication, there is no representation or guarantee that every issue and topic relevant to mold remediation has been thoroughly addressed. Users of this document should stay updated and informed about the rapid developments in the field of mold remediation, implement changes in technology and procedures, as appropriate, and follow applicable federal, state, provincial, and local laws and regulations. All mold

remediation projects are unique and in certain circumstances, common sense, experience and professional judgment may justify deviation from this Standard. It is the responsibility of the remediator to verify on a case-by-case basis that application of this Standard is appropriate. When in doubt, apply caution and seek additional professional opinions. Users of this document assume all risks and liability resulting from use of and reliance upon this Standard.

The Standard summarizes most of the significant and important procedures and methodologies of a mold remediation project. The ANSI/IICRC S520 Standard and IICRC R520 Reference Guide complement one another and should be considered in tandem. The S520 does not attempt to teach mold remediation procedures, but rather provides the principles and foundation for understanding proper remediation practices. The S520 is not a substitute for remediation training and certification programs that are necessary to attain competence in the field of mold remediation and properly apply this Standard.

The ANSI/IICRC S520 is not intended to establish procedures or criteria for assessing mold contamination in an indoor environment. These issues are most appropriately addressed by professional organizations that represent IEPs. Since these professional organizations have not agreed upon threshold exposure limits or levels of visible mold growth that constitute a concern for occupant and worker safety, the IICRC S520 Mold Remediation Consensus Body Standard Committee decided not to establish action levels or procedures based upon the quantity or size of the area of visible mold growth.

Remediators and other parties to the remediation process often request specific guidance regarding quantities of mold or mold spores that trigger remediation activities or confirm remediation success. Quantifying visible levels of mold growth alone is not feasible as an action level decision criterion, because it does not take into consideration hidden, concealed (not readily visible) mold growth, and it does not take into consideration contamination resulting from settled spores (not visible) that were dispersed from areas of actual growth.

Thus, ANSI/IICRC S520 represents a philosophical shift away from using "size" of visible mold growth to determine the remediation response. Instead, it establishes mold contamination definitions, (Conditions 1, 2, and 3) and guidance, which, when properly applied, can assist remediators and others in determining remediation response or confirm remediation success.

The terms "indoor environmental professional" and "IEP" are used in this document and in the remediation industry to generically describe individuals having advanced technical competency in a wide range of subjects related to mold in the built environment, that qualify them to perform assessments and related professional services typically provided by an IEP, as defined in this document. Because there is such a broad array of skills encompassed within the description of an IEP, it is impossible to develop a single, meaningful course of study that would adequately address the advanced levels of knowledge an IEP should possess within their area of specialization. Therefore, the terms "indoor environmental professional" and "IEP" are used in this document and in the remediation industry as a description, and not as a title, designation, certification, trademark, or service mark. Consequently, there is no single license, designation or certification that qualifies an IEP. The qualifications required for an IEP are often gained through years of formal study at the university level, specific training related to mold and the indoor environment, and years of on-the-job work experience, or a combination of these factors. Therefore, the IICRC does not offer or recognize a professional certification or designation for an IEP, and prohibits the exclusive use or co-option of the terms "indoor environmental professional" and "IEP" in association with any one individual, entity or organization, as such use would be contrary to the intent of this document. However, use of the terms "indoor environmental professional" and "IEP" as a generic description is permitted. Remediators and others who engage an indoor environmental professional are advised to consider the individual's knowledge,

skill, education, training and experience to best judge their ability, qualifications and competence, as further explained in this document.

This Standard does not specifically address the protocols and procedures for remediation when potentially hazardous, regulated materials are present or likely to be present in mold-contaminated structures, systems, and contents. Such potentially hazardous, regulated materials include but are not limited to: asbestos, lead, arsenic, mercury, polychlorinated biphenyls (PCBs), pesticides, fuels, solvents, radiological residues, and other chemical and biological contaminants. This standard also does not address water damage restoration; please reference the latest edition of ANSI/IICRC S500 *Standard and Reference Guide for Professional Water Damage Restoration* for information directly related to water damage restoration.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. The IICRC is not responsible for identifying any or all such patent rights.

The S520 is a living document subject to change as more information regarding mold contamination and remediation becomes available and as scientific developments occur and advancements are made in remediation technology and practice. The S520 will be reviewed, evaluated, and validated through application in the field, and thereafter revised and improved. This process and further professional and public review allows the industry to develop a body of mold remediation science and achieve the overall IICRC goal of improving the environments in which people live and work.

Acknowledgements

This publication is the result of a collaborative effort involving industry experts and trade associations, educational institutions, training schools and other organizations. The Institute of Inspection, Cleaning and Restoration Certification (IICRC) is the principle designer of the document.

The development and publication of this document was made possible through the generous contributions of a dedicated group of volunteers. The IICRC Board of Directors and the Standards Committee genuinely appreciate the time and effort contributed by these individuals. They exhibit the true volunteer spirit that has been the driving force behind the IICRC since its inception. At the time of approval of the third edition of the ANSI/IICRC S520 Standard for Professional Mold Remediation, the IICRC S520 Mold Remediation Consensus Body consisted of the members listed below. Other contributors and some past contributors to this document and their respective roles are also listed below.

IICRC Standards Committee:

IICRC Standards Chairman

Howard Wolf
HW3 Group, LLC,
Restoration Consulting

IICRC Standards Vice-Chairman

Lee Senter
Dryit Company

IICRC Standards Vice-Chairman

Mickey Lee
Mickey Lee Consulting, LLC

IICRC S100 Committee Chairman

Doug Bradford
Eco Interior Maintenance

IICRC S100 Committee Vice-Chairman

Richard Bodo
Windsor Industries

S210 Committee Chairman

Greg Laviolette
Stone Restoration Services

S210 Committee Vice-Chairman

Martin Brookes
Heritage Marble and Tile Inc.

S300 Committee Chairman

Paul Pearce
Country House Carpet Care

S300 Committee Vice-Chairman

Ed Hobbs
Hobbs Ultra-Clean Service

IICRC S500 Committee Chairman

Mickey Lee
Mickey Lee Consulting, LLC

IICRC S500 Committee Vice-Chairman

Chris Taylor
Aspire Training Group

IICRC S520 Chairman

Jim Pearson
Mold Inspection Services, Inc.

IICRC S520 Vice-Chairman

Scott Armour
Armour Applied Science, LLC

IICRC S540 Committee Chairman

Kent Berg
National Institute of Decontamination Specialists

IICRC S540 Committee Vice-Chairman

David Oakes
Captain Clean, Inc.

IICRC S600 Committee Chairman

Tom Jennings
World Floor Covering Association

IICRC S600 Committee Vice-Chairman

Jeff Bishop
Clean Care Seminars

IICRC S800 Committee Chairman

Bill Doan

IICRC S800 Committee Vice-Chairman

Lewis Migliore
LGM & Associates Technical Flooring Services

IICRC S520 MOLD REMEDIATION CONSENSUS BODY MEMBERS

S520 Consensus Body Chair

Jim Pearson

Mold Inspection Services, Inc.

S520 Consensus Body Vice-Chair

Scott Armour

Armour Applied Science, LLC.

S520 Consensus Body Members

Michael Bowdoin

Michael Bowdoin, Attorney at Law

Cole Stanton

Fiberlock Technologies, Inc.

Connie Morbach

Sanit-Air, Inc.

Robert G. Baker

BBJ Environmental Solutions, Inc.

John Banta

Restoration Consultants

Michael McGuinness

R.K. Occupational & Environmental Analysis, Inc.

Graham Dick

Genesis Restoration, Ltd.

James Lee Senter

Dryit.CA

Dave Dybdahl

American Risk Management Resources Network, LLC.

ADDITIONAL CONTRIBUTORS

Michael Pinto

Wonder Makers Environmental

Brad Harr

Summit Environmental Inc.

IICRC Chairman, Board of Directors

Tony Wheelwright

IICRC Standards Director

Mili Washington
IICRC

IICRC Legal Counsel

Charles A. Isley
Christel & Isely, LLP

Editor

Patricia L. Harman
Andrews, Logan & Harman, LLC

Important Definitions

Throughout this document the terms “shall,” “should,” and “recommend” are used to compare and contrast the different levels of importance attached to certain practices and procedures. It is impractical to prescribe procedures intended to apply to every mold remediation situation. In certain circumstances, deviation from portions of this Standard may be appropriate. Carelessness is unacceptable and common sense and professional judgment are to be exercised in all cases.

shall: when the term *shall* (previously “must”) is used in this document, it means that the practice or procedure is mandatory due to natural law or regulatory requirement, including occupational, public health and other relevant laws, rules or regulations, and is therefore a component of the accepted “standard of care” to be followed.

should: when the term *should* (previously “highly recommended”) is used in this document, it means that the practice or procedure is a component of the accepted “standard of care” to be followed, while not mandatory by regulatory requirements.

recommend(ed): when the term *recommend(ed)* is used in this document, it means that the practice or procedure is advised or suggested, but is not a component of the accepted “standard of care” to be followed.

In addition, the terms “may” and “can” are also available to describe referenced practices or procedures, and are defined as follows:

may: when the term *may* is used in this document, it signifies permission expressed by the document, and means that a referenced practice or procedure is permissible within the limits of this document, but is not a component of the accepted “standard of care” to be followed.

can: when the term *can* is used in this document, it signifies an ability or possibility open to a user of the document, and it means that a referenced practice or procedure is possible or capable of application, but is not a component of the accepted “standard of care” to be followed

For the practical purposes of this document, it was deemed appropriate to highlight and distinguish the critical remediation methods and procedures from the less critical, by characterizing the former as the perceived and recommended “standard of care.” The IICRC S520 consensus body standard committee interprets the “standard of care” to be: practices that are common to reasonably prudent members of the trade who are recognized in the industry as qualified and competent. Notwithstanding the foregoing, this Standard is not intended to be either exhaustive or inclusive of all pertinent requirements, methods or procedures that might be appropriate on a particular mold remediation project. Ultimately, it is the responsibility of the remediator to verify on a case-by-case basis that application of this Standard is appropriate.

ANSI/IICRC S520 Standard for Professional Mold Remediation

1 Scope, Purpose and Application

1.1 Scope

This Standard describes the procedures to be followed and the precautions to be taken when performing mold remediation in residential, commercial, and institutional buildings, and the systems and personal property contents of those structures.

The Standard explains mold remediation techniques, the principles of which may apply to other microbial remediation projects or services. This Standard assumes that determining and correcting the underlying cause of mold contamination is the responsibility of a property owner, landlord, or their agent(s), and not the remediator, although a property owner may contract with a remediator or other professional to perform these services.

1.2 Purpose

It is the purpose of this Standard to define criteria and methodology to be used by remediators for inspecting mold contamination and establishing remediation procedures and safety plans.

Because of the unique circumstances encountered in mold remediation projects, it is impractical to prescribe procedures that apply to every situation. In certain circumstances, deviation from portions of this Standard may be appropriate. Carelessness is unacceptable and common sense and professional judgment are to be exercised in all cases.

Among other things, S520 does not address *Histoplasma capsulatum*, *Cryptococcus neoformans*, hanta virus, animal-derived pathogens or other highly infectious agents, including those from bird and bat droppings. Refer to the Centers for Disease Control (CDC) or the National Institute for Occupational Safety and Health (NIOSH) for appropriate decontamination procedures for these contaminants. See, for example, *Histoplasmosis, Protecting Workers at Risk*, NIOSH and NCID, U.S. Department of Health and Human Services, 2004.

In addition, this Standard does not specifically address the protocols and procedures for restoration, remediation, or abatement when potentially hazardous, regulated materials are present or likely to be present in water-damaged or contaminated structures, systems, and contents. Such potentially hazardous, regulated materials include but are not limited to: asbestos, lead, arsenic, mercury, polychlorinated biphenyls (PCBs), pesticides, fuels, solvents, radiological residues, and other chemical and biological contaminants.

1.3 Application

This Standard was written for use by those involved in the mold remediation industry, primarily for mold remediation companies and workers, and secondarily, for others who inspect or assess mold complaints, prepare remediation specifications, protocols, or procedures, and manage remediation projects (e.g., indoor environmental professionals or IEPs). Finally, this document is for other materially interested parties (e.g., consumers and occupants, property owners and managers, insurance company representatives, government and regulatory bodies).